



**TOPICAL REPORT**  
GTI PROJECT NUMBER 22788

---

## **Assessment of Residential Natural Gas & Electric Decarbonization in Fayetteville, AR**

**Report Issued:**

March 17, 2021

**Prepared For:**

Black Hills Energy

**GTI Technical Contacts:**

William Liss

Vice President, Energy Delivery & Utilization

847-768-0753

[wliiss@gti.energy](mailto:wliiss@gti.energy)

Patricia Rowley

R&D Manager, Energy Delivery & Utilization

847-768-0555

[prowley@gti.energy](mailto:prowley@gti.energy)

1700 S. Mount Prospect Rd.

Des Plaines, Illinois 60018

[www.gti.energy](http://www.gti.energy)

## Legal Notice

---

*This information was prepared by Gas Technology Institute (“GTI”) for Black Hills Energy.*

*Neither GTI, the members of GTI, the Sponsor(s), nor any person acting on behalf of any of them:*

*a. Makes any warranty or representation, express or implied with respect to the accuracy, completeness, or usefulness of the information contained in this report, or that the use of any information, apparatus, method, or process disclosed in this report may not infringe privately-owned rights. Inasmuch as this project is experimental in nature, the technical information, results, or conclusions cannot be predicted. Conclusions and analysis of results by GTI represent GTI's opinion based on inferences from measurements and empirical relationships, which inferences and assumptions are not infallible, and with respect to which competent specialists may differ.*

*b. Assumes any liability with respect to the use of, or for any and all damages resulting from the use of, any information, apparatus, method, or process disclosed in this report; any other use of, or reliance on, this report by any third party is at the third party's sole risk.*


*c. The results within this report relate only to the items tested.*

## Executive Summary

There is active dialogue on policy considerations pertaining to future pathways for reducing greenhouse gas (GHG) emissions. This report focuses on energy use and future residential GHG reduction pathways for Fayetteville, AR. This information encompasses quantitative and qualitative analytical results on consumer costs and environmental benefits as well as a review of real-world challenges and potential unanticipated consequences of residential electrification.

Key results:


- **The ratio of residential electricity and natural gas prices has grown over the past 15 years.** In 2019, Arkansas homeowner electricity prices were over 2.6 times higher than natural gas on an energy equivalent basis.
- Consumer surveys across the US provide evidence that most homeowners prefer natural gas over electricity, particularly for space heating, water heating, and cooking.
- **Residential electrification results in increases in annual energy bills for Fayetteville, AR homeowners.** A mid-efficiency case using electric heat pumps (HSPF 9) results in an increase in annual consumer energy costs of about \$2.55 million for all homes now using natural gas in Fayetteville.
- Figure 1 compares the annual energy costs and lifecycle net present cost comparisons (2020-2050) for a typical 1,542 ft<sup>2</sup> home in Fayetteville with natural gas appliances vs an all-electric home. With electrification, energy bills would increase over 45% today for a typical single-family home using efficient gas appliances.

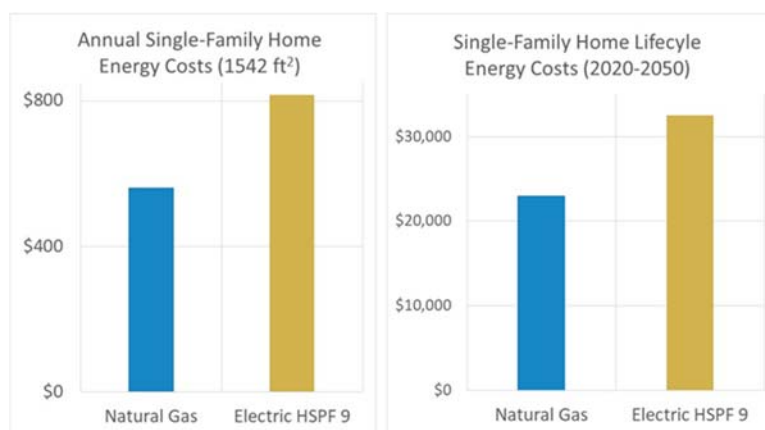

**Figure 1: Annual Energy Costs and Lifecycle Costs for Typical 1,800 ft<sup>2</sup> Single-Family Home in Fayetteville, AR**

- **All-electric homes today in Arkansas using the current average power generation mix in the state typically have higher CO<sub>2</sub> emission rates than a baseline natural gas home.**
- **Natural gas pathways for GHG reductions have lower consumer and societal costs when measured in \$/metric ton of CO<sub>2</sub> reduced (Figure 2).** Using currently available high-efficiency gas equipment results in very cost-effective GHG reductions (-\$33/metric ton of CO<sub>2</sub>) and \$27/metric ton when using 50% renewable natural gas blends with existing high-efficiency equipment. Next-generation natural gas heat pumps offer greater GHG reduction at higher costs (\$220 to \$293/metric ton of CO<sub>2</sub>). Residential electrification with typical electric heat pumps (HSPF 9) and potential future power generation improvements have CO<sub>2</sub> abatement costs of \$234 to \$306/metric ton. More expensive higher-efficiency electric heat

pumps (HSPF 13) reduce carbon abatement costs to \$137 to \$154/metric tons based on this analysis, but are likely to be 15 to 30% or more higher depending on the winter season use of natural gas power generation for electric space heating loads.

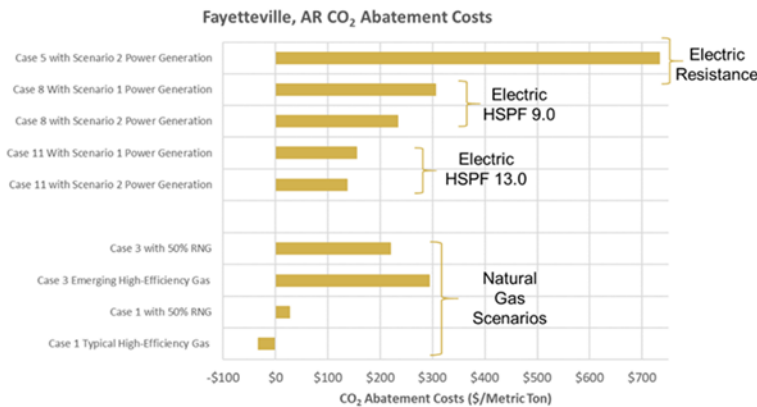

**Figure 2: Comparison of CO<sub>2</sub> Abatement Costs (\$/metric ton)**

- A three-step process is outlined in this analysis for the evolution of Arkansas power generation over the next 10-20 years (from 2030 to 2040): (1) replacement of coal generation, (2) additional capacity for expanded baseload generation under an electrification scenario, and (3) strategies to address high seasonal winter electricity demand. Step 3 is the most challenging market development need and worthy of more concentrated RD&D.
- **A significant issue with residential electrification scenarios is the seasonal energy required for space heating when cold temperatures prevail.** The potential power generation and electric infrastructure cost and reliability implications for consumers and society are significant.
- There is no evidence solar or wind resources can address prospective energy-intensive space heating electricity peaks during Arkansas winters. Solar PV systems have a significant drop in winter output.
- Using the matching principle and reasonable power generation options at this juncture, **most new winter peak electricity demand for electric space heating will be met with dispatchable natural gas generation.** Without GHG mitigation for this scenario, potential GHG reductions from electric space heating are much less than anticipated.
- There is no evidence battery energy storage can play a value-added role in meeting high winter electricity demands and there is uncertain role for pumped hydro in Arkansas.
- Using hybrid space heating systems whereby electric heat pumps provide heating at milder outdoor temperatures and natural gas heating systems operate at cold temperatures is an option that avoids a host of issues with cold weather electric heat pump operation.
- Energy reliability and resilience is critical, especially the risk of electric grid outages during cold temperatures. Natural gas distribution systems have quantifiably higher service reliability and lower outage rates than electric distribution systems, leading more homeowners to install natural gas generators to avoid the cost and issues associated with grid power interruptions.

## Table of Contents

---

<b>Legal Notice</b> .....	i
Executive Summary .....	ii
Table of Contents.....	iv
Table of Figures .....	v
List of Tables.....	vi
Introduction .....	1
Residential Energy Use, Prices, and Preferences.....	2
Residential Greenhouse Gas Reduction Pathways.....	7
Residential Greenhouse Gas Emission Reduction Pathways.....	7
Space Heating and Heat Pumps .....	8
Electricity Generation in the US and Arkansas.....	17
Seasonal and Non-Baseload Power Generation.....	19
Future Power Generation Scenarios in Arkansas.....	22
Renewable Gas.....	24
Fayetteville, AR Residential Greenhouse Gas (GHG) Reduction Analysis .....	28
Energy Planning Analysis Tool (EPAT) and Benefit/Cost Scenario Analysis.....	28
Fayetteville, AR Home GHG Reduction Pathways Cost and Benefit Results.....	30
Individual Single-Family Homes Cases.....	33
Single-Family Home With Lifecycle Cost Analysis (LCA).....	33
Special Space Heating Only Cases .....	34
Additional Home Electrification Considerations and Challenges .....	37
Natural Gas and Electric Energy Delivery Systems .....	37
Natural Gas and Electric Energy Storage Systems .....	38
Home Energy Supply Reliability and Resilience .....	42
Fayetteville, AR Home GHG Reduction Recommendations.....	45
Summary and Conclusions .....	46
Analytical Research Team and Contributors .....	49
References.....	51
Appendix A: Energy Planning Analysis Tool (EPAT) Detailed Results.....	53

## Table of Figures

---

	Page
Figure 1: Annual Energy Costs and Lifecycle Costs for Typical 1,800 ft <sup>2</sup> Single-Family Home in Fayetteville, AR.....	ii
Figure 2: Comparison of CO <sub>2</sub> Abatement Costs (\$/metric ton).....	iii
Figure 3: Fayetteville, AR Residential Space Heating Home Share (US Census) .....	2
Figure 4: Annual Average Space Conditioning Energy Use for US Homes.....	3
Figure 5: US and Arkansas Region Heating and Cooling Degree Days (DOE-EIA).....	3
Figure 6: Sparkline Graphs of Monthly Residential Energy Use in Arkansas Over Seven Years (DOE-EIA).....	4
Figure 7: National Residential Homeowner Energy Preferences .....	4
Figure 8: Arkansas Residential Electric and Natural Gas Price Trends (DOE-EIA) .....	5
Figure 9: Typical Natural Gas Home Emergency Generator (Spectrum Electric Ltd).....	6
Figure 10: Natural Gas Home Greenhouse Gas Emission Reduction Pathways .....	7
Figure 11: Example Natural Gas Heat Pumps and Efficiency .....	8
Figure 12: Residential Electric Air-Source Heat Pumps Sales Estimates.....	9
Figure 13: Cadmus Group Field Testing of Electric Heat Pumps in Northeastern US...	10
Figure 14: Electric Heat Pump Performance Below 40°F (Source: GTI) .....	11
Figure 15: Impact of Ambient Temperature on Electric Heat Pump Electricity Use.....	12
Figure 16: Impact of Cold Temperatures On February 2021 Electricity Demand .....	13
Figure 17: Electric Heat Pump Annual Heating Operating Hours in Different Climates (Source: GTI) .....	14
Figure 18: Natural Gas and Electric Hybrid Heating Systems .....	15
Figure 19: Hybrid Natural Gas and Electric Space Heating System (GTI) .....	16
Figure 20: Hybrid Natural Gas and Electric Heating System Comparisons (GTI) .....	16
Figure 21: Changes in US Power Generation Output (2014–2019, DOE-EIA).....	17
Figure 22: Arkansas Power Generation Changes (2014–2019, DOE-EIA) .....	17
Figure 23: US Power Generation Average CO <sub>2</sub> Emission Rate (DOE-EIA) .....	18
Figure 24: Arkansas Region Baseload and Non-Baseload Power Generation CO <sub>2</sub> Emission Rates .....	20
Figure 25: Arkansas 2019 Baseload, Winter, and Summer Generation Mix (DOE-EIA)	21
Figure 26: Monthly Arkansas Solar PV Generation (DOE-EIA).....	22
Figure 27: Arkansas Current Monthly Electricity Use and Projected Impact of Full Residential Electrification .....	23

Figure 28: Renewable Gas Generation Pathways (Source: American Gas Foundation)	25
Figure 29: American Gas Foundation/ICF Renewable Gas Potential	26
Figure 30: American Biogas Council Arkansas Operational RNG Plants	26
Figure 31: Fayetteville, AR Annual Energy Cost Comparison	31
Figure 32: Comparison of CO <sub>2</sub> Abatement Costs (\$/metric ton)	32
Figure 33: Fayetteville, AR Residential GHG Reduction Scenarios	33
Figure 34: Annual Energy Costs and Lifecycle Costs for Typical 1,542 ft <sup>2</sup> Single-Family Home in Fayetteville, AR	34
Figure 35: Directional Impact of Winter Peak Electricity Use on CO <sub>2</sub> Reduction and Cost/Benefit Ratio	35
Figure 36: Impact of Electrification on Peak Winter Demand (Source: GTI)	37
Figure 37: Major Natural Gas and Electric Transmission System Capacity (DOE, AEP)	38
Figure 38: Nominal Energy Storage Capacity (DOE-EIA)	40
Figure 39: Example Monthly Energy Delivery for Storage (DOE-EIA)	40
Figure 40: Energy Storage Cycle Energy Losses (DOE-EIA, GTI)	41
Figure 41: Example Energy Storage System Capacity Factors (DOE-EIA)	41
Figure 42: Size and Duration of Energy Storage Systems (adapted from National Hydropower Association report)	42
Figure 43: Trends in North American Residential Natural Gas Generators Units	43
Figure 44: Natural Gas and Electric Distribution Outage Rates and Service Reliability	43
Figure 45: Example Residential and Commercial/Industrial Natural Gas Generator Sets	44
Figure 46: Annual Energy Costs and Lifecycle Costs for Typical 1,800 ft <sup>2</sup> Single-Family Home in Fayetteville, AR	46
Figure 47: Comparison of CO <sub>2</sub> Abatement Costs (\$/metric ton)	47

## List of Tables

---

Table 1: Fayetteville, AR Residential Building Characteristics (US Census, 2019; GTI estimates).....	2
Table 2: Trends for US Electric Residential Heating Systems (DOE-EIA RECS).....	9
Table 3: Space Heating System Installed Cost and Lifetime (Source: DOE/NREL).....	14
Table 4: US and Arkansas 2019 Power Generation Mix (DOE-EIA).....	18
Table 5: Arkansas Area Power Generation Mix (DOE-EIA, EPA eGRID).....	20
Table 6: Current and Two Future Arkansas Power Generation Scenarios.....	24
Table 7: Fayetteville, AR Residential GHG Reduction Scenario Cases.....	29
Table 8: CO <sub>2</sub> Emissions Change with Current Arkansas Power Generation Mix.....	30
Table 9: Annual Energy Cost Changes with Electric Systems.....	31
Table 10: Comparison of Gas and Electric Heating Using 100% Natural Gas Power Generation (Case 15, 16).....	34
Table 11: Energy and Environmental Cost and Benefit Data.....	36
Table 12: Major Natural Gas and Electric Transmission System Capacity (DOE, AEP).....	38
Table 13: Representative Gas and Electric Energy Storage Size and Performance Metrics (DOE-EIA, GTI).....	39



## Introduction

---

There is active international, national, state, and local dialogue on policy considerations pertaining to future pathways for reducing greenhouse gas (GHG) emissions. This report focuses on energy use and future residential GHG reduction pathways for Fayetteville, AR. Natural gas and electricity, the two main residential energy choices, are reviewed in this analysis in terms of the current market situation and potential future pathways for GHG reductions using natural gas or electricity or hybrid approaches employing both energy options. The report encompasses a quantitative assessment of residential consumer economic impacts (e.g., capital costs and annual energy costs) and societal benefits and costs (e.g., GHG reduction and \$/metric CO<sub>2</sub> reduction) stemming from various future gas and electric appliances for Fayetteville, AR homes.

There are substantive energy delivery system challenges with seasonal residential space heating, including: (1) high winter peak-day/peak-month energy demand, (2) expanded need for electric generation, transmission, distribution, and energy storage assets on a limited seasonal basis, and (3) the type of generation resources typically employed for seasonal, dispatchable service. These issues may result in higher than anticipated consumer and societal costs along with lower than expected GHG reduction benefits being captured in the real world.

In some extreme cases, there are public policy discussions on eliminating natural gas service to homes. Beyond the consumer cost impacts quantified in this report, such measures would override consumer choice principles and negatively impact the growing number of homeowners using natural gas emergency generators to improve home energy system reliability and resilience.

The report reviews trends in Arkansas residential natural gas and electricity prices and discusses – at a high level – potential issues in future electric system asset investment that may arise from higher home electricity use. While relevant to policy discussions, the potential impact future electric system infrastructure investments may have on residential electricity prices is outside the report scope.

Recommendations are made for pursuing immediate no regrets, common sense, and cost-effective measures for reducing GHG emissions from Fayetteville, AR homes using natural gas. Gaseous resources – conventional natural gas and renewable gases – and their delivery infrastructure can play an important long-term role in realizing GHG reductions and energy reliability. These recommendations emphasize consumer choice, cost-effective investments (including leveraging existing infrastructure and improving building envelope thermal efficiency), the potential role for hybrid natural gas and electric systems for home space heating, an expanded role for low-carbon gaseous energy resources, and the value of future innovation and optionality. The report places an emphasis on quantified GHG reduction pathways using a common metric (i.e., \$/metric ton of CO<sub>2</sub>).


## Residential Energy Use, Prices, and Preferences

Table 1 is a breakdown of the approximately 37,700 homes in Fayetteville, AR. The largest portion are single-family detached or attached (duplex) homes (52.6%), with the balance comprising a mix of large and smaller apartment/condo buildings and mobile homes. From these data, GTI estimated the number of natural gas homes for each category (right column).

**Table 1: Fayetteville, AR Residential Building Characteristics (US Census, 2019; GTI estimates)**

Total Occupied Homes	37,671	% of Market	Estimated Natural Gas Homes
Single-Family Detached	18,288	48.5%	11,400
Single-Family Attached	1,526	4.1%	825
Multi-Family 2-4 units	3,812	10.1%	1,775
Multi-Family (over 4 units)	13,488	35.8%	4,395
Mobile Homes	516	1.4%	0


Natural gas and electricity are the main space heating energy choices for Fayetteville, AR homes (Figure 3). Natural gas has a 48.6% of the residential space heating market and electricity has the same level of market share at 48.6%.

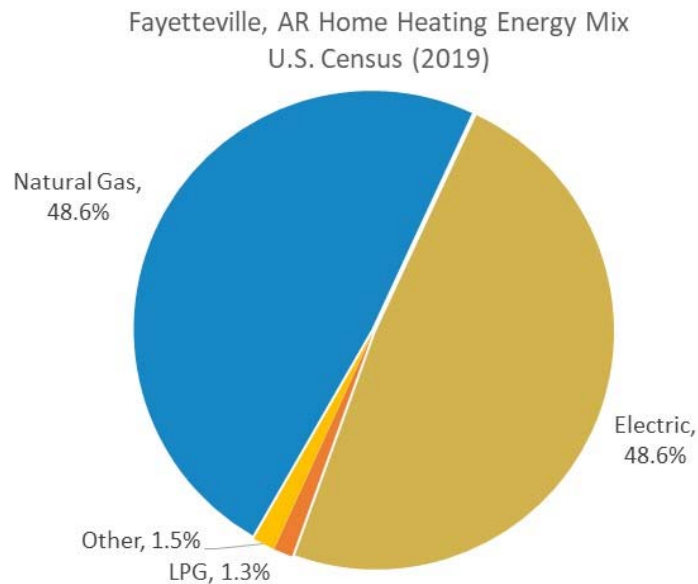

**Figure 3: Fayetteville, AR Residential Space Heating Home Share (US Census)**


Across the US residential sector, more energy is used for space heating than cooling – especially in colder-weather regions (Figure 4). As a first-order approximation, the energy required for home space conditioning depends on temperature differences inside and outside the dwelling. For example, cooling a home from 90°F to 74°F is a temperature difference of 16°F, while

heating a home from 20°F to 70°F is a temperature difference of 50°F. In addition, across much of the US, the duration of the heating season and runtime (hours) for space heating equipment is considerably higher than equipment runtime needed for cooling homes.

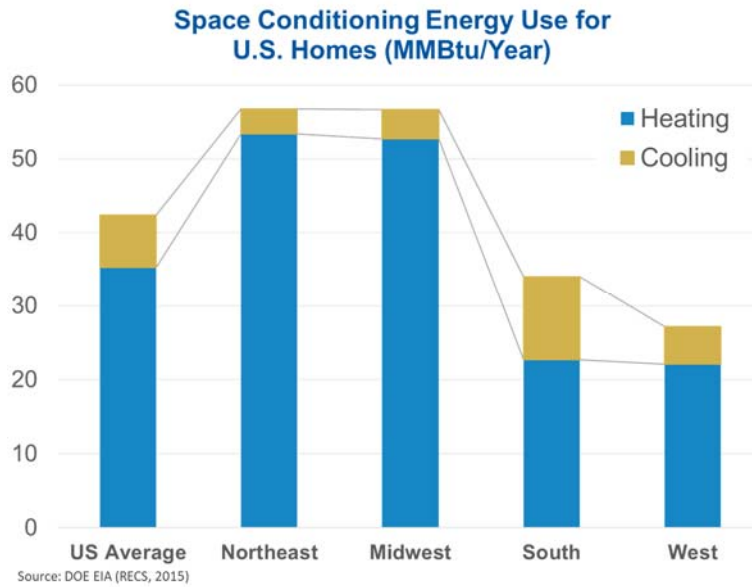

**Figure 4: Annual Average Space Conditioning Energy Use for US Homes**


Heating and Cooling Degree Days (HDD and CDD, respectively) are metrics that account for: (1) space conditioning temperature differences (that is, between the outdoor and indoor temperatures) and (2) the number of days needed for heating and cooling. Figure 5 shows HDD and CDD values since 2000 for the US compared to the nominal range for Fayetteville, AR. Fayetteville’s CDD are slightly above the US average, while HDD are similar to the US average. Fayetteville, AR HDD requirements are about 2.5 times more than CDD needs.

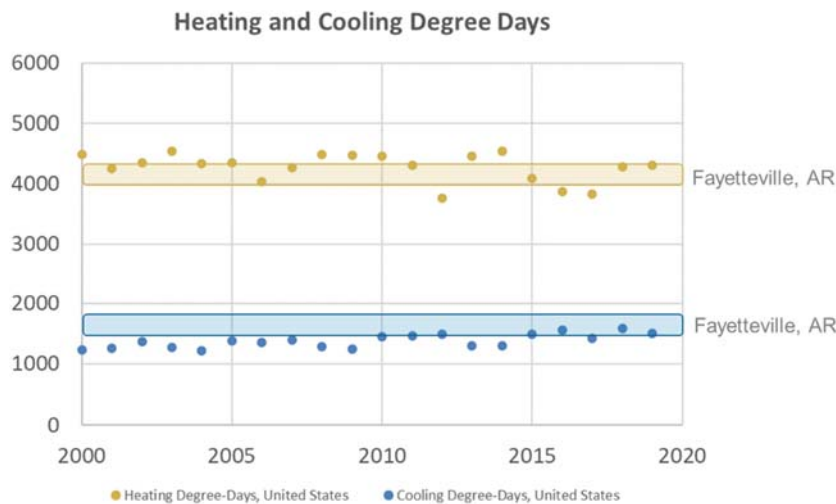

**Figure 5: US and Arkansas Region Heating and Cooling Degree Days (DOE-EIA)**


Figure 6 shows monthly electricity and natural gas energy use in Arkansas homes over a seven-year period (2013 to 2019). Each sparkline graph is on the same monthly energy use scale,

enabling direct comparisons. This highlights the larger seasonal natural gas energy required to heat Arkansas homes compared to the electricity used for cooling. This pattern of high natural gas winter peaks is seen across much of the US.

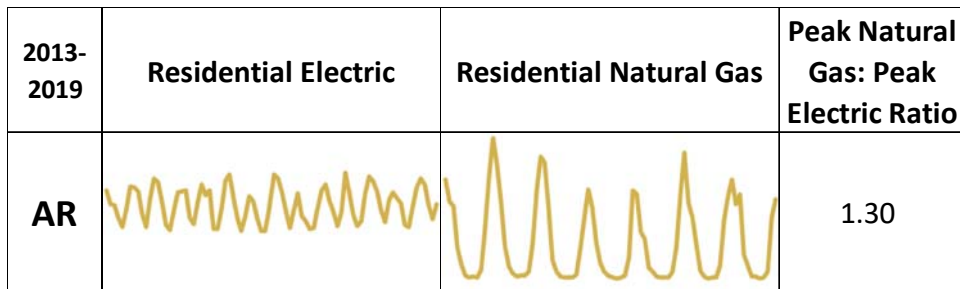

**Figure 6: Sparkline Graphs of Monthly Residential Energy Use in Arkansas Over Seven Years (DOE-EIA)**


Nationally, homeowner surveys show consumers prefer natural gas over electricity in four primary thermal energy applications: space heating, water heating, cooking, and clothes drying. Presently, about 50% of Fayetteville, AR homes use gas heating.

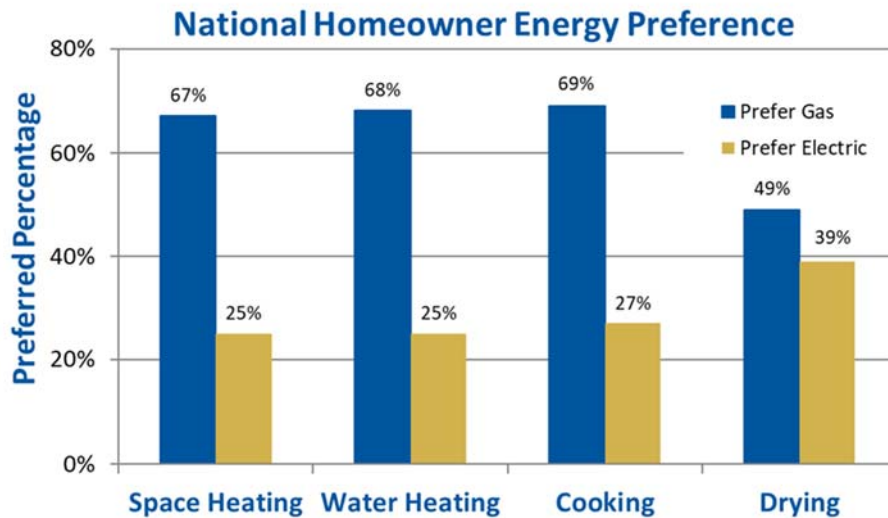

Source: Woodland, O'Brien, Scott/Energy Solutions Center (2016)

**Figure 7: National Residential Homeowner Energy Preferences**

Figure 8 shows trends for average annual Arkansas residential electricity and natural gas prices since 2005. In this period, residential electricity prices grew over 30% while natural gas prices dropped 12%. With these price changes, Arkansas residential electricity prices are over 2.6 times greater than natural gas on an energy equivalent basis. According to DOE-EIA, the average 2020 Arkansas residential electric price was 10.4 cents/kWh. In equivalent energy units, the average 2019 Arkansas residential natural gas price was about 4 cents/kWh (or about \$11.75/MMBtu).

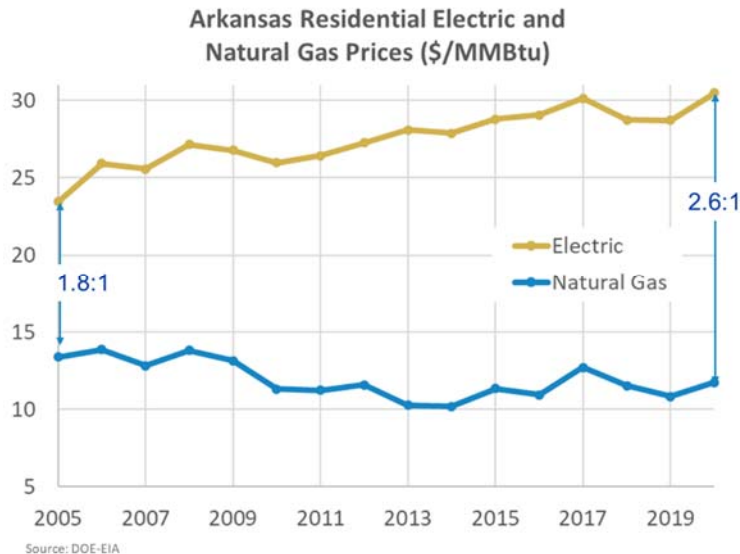

**Figure 8: Arkansas Residential Electric and Natural Gas Price Trends (DOE-EIA)**

Estimating potential future electricity price impacts from large-scale residential electrification is outside the scope of this study. However, the report discusses challenges with scaling up electric energy systems to provide the capacity and performance required for the large task of seasonal heating of homes during cold periods.

Beyond the economic value natural gas provides, consumers prefer natural gas because of its performance advantages over equivalent electric options:

- Homes heated with natural gas have greater indoor comfort due to higher delivered air temperatures compared to electric heat pumps
- Natural gas furnaces and boilers often provide 2-4 times greater energy delivery rates than electric heat pumps, allowing rapid heat up. This is particularly valuable when using energy saving setback thermostats or smart thermostats that allow indoor temperatures to drop when the home is not occupied or overnight
- Natural gas water heaters provide rapid water heating and faster recovery times (e.g., with conventional storage water heaters) or high continuous hot water rates (e.g., with more efficient gas tankless water heaters)
- Natural gas cooking provides more rapid stovetop heating of water or food products – with greater control – than conventional electric resistance stoves

Beyond traditional natural gas uses, more homeowners are using natural gas for fireplaces, outdoor grills, and home emergency generators. Natural gas fireplaces are a clean-burning alternative to wood, while virtually eliminating carbon monoxide and particulate emissions.

Residential generators are increasingly popular as a means of improving home energy security, reliability, and resilience. According to the US Census American Housing Survey, over 23% of single-family homes (nearly 15 million in total) in the US have some form of home power generation – typically a stationary or portable generator fueled by natural gas, propane, or gasoline. Over the past 15 years, natural gas home generators have grown substantially in popularity (Figure 9), due to growing reliance on electricity to provide space conditioning and refrigerated food storage as well as home internet, sump pumps, and other important services.



**Figure 9: Typical Natural Gas Home Emergency Generator (Spectrum Electric Ltd)**

In regions with intermittent electric service or potential for extended weather-driven power outages, residential generators provide homeowner security and value – including stress reduction over potential property losses and personal safety. The topic of energy delivery systems and home energy reliability is discussed in this report. The uniquely high reliability of natural gas distribution service (without the need to periodically refill propane or gasoline tanks) is an important driving force for homeowners choosing natural gas emergency generators for their homes and businesses.

## Residential Greenhouse Gas Reduction Pathways


This section reviews natural gas, electric, and hybrid natural gas/electric GHG reduction pathways for homes, providing context for the following GHG reduction benefit/cost analysis section. In crafting GHG reduction scenarios, it is essential to understand the complex dynamics that can influence the design and operation of natural gas and electric energy delivery systems along with real-world factors impacting end-use equipment performance. This presents an informed framework for differentiating between reasonable future pathways versus idealized or potentially risky scenarios with unintended or unanticipated impacts.

### Residential Greenhouse Gas Emission Reduction Pathways

Experts recognize a need to pursue multiple GHG reduction solutions based on available and emerging technology pathways to cost-effectively reduce climate change risks. Prominent potential measures and pathways for reducing residential-sector GHG emissions include:

- (1) Natural gas appliance efficiency improvements
- (2) Electric appliance efficiency improvements
- (3) Building envelope enhancements
- (4) Hybrid natural gas and electric appliance improvements
- (5) Use of renewable energy (e.g., renewable natural gas, renewable hydrogen, rooftop solar PV or solar thermal systems).

Figure 10 shows a natural gas consumer-oriented depiction of near-term (commercially available) and mid-term emerging home appliances, efficiency measures, and renewable energy options for reducing GHG emissions. As highlighted in the benefit/cost analyses, these are practical near-term and mid-term options that offer more feasible, less costly, and/or less risky solutions than wholesale residential electrification.

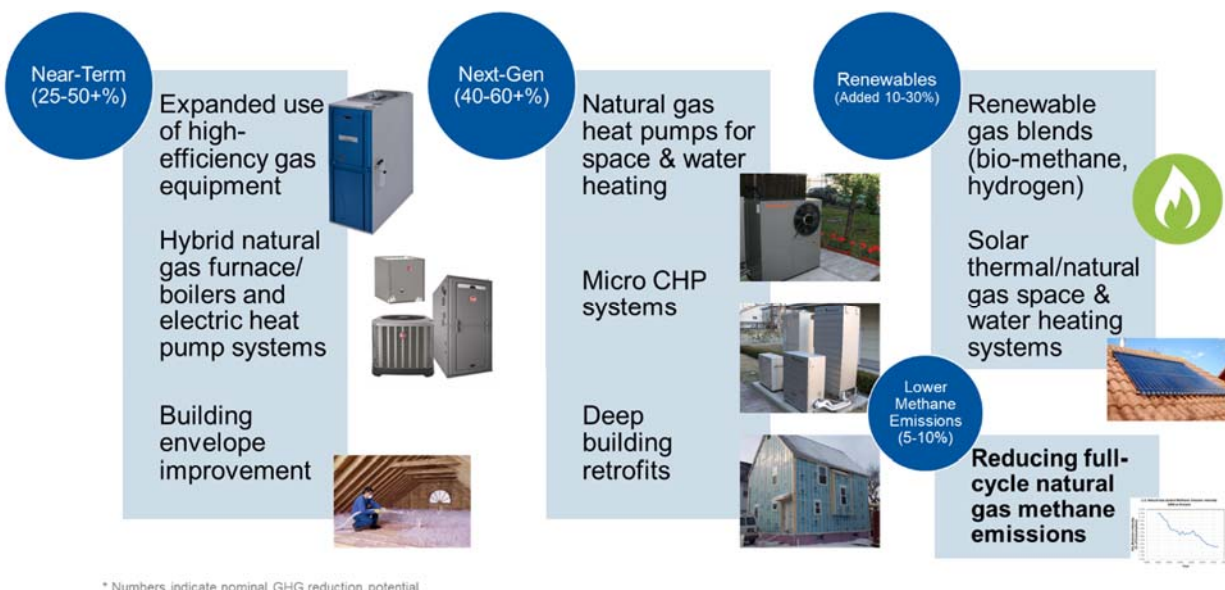


**Figure 10: Natural Gas Home Greenhouse Gas Emission Reduction Pathways**

Near-term options include high-efficiency gas equipment coupled with home weatherization. In addition, hybrid approaches with a high-efficiency natural gas furnace or boiler coupled with an electric heat pump (e.g., as an upgrade to a traditional home air conditioning system) can be implemented immediately. With hybrid space conditioning, electric heat pumps are used for heating at milder outdoor temperatures (e.g., 40°F and above) while natural gas space heating is used at colder temperatures when electric heat pump heating output and efficiency decline. For next-generation solutions, options include: (1) natural gas heat pumps and (2) renewable gas. The following sections explore these home efficiency measures as well as a discussion on electric heat pumps and electric power generation in the State of Arkansas.

### Space Heating and Heat Pumps

Space heating is the largest and most important natural gas application in homes as well as the most challenging and costly to replace with electricity. Homes with natural gas heating use a forced-air furnace or a boiler that circulates hot water in a hydronic loop. These can be either mid-efficiency (e.g., 80% efficient) or high-efficiency condensing systems (e.g., efficiencies of 92-98%). In addition, gas-fired tankless water heaters and boilers can be used as combination devices (also called combi systems) providing both hot water and space heating in a single unit, with rated efficiencies of 80% to around 98%.

Natural gas heat pumps, an emerging efficiency measure, are like electric heat pumps but use natural gas as the primary energy input. There are several gas heat pump technologies with varying levels of efficiency (Figure 11). Like electric heat pumps, gas heat pump performance and efficiency vary with outdoor temperatures, though cold outdoor temperatures have lesser impact on gas heat pumps than electric heat pumps. There are several gas heat pump technology and product development efforts underway – documented in a GTI report: The Gas Heat Pump Technology and Market Roadmap (released in 2019).

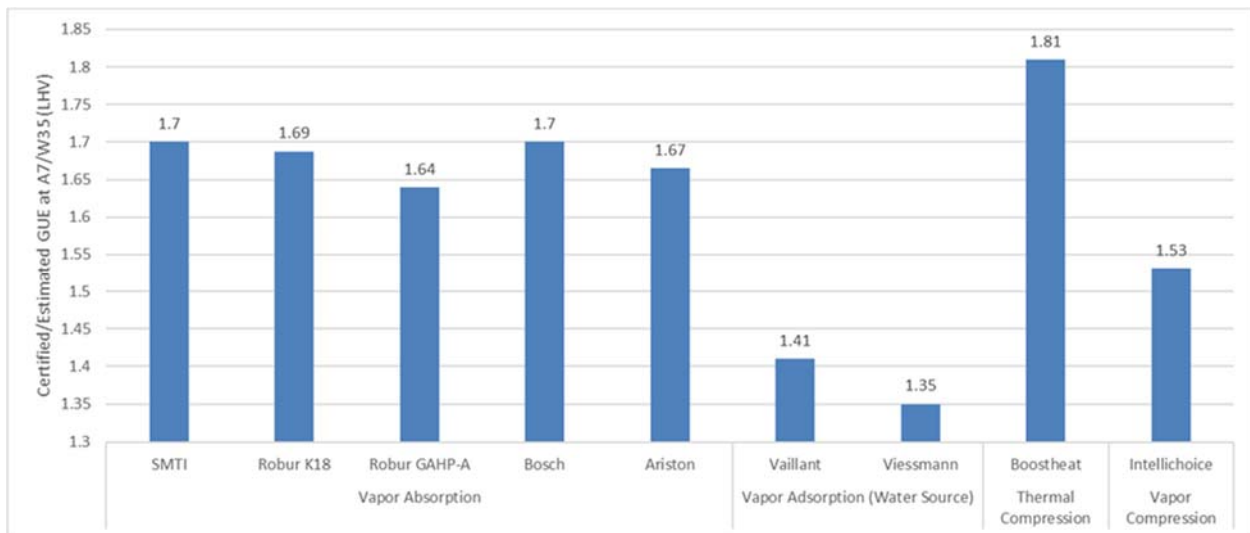

**Figure 11: Example Natural Gas Heat Pumps and Efficiency**

Table 2, based on DOE-EIA Residential Energy Consumption Survey (RECS) data, shows multi-year trends for US residential electric heating systems. The number of electrically heated homes has grown over the last 25 years (along with the total building stock), but the relative market




share of electric heat pumps in electrically heated homes is largely unchanged at about 30% (about 40% for single-family homes). As the table reveals, most homes today with electric space heat use inexpensive and less efficient electric resistance heating rather than more expensive and more efficient electric heat pumps. From an energy efficiency program and GHG reduction perspective, public policies should aim to upgrade homes from inefficient electric resistance home heating systems to electric heat pumps. This is a simpler and cost-effective strategy in comparison to wholesale energy system changes associated with switching from natural gas to electric space heating.

**Table 2: Trends for US Electric Residential Heating Systems (DOE-EIA RECS)**

<b>DOE-EIA RECS Main Heat Source (millions of homes)</b>	<b>1993</b>	<b>2005</b>	<b>2015</b>
All Homes	96.6	111.1	118.2
Electric Heating – All Types (% of homes)	25.3 (26.2%)	33.7 (30.3%)	42.9 (36.3%)
Electric Heat Pumps (% of Electric Homes)	7.5 (29.6%)	9.2 (27.3%)	12.1 (28.2%)

There is growing discussion of higher-efficiency cold-climate electric heat pumps. While new products offer efficiency improvements, data show most electric heat pump sales are units close to minimum Federal efficiency standards (Figure 12). A very small percentage of the electric heat pump market have a Heating Seasonal Performance Factor (HSPF) greater than 10 with no current signs of sales ramping up.

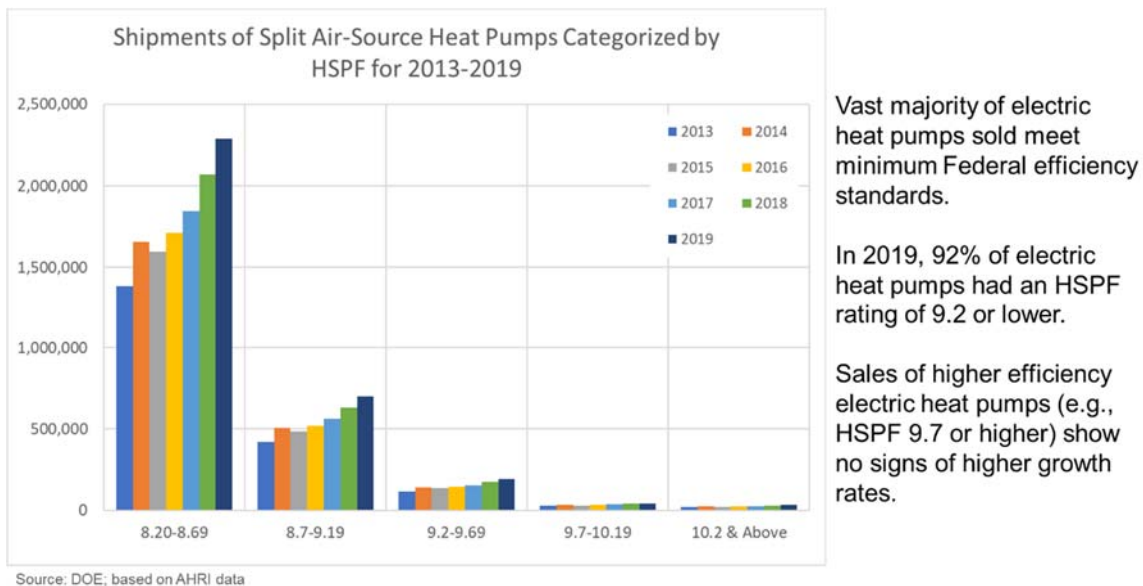


**Figure 12: Residential Electric Air-Source Heat Pumps Sales Estimates**

Beyond first cost, a key challenge and limitation of electric air-source heat pumps (EHP or ASHP) are their real-world performance and efficiency at cold outdoor temperatures. Below about 40°F, most electric heat pumps start exhibiting performance tradeoffs that may include: (1) reduced heating capacity and lower supply air temperatures, (2) reduced system efficiency (or

Coefficient of Performance, COP), (3) higher energy use for defrosting outside coils, and (4) increasing use of supplemental heating energy. At colder temperatures, electric heat pumps may use electric resistance heating for supplemental heat – which increases electricity consumption and peak power that lead to a decline in total electric heating efficiency. In other instances, homes may switch to supplemental heating provided by a natural gas furnace during cold periods to avoid costly electric resistance heating (i.e., a hybrid heating system).

Manufacturer ratings for electric heat pumps do not satisfactorily account for total, real-world energy use. Several factors can reduce electric heat pump efficiency, including: efficiency and capacity reduction from frost, snow, or dust accumulation on outdoor coils; electric energy used to defrost outdoor coils; standby parasitic power and cycling losses; efficiency and performance degradation from improper refrigerant charge; and energy required for supplemental heating at cold temperatures. These factors lead to real-world electric heat pump system efficiencies that are less than rated values obtained from testing under controlled conditions.


Figure 13 shows recent independent large-scale cold-weather field testing of residential electric heat pumps. System performance notably declined as outdoor temperatures dropped; impacts of snow and ice accumulation on outdoor electric heat pumps were also documented.

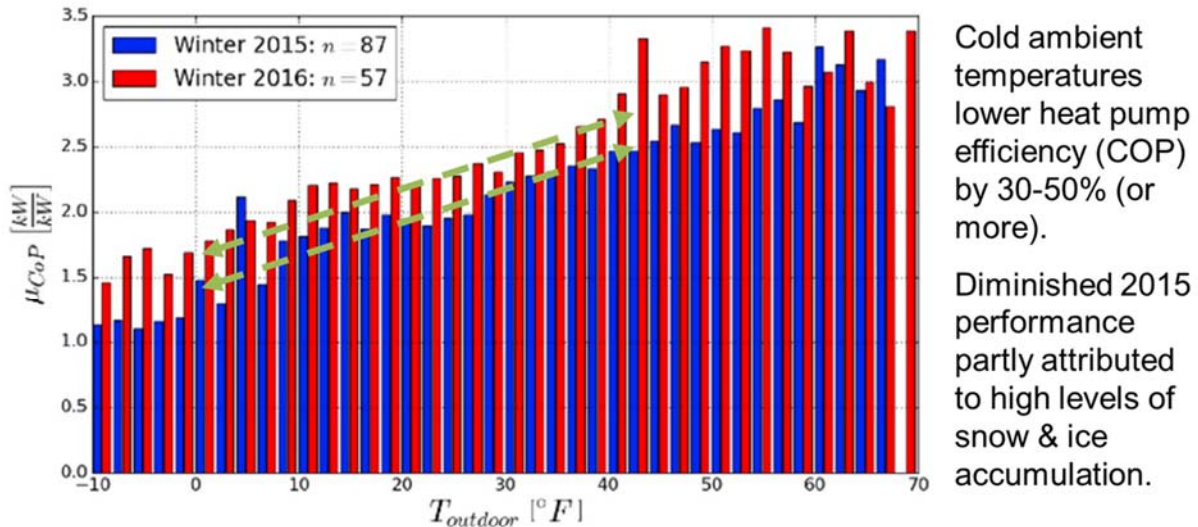

Ductless Mini-Split Heat Pump Impact Evaluation (Cadmus Group, Dec. 2016). Testing conducted on homes in Massachusetts and Rhode Island.


**Figure 13: Cadmus Group Field Testing of Electric Heat Pumps in Northeastern US**

GTI has conducted extensive lab and field testing as well as computer modeling of electric heat pump performance and efficiency, including conventional units as well as newer equipment characterized as cold climate (ccEHP) systems. Figure 14 shows representative performance data for electric heat pumps at colder temperatures (below 40°F). These data account for real-world conditions like defrosting outside air coils and standby power consumption. Conventional electric heat pumps with nominal HSPF values around 9 (over 90% of current sales) show decreasing COP values at colder temperatures and fall below 1.5 COP around 10°F. Higher-efficiency (HSPF 10 and above) cold-climate electric heat pumps have improved efficiency but show a decline in efficiency from 40°F down to 10°F and lower. Cold-climate heat pumps are an improvement but have higher first costs and are not yet representative of consumer choices.

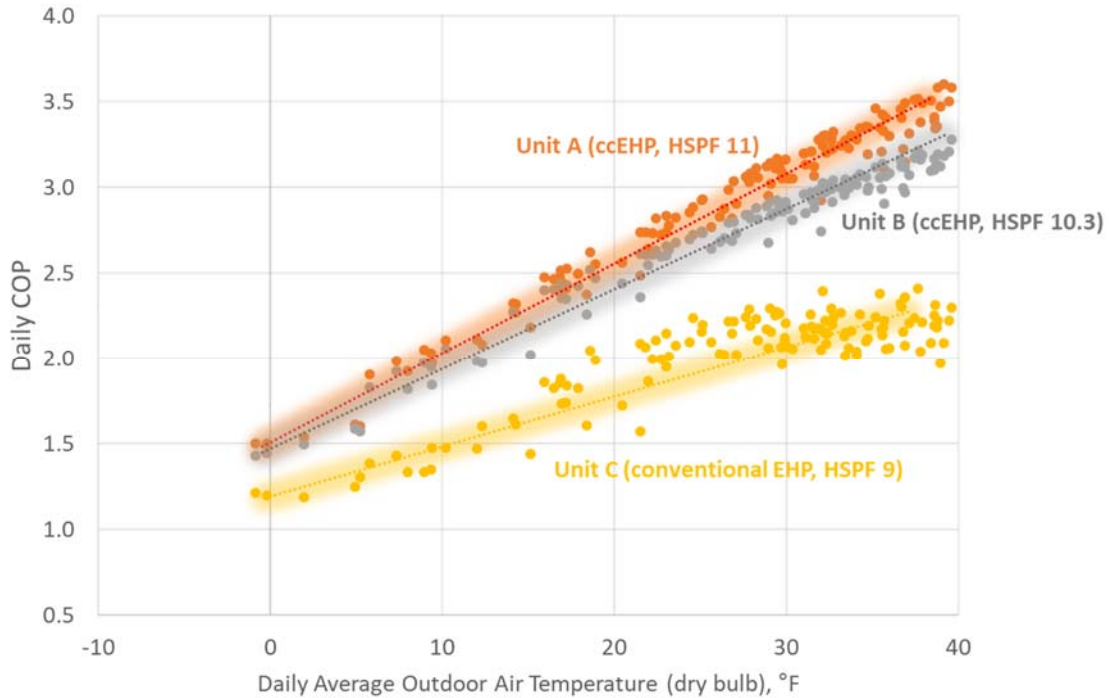

**Figure 14: Electric Heat Pump Performance Below 40°F (Source: GTI)**

Figure 15 provides further insights into the critical issue of non-linear increase in electricity use for space heating as outdoor temperatures drop. In this example, the building space heating load (shown in dark blue in left graph) increases by a factor of 2.7 at 20°F and by a factor of 3.9 at 0°F. These graphs illustrate the increased heating needed to maintain indoor temperatures independent of the heating source. Since electric heat pump efficiency (or COP) goes down with temperature, there is a compounded non-linear growth in average hourly electricity consumption at colder outdoor temperatures. For example, a conventional electric heat pump (HSPF 9, shown in light blue) will use 7.8 times more electricity at 0°F than it would at the baseline conditions of 40°F. The right figure shows an example of the absolute electricity consumed in an average hour as ambient temperatures change – with the more efficient heat pump using 9.3 times more electricity than its reference baseline at 40°F. On an absolute basis, the more efficient cold-climate electric heat pumps, shown in gold, uses about 20% less electricity than a conventional electric heat pump at 0°F. These graphs would continue a non-linear increase at sub-zero temperatures. Note that these data are based on a nominal, well-insulated 1,660 ft<sup>2</sup> home built to 2010 International Energy Conservation Code (IECC) building standards. Older homes and/or larger homes will have proportionately larger hourly electricity demands and will have a further compounding effect on peak hourly electricity use at cold ambient temperatures.

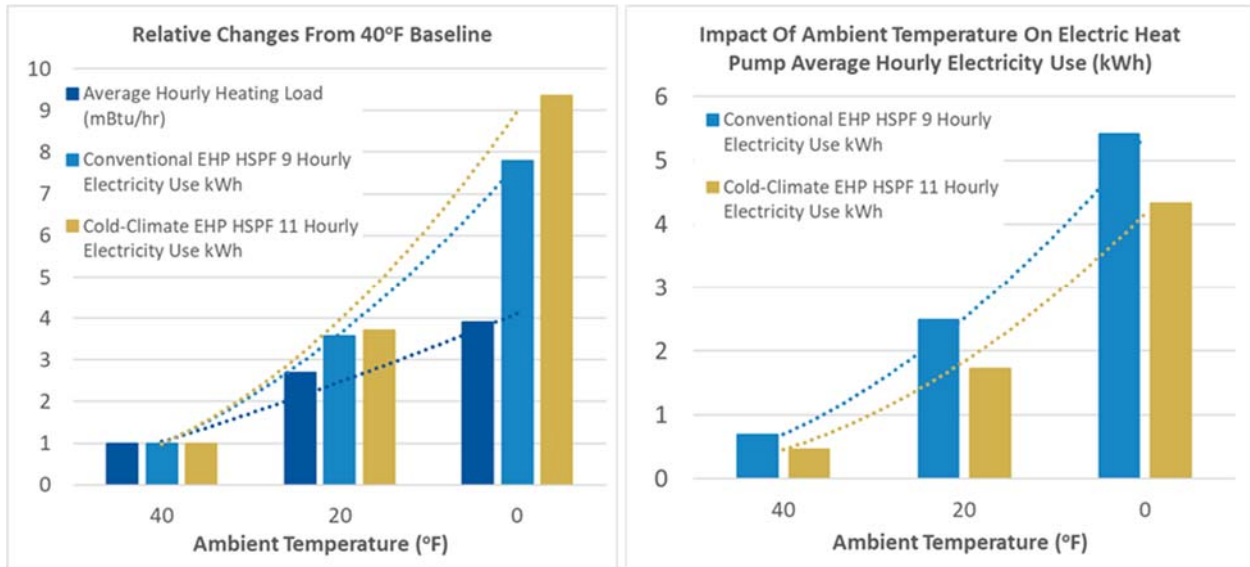

**Figure 15: Impact of Ambient Temperature on Electric Heat Pump Electricity Use**

Cold-climate electric heat pumps improve cold weather performance and efficiency compared with conventional EHP units by raising refrigeration compressor speeds at colder temperatures and by incorporating more heat exchanger surface area (which results in higher capital costs). At this juncture, there is uncertainty whether a higher compressor speed operating strategy may impact cold-climate electric heat pump equipment durability and life.


In nearly all cases, operating electric heat pumps at very cold temperatures (e.g., below 10°F) leads to a notable drop-off in heating capacity and efficiency. This has serious implications for consumer energy costs and for power generation and infrastructure sizing. Some manufacturers indicate that electric heat pumps may shut off during extreme cold weather events (e.g., <-15°F) such as during a polar vortex event.

Electric heat pumps limitations at colder ambient temperatures raise several consumer and energy supplier concerns:

- Is a back-up home heating source available to ensure consumer comfort and safety?
- Will supplemental electric resistance heating substantially raise consumer heating bills?
- Will widespread simultaneous use of electric resistance heating at cold temperatures result in significantly higher peak-day electric power (generation, transmission, and distribution) asset requirements?

Recent events provide an illustration of the impact that cold temperatures have on electricity demand in regions where more than 50% of homes use electric space heating as their primary energy choice. Figure 16 shows DOE-EIA electricity usage as a function of outdoor temperature (based on the average daily temperature in Dallas, TX). During this period, a cold-weather front moved into Texas over a multi-day period that led to a nearly 40% increase in total electricity demand; this increase is driven exclusively by electric space heating loads in the residential, commercial, and industrial sectors. This substantial increase in electricity demand due to cold temperatures could not adequately be met by all generation resources, leading to widespread outages over an extended period in large parts of the Texas market. While much discussion has

centered on electricity supply, it is important to highlight this outage event occurred due to electric space conditioning loads (heating).

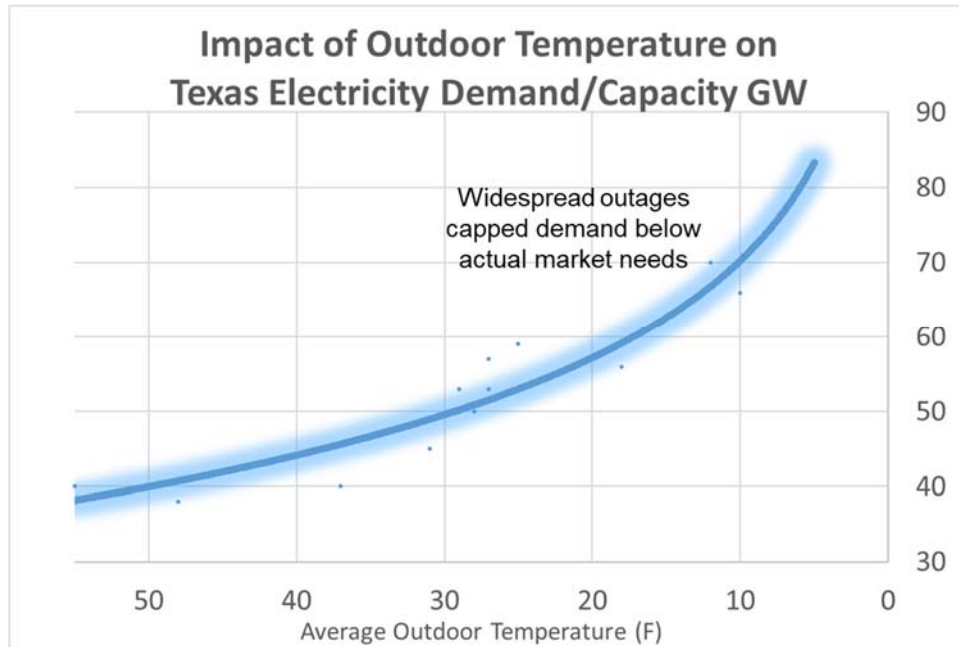

**Figure 16: Impact of Cold Temperatures On February 2021 Electricity Demand**


The Texas cold-weather event shows clear empirical data that reinforces the non-linear impact of cold temperatures on electricity demand (as shown previously in Figure 15). It is noteworthy that in August, 2020, widespread electricity outages occurred in California also due to electric space conditioning loads (cooling in that instance). For reasons that have been highlighted in the earlier discussion of HDD and CDD, electric space heating loads are more severe than cooling load impacts due to the much larger temperature differences between outdoor and indoor spaces. Adding more electric space heating loads places an enormous peak electricity burden on electric generation, transmission, and distribution systems – more than space cooling.

From a consumer perspective, there are three primary economic considerations for space heating equipment: (1) equipment installed cost, (2) annual operating cost, and (3) equipment life. Table 3 shows DOE data on space heating equipment cost and lifetime. The capital and installed cost of a conventional electric heat pump is estimated at 85% or greater than a natural gas furnace; higher-efficiency cold-climate heat pumps are even greater. While not directly addressed in this report, the retrofit installed cost for replacing gas heating with an electric heat pump(s) may be even higher than these estimates – especially for homes using hydronic heating. In addition, the expected life of an electric heat pump is around 15.5 years – about 28% shorter than a natural gas furnace equipment lifetime of about 21.5 years.

**Table 3: Space Heating System Installed Cost and Lifetime (Source: DOE/NREL)**

Space Heating Systems	Installed Cost	Equipment Lifetime Range, (Midpoint)
Natural Gas Furnace	\$2,760 - 3,040	16 – 27 Years (21.5 Years; ~40% longer)
Electric Heat Pump	\$5,100 – 6,100 (~85+% higher)	9 – 22 Years (15.5 Years)

There are unanswered questions on newer cold-climate electric heat pump operating life. Using electric heat pumps in non-traditional cold climates will result in higher annual heating run hours. Figure 17 shows GTI modeling data on annual operating hours using conventional and cold-climate electric heat pumps in different regions. Cold-climate EHP equipment have annual heating-mode runtime values 2-3 times higher than heat pumps operated in milder climates.

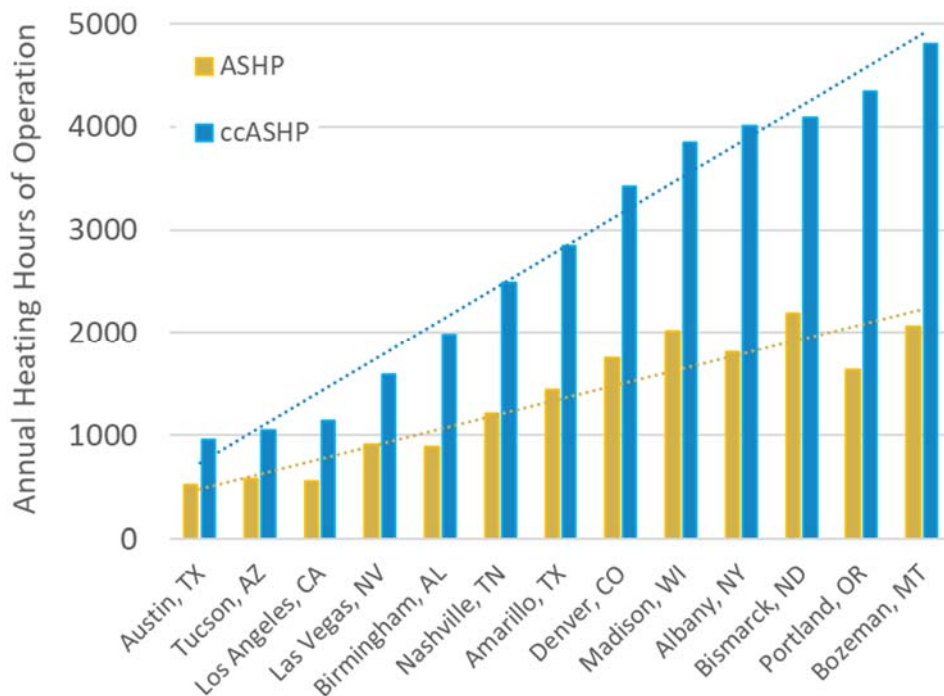

**Figure 17: Electric Heat Pump Annual Heating Operating Hours in Different Climates (Source: GTI)**

While long-term empirical evidence is pending, cold-climate electric heat pumps operating in cold-weather regions should see higher annual runtime. If run hours are a primary determinant of equipment life, these systems could see lower lifetime when measured in years of service.

Taken together, over the long term, consumers will pay more in capital costs for an electric heat pump compared to a gas furnace. This is due to the higher first cost of electric heat pumps as well as shorter equipment lifetime. The full lifecycle cost impact is somewhat lessened when factoring in consumer use of air conditioning systems – since an electric heat pump provides heating and cooling in one unit.


Complementing electric heat pumps with natural gas heating equipment (i.e., hybrid gas/electric systems) and using natural gas to satisfy heating loads at colder temperatures helps ameliorate consumer and societal cost impacts (Figure 18 and Figure 19) and empowers consumers and utilities with choices. Supplemental gas heating is a cost-effective peakshaving approach to avoid significant peaks in electric demand during very cold periods when electric heat pump efficiency drops and electricity use goes up. This is especially important for electric grid-constrained regions. Supplemental gas heating also reduces an electric heat pump’s annual runtime which may extend equipment years of service. A hybrid heating strategy also avoids running electric heating equipment mainly on dispatchable power generating systems (e.g., natural gas combined-cycle plants) that are likely to have higher GHG emission rates; this will largely negate potential electric space heating GHG reductions.

## Complementary ‘Hybrid’ Natural Gas and Electric Space Conditioning Systems

- **“Hybrid” space conditioning systems** empower consumers to make smart choices
  - And avoid using electric systems when they’re inefficient, costly, or would place extreme loads on electric distribution systems
- **Steps**
  - 1. Invest in home/building envelope improvements to lower space conditioning loads (gas & electric EE programs)
  - 2. Retain/use high-efficiency gas furnaces (natural gas EE programs)
  - 3. Replace air conditioners with electric heat pumps and/or replace electric resistance space heating with electric heat pumps (electric EE programs)
  - 4. Smart thermostats that choose electric or gas space heating depending on outdoor temperature, operating cost, or other factors (gas & electric EE programs)



**Figure 18: Natural Gas and Electric Hybrid Heating Systems**

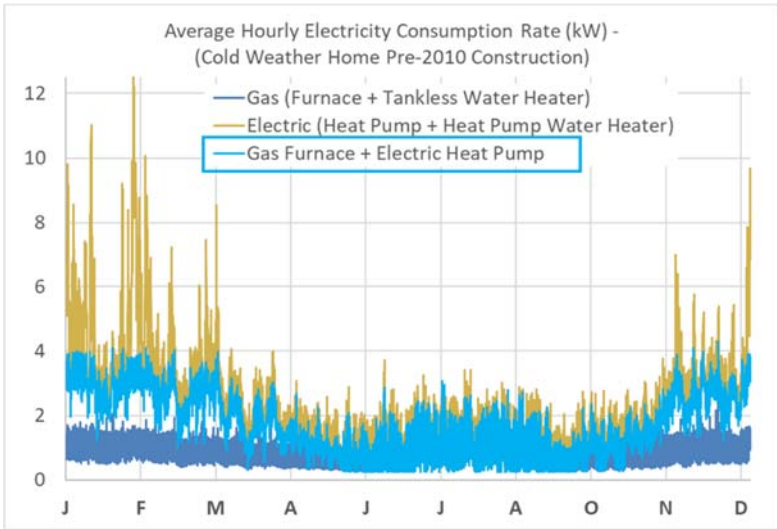

Detailed 8,760 hour residential home energy model.


All-electric home space heating results in massive increases in peak winter demand.

Hybrid heating approach with natural gas furnace and electric heat pump (run on mild winter days) dramatically lowers peak electric demand impacts and related negative issues.

**Figure 19: Hybrid Natural Gas and Electric Space Heating System (GTI)**

Figure 20 shows results of GTI modeling of a 1,660 ft<sup>2</sup> home built to the 2010 IECC standard (example home located in Colorado). Electricity use with only electric heat pumps and electric resistance supplemental heating results in large increases in electricity consumption. Hybrid gas and electric systems provide a potential middle-ground solution that avoids many deleterious effects with dedicated electric heating systems in cold-weather regions.

## Hybrid Natural Gas & Electric Heating Systems

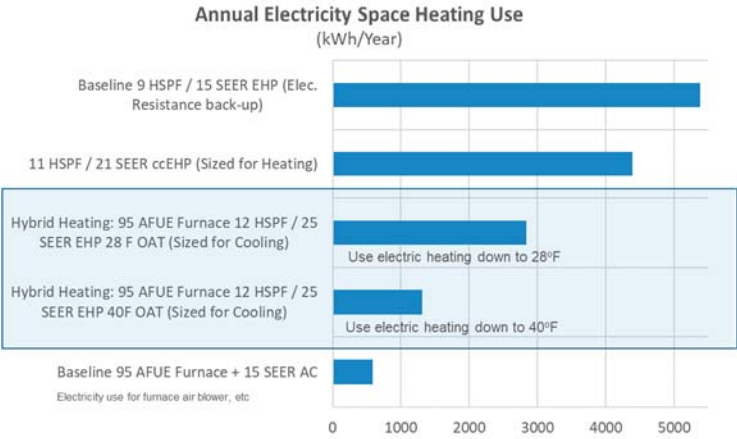

Source: GTI home energy modeling  
Colorado Home: 1,660 ft<sup>2</sup> built to 2010 IECC standards

**Hybrid natural gas and electric heating systems** – a high-efficiency gas furnace with an electric heat pump operating at milder winter temperatures – results in lower peak electricity use.

This avoids issues with grid and power generation investments upgrades to address shorter-duration seasonal loads.

Example shows a smaller home built to more modern energy efficiency standards. Larger homes and older homes would have higher electric heating use impacts.


**Figure 20: Hybrid Natural Gas and Electric Heating System Comparisons (GTI)**



## Electricity Generation in the US and Arkansas


This section reviews the current and potential future power generation mix in the US and Arkansas. Power generation is intimately connected to understanding the impact of residential electrification and potential GHG reduction pathways. Factoring in power generation emissions enables a comprehensive full-fuel-cycle review of primary energy and emissions associated with different scenarios.

The US electric power generation sector (Figure 21) has undergone significant change, driven by the growth of natural gas, wind, and solar power generation sources along with a precipitous decline in coal generation (made possible by a large fleet of aging coal power plants).

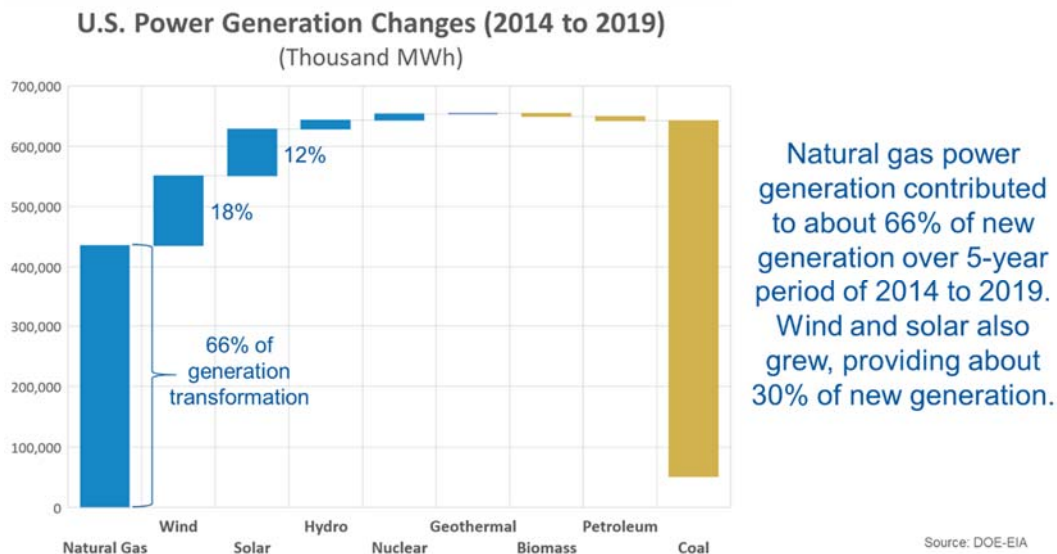


**Figure 21: Changes in US Power Generation Output (2014–2019, DOE-EIA)**

Figure 22 shows the primary power generation in Arkansas changes since 2014, with substantial addition of natural gas generation offsetting reductions in coal along with slight changes in nuclear and biomass generation output.

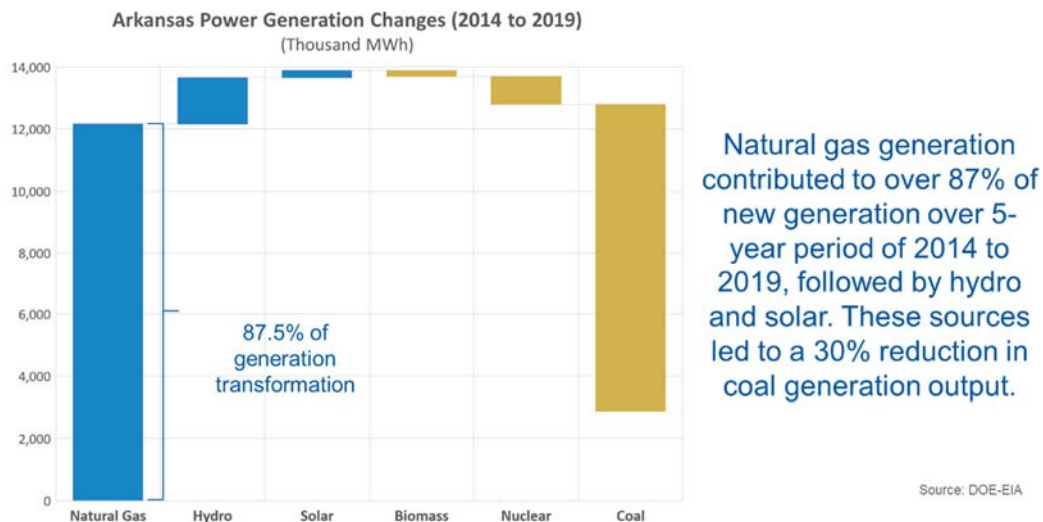

**Figure 22: Arkansas Power Generation Changes (2014–2019, DOE-EIA)**

Figure 23 shows trends in the US power generation average CO<sub>2</sub> emission rate since 2005 and two annual Arkansas data points. US power generation averaged about 402 grams of CO<sub>2</sub> emitted per kWh of electricity generated in 2019 – a roughly one-third reduction compared to 2005. Arkansas has seen little change in power sector CO<sub>2</sub> emissions rate from 2005 to 2018 and is now around 534 g CO<sub>2</sub>/kWh – higher than the U.S. average.

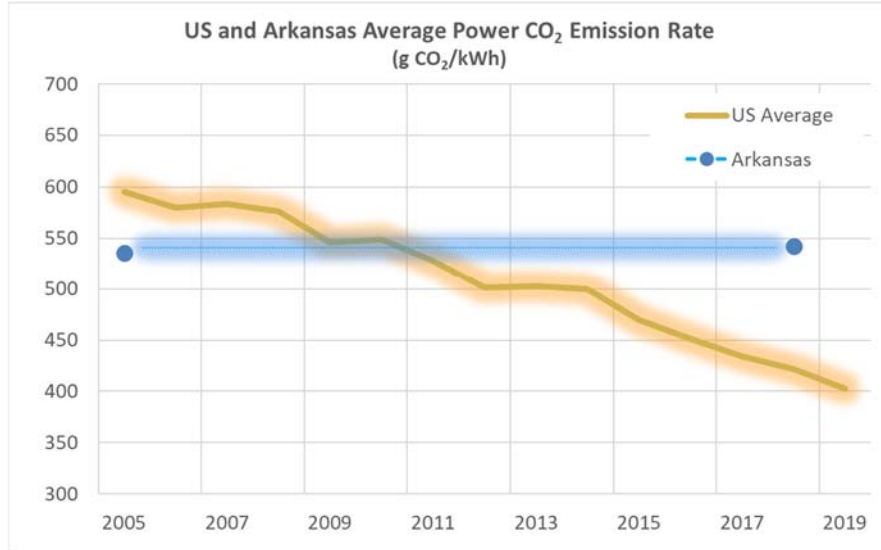

**Figure 23: US Power Generation Average CO<sub>2</sub> Emission Rate (DOE-EIA)**

Table 4 compares the 2019 US and Arkansas power generation mix. Arkansas has a higher level of coal generation and lacks wind generation. Further displacement of coal is needed to bring about improvements in electric sector CO<sub>2</sub> intensity (e.g., in terms of grams CO<sub>2</sub>/kWh).

**Table 4: US and Arkansas 2019 Power Generation Mix (DOE-EIA)**

2019 Power Generation Mix	United States	Arkansas
Natural Gas	38.7%	33.7%
Coal	23.6%	36.2%
Oil	0.3%	0.1%
Nuclear	19.6%	21.1%
Hydro	6.5%	6.4%
Wind	7.3%	0.0%
Solar	2.6%	0.4%
Biomass	1.4%	2.1%

For planning purposes, one can formulate hypotheses – a set of scenarios – for the future Arkansas power generation mix (e.g., 2030-2050). In advance of developing such scenarios, it is pertinent to review the considerations and constraints with residential electrification:

- High seasonality of space heating energy use, particularly during cold temperatures
- Seasonal/non-baseload power generation resources and their emission rates
- Mismatch of solar PV generation output (and to a lesser extent wind) with winter peak heating loads
- Electrical energy storage limitations and energy losses

Each of these issues will be more fully reviewed in the following sections. The challenge is overlaying demand-side impacts from electrification (e.g., high winter peak demand) with a changing supply-side mix for power generation. A future with large-scale residential electrification is demonstrably different than today's market situation. Likewise, a future with large penetration of intermittent renewables such as wind and solar is also much different than today's market situation and likely to pose new challenges.

### ***Seasonal and Non-Baseload Power Generation***

There is an important consideration around generating power for building space conditioning: seasonality. The implications of seasonality are often glossed over in policy discussions of building electrification GHG reductions – yet it is significant and highly problematic.

As shown previously in Figure 6, seasonal natural gas space heating loads are vastly larger than seasonal electricity cooling loads. The importance of seasonality goes beyond the ability to deliver intense amounts of energy for short periods (e.g., multiple days or even 2-4 months for space heating loads in cold climates). This alone is significant and will be explored in detail. What is also relevant and potentially problematic is the type of power generation plants used to meet seasonal electricity use.


Seasonal or dispatchable, non-baseload power plants are different than the average or baseload power generation mix. From a GHG reduction policy perspective, seasonal power generation resources can have appreciably different CO<sub>2</sub> emission rates than baseload plants. Given the substantial energy used for building space heating, not properly accounting for seasonal power generation emission rates is likely to over-estimate the GHG benefits of residential electrification.

Table 5 shows an overview of Arkansas state-level and area-wide power generation resources, including average as well as non-baseload or seasonal power generation resources. Arkansas's 2019 power generation mix averages around 534 g CO<sub>2</sub>/kWh but generation sources matched to peak seasonal use show high reliance on dispatchable coal and natural gas (in summer) generation. The emission rate for Arkansas's summer and winter peak generation mix is over 30% higher than baseload power.

**Table 5: Arkansas Area Power Generation Mix (DOE-EIA, EPA eGRID)**

Arkansas Power Mix	Average Power Generation Mix		Seasonal/Marginal Power Generation Mix		
	DOE-EIA Arkansas Average (2019)	EPA eGRID SRMV Region All Plants (2018)	DOE-EIA 2019 Arkansas Summer Seasonal	DOE-EIA 2019 Arkansas Winter Seasonal	EPA eGRID SRMV Region Non-Baseload (2018)
CO <sub>2</sub> Emission Rate (g/kWh)	534	461	621	794	600
Natural Gas	33.7%	56.5%	35.9%	0.0%	78.0%
Coal	36.2%	16.8%	43.6%	74.5%	19.2%
Oil	0.1%	1.0%	0.0%	0.1%	1.2%
Nuclear	21.1%	20.7%	19.9%	23.5%	0.0%
Hydro	6.4%	1.3%	0.0%	0.4%	0.0%
Wind	0.0%	21.7%	0.0%	0.0%	0.0%
Solar	0.4%	0.1%	0.4%	0.0%	0.0%
Biomass	2.1%	1.6%	0.2%	1.5%	1.6%


Figure 24 shows the notable differences between baseload power compared to dispatchable power generation units run for seasonal summer and winter loads (which includes extremely large amounts of coal in both seasons and some gas generation in the summer). Winter seasonal generation is nearly 50% higher than the year-round average.

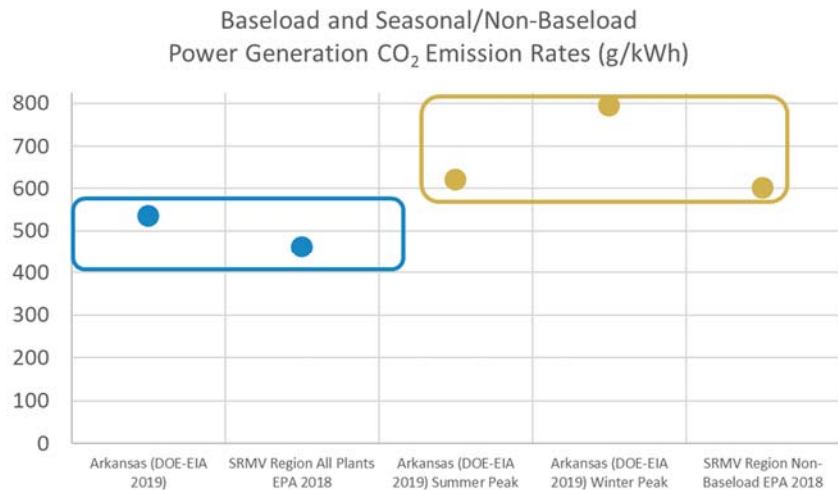

**Figure 24: Arkansas Region Baseload and Non-Baseload Power Generation CO<sub>2</sub> Emission Rates**

Figure 25 shows 2019 data for Arkansas baseload, winter, and summer generation mix from coal, natural gas, wind, and solar resources; solar and wind are currently at *de minimis* levels in


Arkansas. Baseload generation is derived from the nominal spring and fall months and compared to the summer and winter peak months (e.g., July and January). The positive seasonal generation values (i.e., above the dashed lines) are the incremental, dispatchable seasonal resources that meet peak summer or winter electricity use. In Arkansas, summer and winter electricity peaks are met with coal along with some natural gas in the summer. With extremely high coal reliance for winter peaks, shifting to electric space heating today in Arkansas uses a generation mix with roughly 50% higher CO<sub>2</sub> emission rates than baseload power plants. Under the current situation, GHG emissions will not decrease when switching residential space heating from natural gas to electricity.

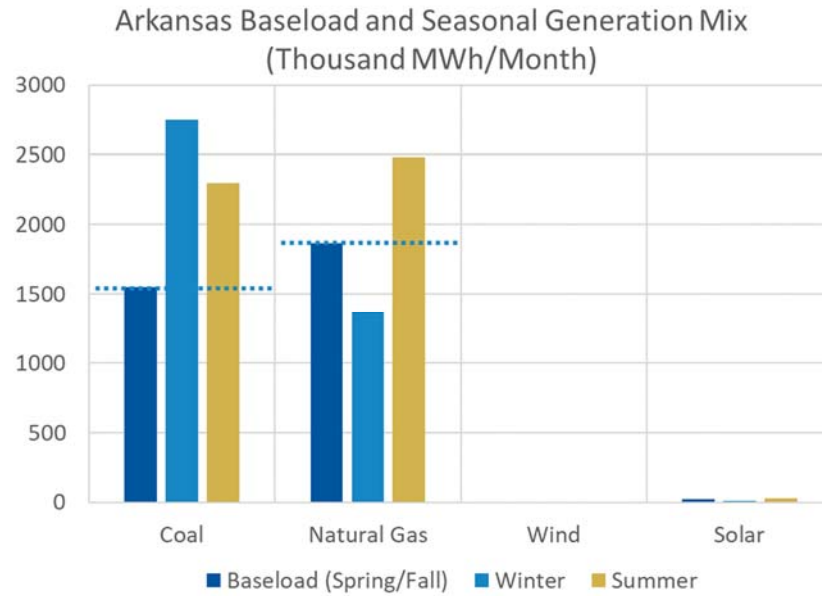

Source: DOE-EIA 2019 data, GTI analysis

**Figure 25: Arkansas 2019 Baseload, Winter, and Summer Generation Mix (DOE-EIA)**

Solar and wind generation varies throughout the year. Solar (Figure 26) is a small part of the Arkansas power generation mix, but the figure highlights the over 50% decline in winter solar PV output compared to summer peaks. This is due to the fewer winter sunlight hours and reduced sun angle; increased cloud cover or snow accumulation can also reduce winter solar PV output. This pattern of decreased output during winter months is seen with solar in general, with larger decreases in more northern regions (i.e., higher latitude).

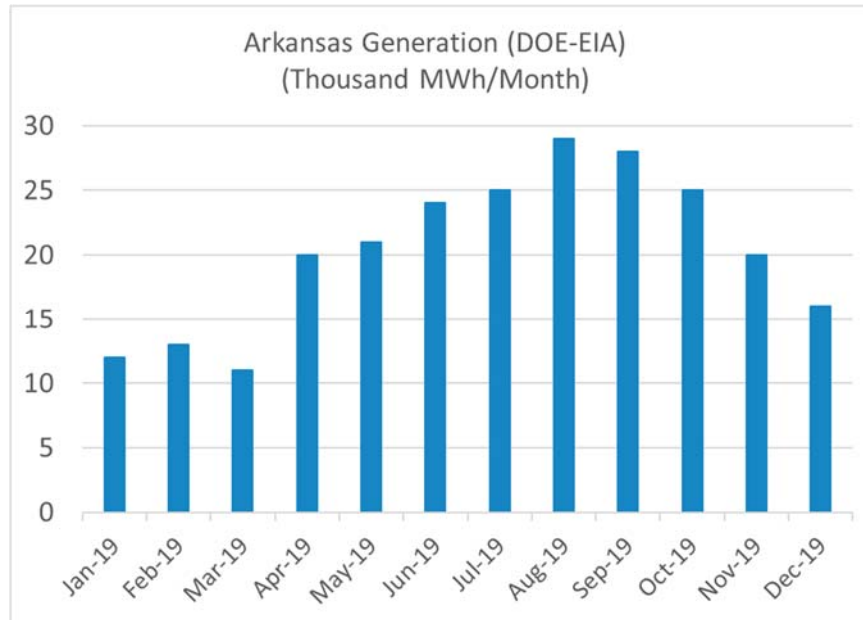

**Figure 26: Monthly Arkansas Solar PV Generation (DOE-EIA)**


A subsequent report section provides details on full-fuel-cycle emissions from using natural gas and electricity in the Arkansas residential sector. In advance, there are several key interim conclusions based on this section:

- The current average or baseload Arkansas power generation CO<sub>2</sub> emission rate (about 534 g/kWh) is above the US average
- Incremental or marginal winter seasonal power generation emission rates in Arkansas are 50% higher than baseload emission rates in Arkansas. Currently, this makes it unattractive to replace natural gas space heating with electricity as a GHG reduction strategy.
- There is no evidence solar (or wind) resources can help seasonal space heating electricity peaks during Arkansas winters; solar PV has a notable drop in winter output.

### ***Future Power Generation Scenarios in Arkansas***

The future Arkansas power generation outlook can be gauged based on the current generation mix, coupled with market experience in recent years, and assumptions on the continued phasing-out of coal generation. In a business-as-usual scenario, this can be feasibly done. However, there are limitations when considering a longer-term framework with widespread residential electrification that will change load profiles in a meaningful way.

Figure 27 shows the current and projected electricity use in Arkansas in a widespread residential electrification scenario. This includes a 10.5% increase in annual electricity use and 36% increase in residential peak month electricity use. The graph identifies the nominal monthly coal generation that needs to be displaced and the winter seasonal peak. This information will be used to craft future scenarios with a mix of baseload and seasonal, non-baseload power generation sources.

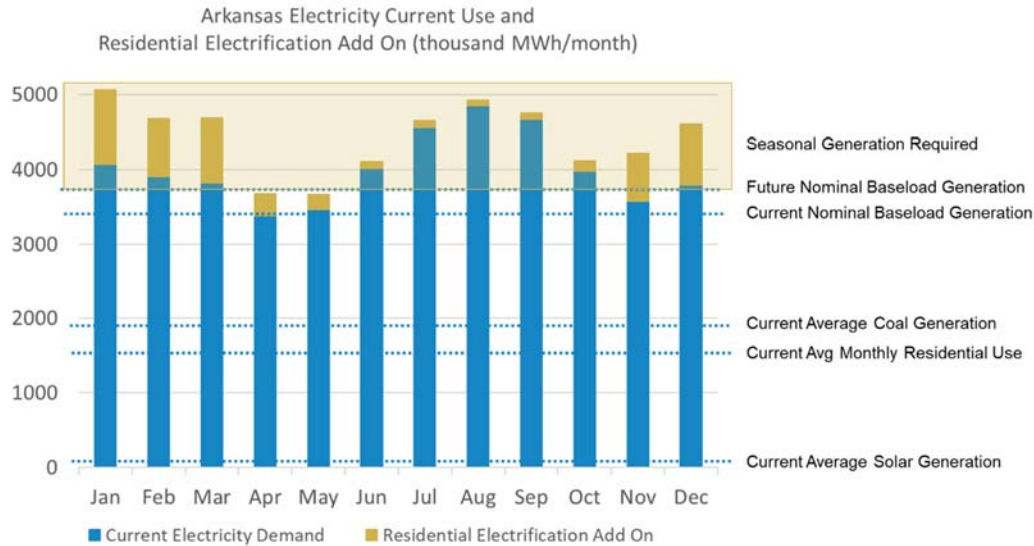

**Figure 27: Arkansas Current Monthly Electricity Use and Projected Impact of Full Residential Electrification**

There are three major changes to address the type of demand profile change shown in Figure 27:

- Step 1: Replace Arkansas coal generation with a mix of solar and natural gas.
- Step 2: Add baseload generation to address future elevated year-round baseload electricity demand.
- Step 3: Add low GHG dispatchable generation to meet increased seasonal peak electricity demand driven by electric space heating use. This step is largely addressed by dispatchable natural gas combined-cycle generation backed up with natural gas storage (based on the current market situation).

Solar and wind (though wind is not presently part of the Arkansas mix) have no peak winter seasonal generation capability. In addition, their baseload output drops in winter and results in a shortfall that needs to be replaced by natural gas power generation or some other source. Generally hydro and pumped hydro storage can provide seasonal energy storage but is not seen as likely in Arkansas. The limitations of battery energy storage, discussed in a separate section, make it an unlikely or infeasible option for sustained seasonal energy use.

Based on current and reasonable technology options, the practical power generation option for meeting about four months of winter seasonal demand (i.e., Step 3) is likely to be dispatchable natural gas generation. The GHG reduction implications of replacing natural gas space heating with mainly natural gas combined-cycle power generation will be explored in the next section – but the benefits are limited and likely detract from residential electrification space heating as a GHG reduction strategy. However, dispatchable natural gas combined-cycle plants could result in a lower GHG footprint through measures such as:

- Using renewable gas blends (e.g., bio-methane and renewable hydrogen) to fuel turbines
- Using CO<sub>2</sub> capture with sequestration or reuse

With this backdrop, it is possible to hypothesize future scenarios for power generation in Arkansas. Several key assumptions are made:

- Coal-fired generation is completely phased out in the future
- Nuclear power output remains unchanged
- A significant portion of seasonal winter electricity use (and daily grid stabilization) will come from dispatchable natural gas combined cycle plants.

Table 6 shows the current 2019 Arkansas power generation mix along with two future 2030-2040 timeframe power generation scenarios where coal is replaced by a mix of natural gas and solar generation. These two scenarios represent sizeable reductions in CO<sub>2</sub> emission rates, 52% and 60% lower than the current Arkansas power generation mix. This level of GHG emission rate is where leading states such as California and New York GHG are today. Along with the current generation mix, these future scenarios will be used in the benefit/cost analysis section of this report.

**Table 6: Current and Two Future Arkansas Power Generation Scenarios**

<b>Future Arkansas Power Generation Mix Circa 2030-2040</b>	<b>Nominal Current Power Generation Mix (2019)</b>	<b>Scenario 1: Base Case Future Arkansas Generation Mix</b>	<b>Scenario 2: Higher Renewables Future Arkansas Generation Mix</b>
Natural Gas	33.7%	57.5%	47.5%
Coal	36.2%	0%	0%
Wind	0%	0%	0%
Solar	0.4%	15%	25%
Nuclear	21.1%	21.1%	21.1%
Hydro, Oil, Biomass	6.4%, 0.1%, 2.1%	6.4%	6.4%
CO <sub>2</sub> Emission Rate (g/kWh)	530	255 (-52%)	212 (-60%)


## Renewable Gas

The following is a brief renewable gas overview. There are several pathways to generate methane (CH<sub>4</sub>) and other gases (e.g., hydrogen or H<sub>2</sub>) from renewable resources, including:

- Conventional anaerobic digestion pathways that can produce bio-methane from landfills, wastewater treatment plants, farm digesters, and other sources; these are mature pathways with established and growing commercial use today
- Thermochemical conversion (e.g., gasification) pathways that produce renewable methane or hydrogen from biomass materials (e.g., wood waste and agricultural waste)
- Power-to-gas concepts using renewable or zero-carbon power generation sources (e.g., wind, solar, nuclear) to produce hydrogen via water electrolysis (which can subsequently be combined with recycled CO<sub>2</sub> to produce methane – a process called methanation – if desired)

Figure 28, from the American Gas Foundation (AGF), provides a visual description of these renewable gas pathways and the energy sources that can be used to produce renewable gases.



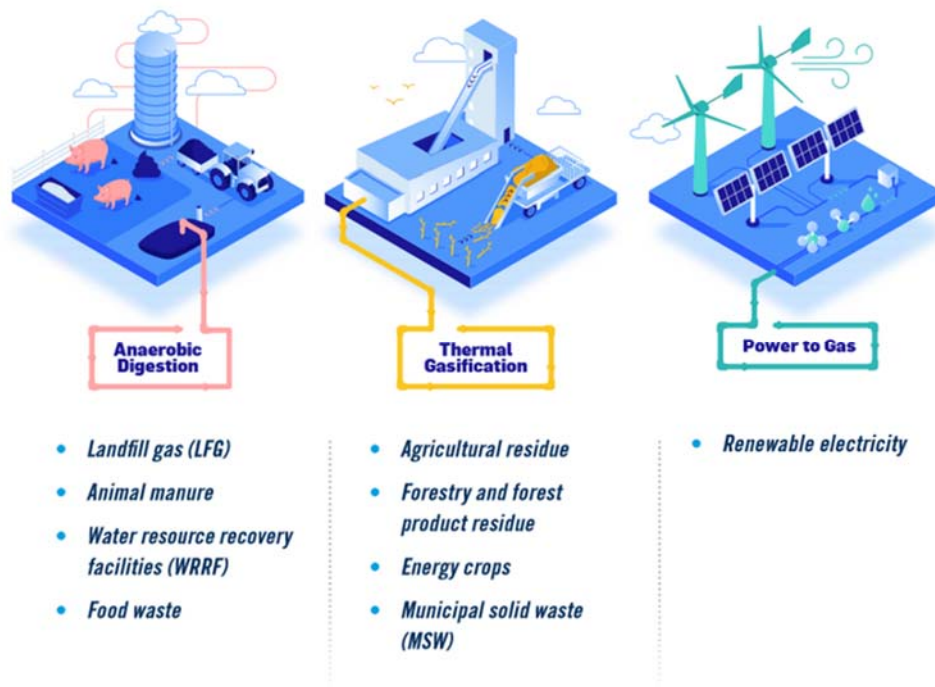

**Figure 28: Renewable Gas Generation Pathways (Source: American Gas Foundation)**


Renewable gas is an energy form – that is, chemical energy – which is important for several reasons:

- (1) Intrinsically high energy density
- (2) Readily and efficiently stored as a compressed gas
- (3) Potentially compatible with existing gas pipeline infrastructure and end-use equipment
- (4) Efficiently delivered to customers with minimal energy losses

Renewable gases can be injected into gas pipelines or used onsite to generate power, fuel vehicles, or fuel other process heating needs.


The AGF report, produced by ICF, indicates substantial US potential for three renewable gas pathways (Figure 29). The 2040 potential for renewable gas is equivalent to about 4,512 Trillion Btu/year. This is comparable to the total amount of natural gas consumed in the US residential sector – indicating a possibility for a total renewable gas displacement of conventional gas sources for this segment. For Arkansas, the AGF report indicates a technical resource potential for conventional biogas plus thermochemically produced gases of about 232 Trillion Btu/year. Much of this could come from the agricultural sector and energy crops through gasification. The amount of 232 Trillion Btu/year is significantly more than the roughly 35-40 Trillion Btu/year of natural gas consumed in Arkansas homes. In theory, all Arkansas residential natural gas use could be displaced with bio-methane.

Renewable Gas Potential by 2040  
(Trillion Btu/Year)

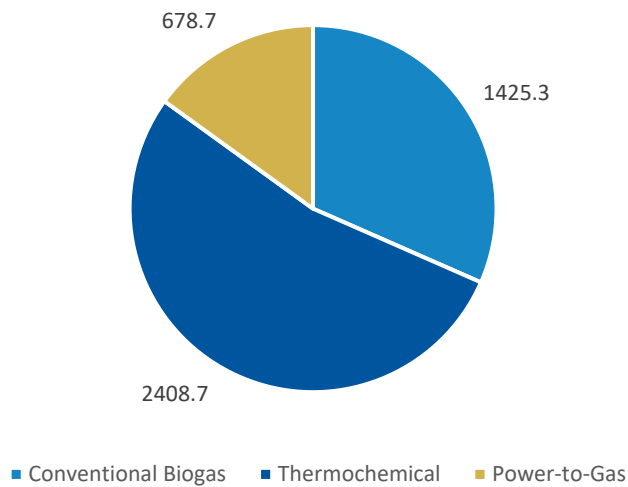

**Figure 29: American Gas Foundation/ICF Renewable Gas Potential**

Figure 30 is a snapshot of the operational biogas/bio-methane plants in the State of Arkansas. Presently, there are about 11 bio-methane systems operating in the state. From a GHG policy perspective, these systems provide a highly effective means of (1) displacing the use of conventional natural gas and (2) reducing methane emissions that might otherwise be released to the environment.

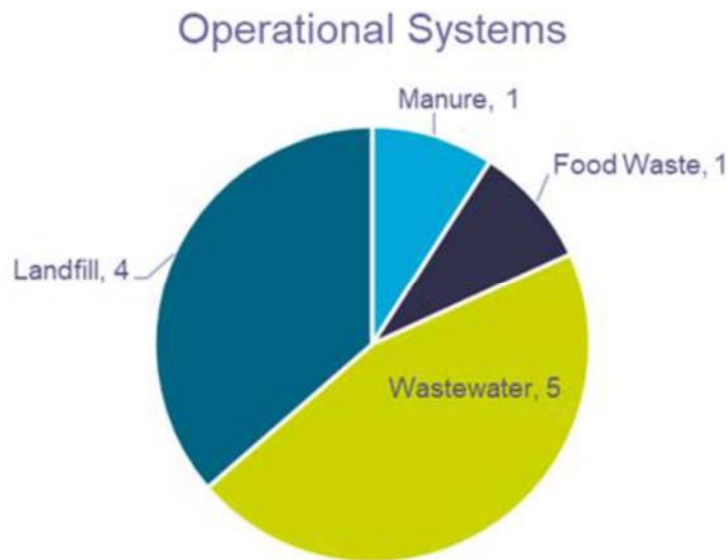

**Figure 30: American Biogas Council Arkansas Operational RNG Plants**

Next-generation renewable gas options are possible through (1) thermochemical conversion of biomass and (2) power-to-gas systems. These are not yet widely reduced to commercial practice but have long-term potential to expand the portfolio of renewable and sustainable forms of methane or hydrogen.

Thermochemical conversion of biomass to methane or hydrogen has several favorable attributes, including feedstock flexibility and greater capability to produce large volumes of renewable gas. These processes can convert agricultural wastes, forestry wastes, organic municipal wastes, and byproducts from a variety of industries. These facilities are typically 2-10 times larger than conventional biogas facilities. The sustainable availability of biomass materials in Arkansas opens the potential for these processes to be a significant long-term source of renewable gas.

Power-to-gas is a pathway that produces hydrogen through the electrolysis of water. The power can come from any electrical source but is often viewed in the context of wind and solar power (as a means of storing excess power generation) or from nuclear power plants. This hydrogen can be used directly, stored as a compressed gas, or injected into a pipeline. Through a process called methanation, it can also be combined with captured and recycled CO<sub>2</sub> to produce methane, which can be used directly with existing natural gas infrastructure. This pathway offers feasible large-scale storage of renewable energy with the capability to meet long-duration seasonal demand (e.g., space heating) which cannot be met by other energy storage systems such as batteries.

## Fayetteville, AR Residential Greenhouse Gas (GHG) Reduction Analysis

---

This section highlights information on the benefits and costs of various natural gas, electric, and hybrid natural gas/electric greenhouse gas reduction pathways for Fayetteville, AR homes. This analysis is based on a free, publicly accessible online tool developed by GTI: Energy Planning Analysis Tool (EPAT; <http://epat.gastechnology.org/>).

### ***Energy Planning Analysis Tool (EPAT) and Benefit/Cost Scenario Analysis***

EPAT is a free publicly accessible analytical tool for conducting an energy and environmental analysis of various home energy uses. EPAT relies on government published and publicly available data sources to estimate source energy (i.e., full-fuel-cycle) and emissions for energy sources like natural gas and electricity consumed at a site. EPAT accounts for upstream energy use and emissions in the production and delivery of energy, including features such as methane emissions from the full natural gas production and delivery chain as well as full-fuel-cycle energy losses and emissions from electric power generation, transmission, and distribution. The EPAT electric generation component relies on EPA eGRID data, with granular information on power generation plant efficiency and emissions on a city, state, or regional level. For each scenario, the user can select the default power generation fuel mix based on the latest eGrid state or regional data or enter a custom power generation mix.

In this analysis, we use the population of natural gas homes shown previously in Table 1. EPAT involves a pair-wise comparison of a baseline and alternative scenario. The baseline for this analysis is a home using an 80% efficient natural gas furnace, 62% efficient gas water heater, and conventional natural gas cooking and dryer equipment. From this, a series of pair-wise comparisons are made for the baseline and alternative scenarios or cases. Table 7 shows a summary matrix of the 13 comparable cases in this analysis. These will be referred to as Case 1, Case 2, etc., in the analysis discussion. Detailed summary reports of each case are included in an appendix. There are also three additional space heating-only cases (Cases, 14, 15, and 16): two special cases with electric heat pumps exclusively on seasonal, dispatchable natural gas generation and one case of replacing an existing electric resistance heating system with an electric heat pump. Building envelope improvements are shown in this table for completeness but are not part of the quantitative analysis. Improved home weatherization of homes is a critically important component of a residential building GHG reduction program. These measures provide value to consumers in the form of lower annual energy bills and improved indoor comfort while also reducing natural gas and electricity use for home space conditioning. Building envelope improvements are an important GHG reduction measure that is highly complementary and additive to the other natural gas and electric equipment-based efficiency measures assessed in this section but is not specifically assessed as a variable in this analysis.

**Table 7: Fayetteville, AR Residential GHG Reduction Scenario Cases**

<b>Natural Gas</b>	<b>No RNG</b>	<b>50% RNG</b>	
Baseline (80% efficient furnace, 62% efficient water heater, standard cooking and dryer appliances)	Baseline	--	
Existing High-Efficiency (98% efficient furnace, 95% efficient water heater, high-efficiency dryer)	1	2	
Emerging High-Efficiency (140% efficient natural gas heat pump, 130% efficient gas heat pump water heater, high-efficiency dryer)	3	4	
<b>Electricity</b>	<b>Current Power Mix</b>	<b>Scenario 1 Power Mix</b>	<b>Scenario 2 Power Mix</b>
Baseline Electric (all electric-resistance heating equipment)	5	6	7
Typical High-Efficiency Electric (HSPF 9.0 electric heat pump, water heater/EF = 0.95, standard cooking/dryer)	8	9	10
Emerging High-Efficiency Electric (HSPF 13.0 electric heat pump, electric heat pump water heater EF 2.0, induction cooking, high-efficiency dryer)	11	12	13
<b>Single Family Home Comparison</b>			
1,542 ft <sup>2</sup> single-family home using Case 2 (gas) and Case 9 (electric) input; with Lifecycle Cost Analysis (LCA)	14		
Space heating only with 100% natural gas power generation for peak winter heating with electric heat pumps (HSPF = 9, HSPF = 13) compared to a 98% efficient natural gas furnace	15, 16		
<b>Building Envelope Improvements</b>			

The main analytical thrust is energy used for space heating, water heating, cooking, and clothes drying applications. To properly account for capital costs, the natural gas cases include cost for central air conditioning systems in 80% of the homes. This allows for equitable capital cost treatment of electric heat pumps which also provide cooling. The cases with 50% renewable natural gas (RNG) assume an RNG price of \$15/MMBtu.

The current Arkansas power generation and future Scenario 1 and 2 power generation mixes, shown previously in Table 6, are used for the electric residential pathways. Note that the natural gas cases also use the Scenario 1 power generation mix, reflecting possible future GHG emission reductions for electricity used in gas equipment (e.g., furnace blower fans).

The EPAT analytical tool captures consumer costs in two main categories: annual energy costs (natural gas and electric) and capital costs. Equipment capital costs are annualized by a simple amortization achieved by dividing the capital cost by expected equipment life of the space heating systems. As noted, for gas furnaces this is 21.5 years and for heat pumps (electric or gas) this is 15.5 years. The annual energy costs and annualized capital costs are added together to provide a nominal annualized cost for each scenario – and used to calculate the GHG abatement costs in terms of \$/metric ton of GHG reduced.

A brief comment about capital costs. The EPAT tool relies on the NREL National Residential Efficiency Measures (NREM) Database for equipment costs. This NREM information resource may underestimate installed equipment costs. Further, there are likely additional upfront consumer costs in switching a home from natural gas to all-electric systems such as costs to upgrade the service panel and for additional home circuits. There also may be added costs to upgrade home space-conditioned air distribution systems, particularly for homes now using hydronic heat distribution (e.g., adding a SpacePak or similar small duct high-velocity system). There is no attempt to estimate or account for these potential added electrification capital costs or the challenges of evenly heating and cooling a home.

EPAT results also include information on the annual site and source (or full-fuel-cycle) energy use as well as a suite of annual conventional emissions (e.g., NO<sub>x</sub>, SO<sub>x</sub>) and GHG emissions (e.g., CO<sub>2</sub>, methane, CO<sub>2</sub>e).

Annualized costs are divided by the annualized emission reductions for the individual cases relative to the baseline natural gas case. This results in a GHG cost/benefit ratio – also referred to as a carbon, CO<sub>2</sub>, or GHG abatement cost – reported as \$/metric ton of CO<sub>2</sub> or CO<sub>2</sub>e reduced. In most cases, the GHG abatement cost is a positive number when consumers (and society) pay a cost premium to lower GHG emissions. In some instances, the GHG abatement cost is negative; in these highly favorable instances, consumers are saving money and reducing GHG emissions. GHG abatement costs can be considered in the context of a carbon tax or the notion of the societal cost of carbon. In some cases, with the current Arkansas power generation mix, GHG emissions increase over the natural gas baseline. These cases are labeled “GHG Increase” without any GHG abatement cost (i.e., it is not a GHG reduction measure).

### Fayetteville, AR Home GHG Reduction Pathways Cost and Benefit Results

Table 11 (at the end of this report section) provides data on Cases 1 through 13 described previously. Detailed reports on each case are included in a report appendix.

**Main Finding:** With today’s current Arkansas power generation mix, two all-electric scenarios show large increases in GHG emissions while one shows a 10% decrease (Table 8).


**Table 8: CO<sub>2</sub> Emissions Change with Current Arkansas Power Generation Mix**

Electrification Case	Change in CO <sub>2</sub> Emissions
Electric Resistance (Case 5)	88% higher
HSPF 9.0 Heat Pump (Case 8)	35% higher
HSPF 13.0 Heat Pump (Case 11)	10% lower

**Main Finding:** Two of the three all-electric scenarios result in increases in annual energy bills for Fayetteville, AR homeowners (Table 9). Mid-case electric heat pump (HSPF 9) results in a 21% increase in annual consumer energy costs (about \$2.55 million/year increase). Natural gas Case 2 using available high-efficiency furnaces and water heaters gives lowest overall costs (Figure 31).

**Table 9: Annual Energy Cost Changes with Electric Systems**


Electrification Case	Annual Energy Bills
Electric Resistance (Case 5)	68% higher (\$8.3 million increase)
HSPF 9.0 Heat Pump (Case 8)	21% higher (\$2.55 million increase)
HSPF 13.0 Heat Pump (Case 11)	19.7% lower (\$2.39 million decrease)

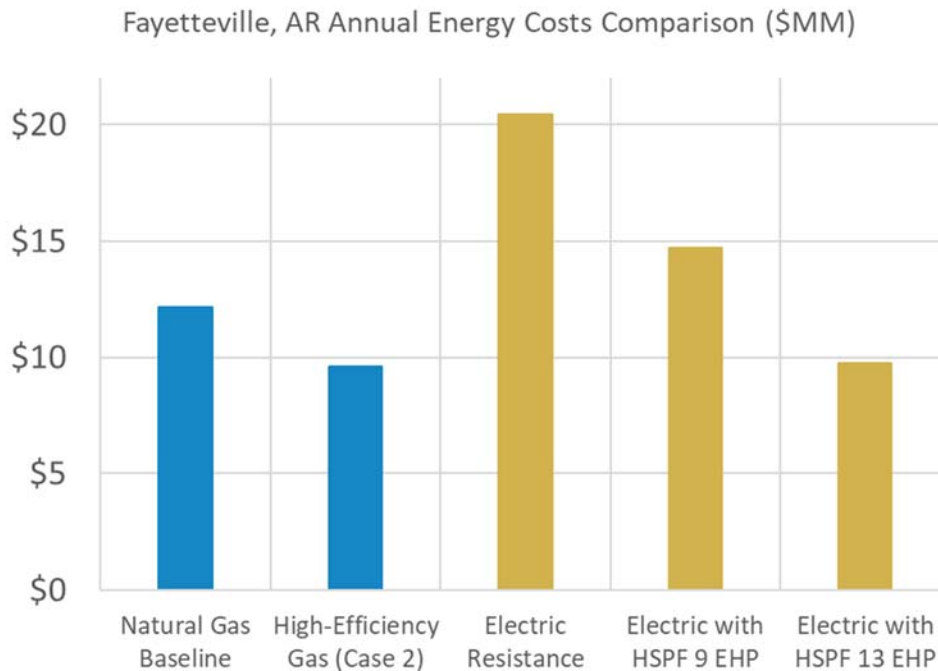

**Figure 31: Fayetteville, AR Annual Energy Cost Comparison**

Figure 32 shows a comparison of natural gas and electric GHG reduction options. Case 1 is the most cost-effective option using available high-efficiency gas equipment followed by the use of available high-efficiency gas equipment with renewable gas blends. Using natural gas heat pumps is more expensive due to the more modest heating loads seen in Fayetteville; further improvement in first cost would help make these technologies more attractive. Electrification with straight electric resistance equipment either raises GHG emissions or is very expensive as a carbon abatement measure. Conventional electric heat pumps (HSPF 9.0) cases with potential future grid mixes are higher cost, with CO<sub>2</sub> abatement costs ranging around \$230-\$305/metric ton. Higher-efficiency electric heat pumps (HSPF 13) and possible future power generation mix

are in the range of \$135-\$155/metric ton. Higher efficiency electric heat pumps come with greater initial costs that can impede market adoption. For reference, a GHG abatement cost of \$300/metric ton is like adding a \$2.67/gallon tax on gasoline or adding \$15.92/MMBtu to the cost of natural gas.

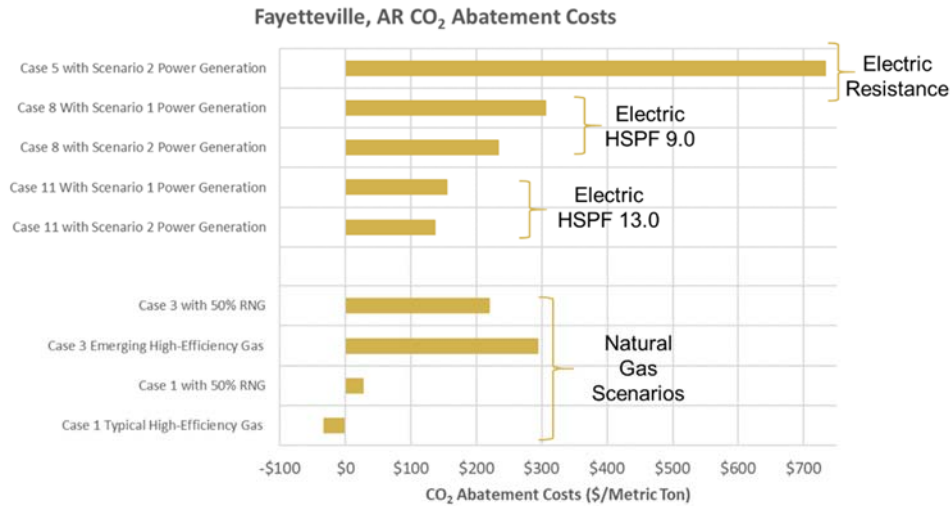

**Figure 32: Comparison of CO<sub>2</sub> Abatement Costs (\$/metric ton)<sup>1</sup>**


There are cautionary factors for the electrification scenarios that are not included in this analysis: (1) the potential for future electricity price increases, (2) solar PV winter generation drops nearly 50% during the coldest months, and (3) the likelihood much of the electric space heating will use dispatchable natural gas power generation resulting in lower real-world CO<sub>2</sub> reductions and elevated abatement costs. It is also worth remembering that building envelope improvements can yield additional percent reductions for gas and electric cases with attendant costs (not included in this analysis).

Figure 33 captures Fayetteville, AR natural gas and electric residential GHG reduction options. Natural gas offers options with the ability to reduce CO<sub>2</sub> emissions by 22% to 58%. Electrification cases require major future power generation mix changes in order to effectively reduce GHG emissions (which may not be realized in practice) but have the potential to be attractive for only the highest efficiency electric heat pumps.

---

<sup>1</sup> Actual CO<sub>2</sub> abatement costs for electrification will likely be higher when factoring in emissions from dispatchable generators used to meet seasonal winter demand for electric space heating.



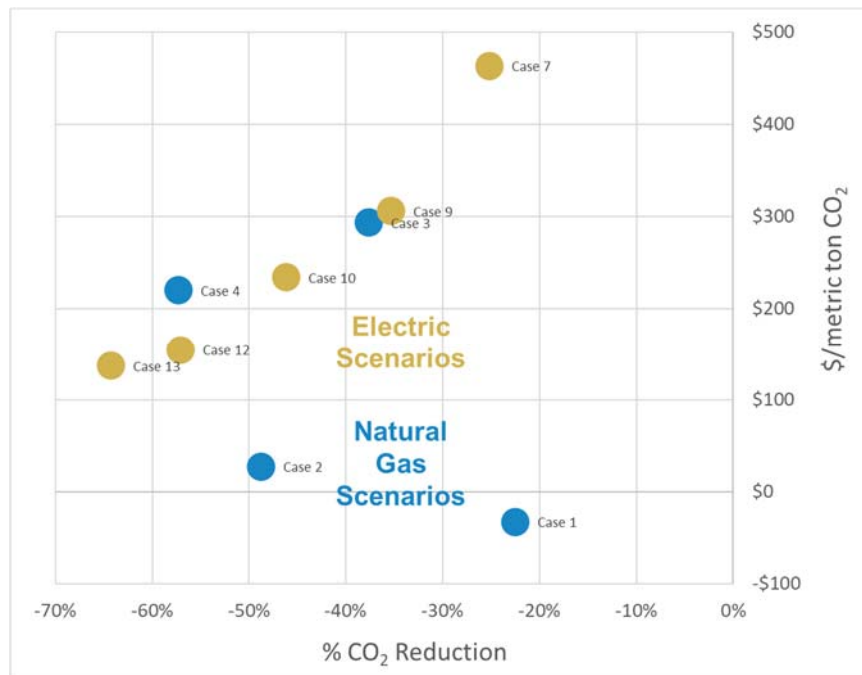

**Figure 33: Fayetteville, AR Residential GHG Reduction Scenarios**

While EPAT is a suitable screening tool, it does not dynamically match electric supply sources (and emissions) with year-round real-time demand. The next section discusses the specific case of space heating with dispatchable natural gas generation to meet peak winter demand and its implications. Absent clear alternatives, these data highlight that a sizeable portion of the electrification CO<sub>2</sub> reduction potential shown in Figure 33 could be illusory and not likely realized in practice without specific solutions such as natural gas combined-cycle plants running on renewable gas or using carbon capture – or other uncertain alternatives. This is particularly true with electric grids that rely on substantial solar PV – which drops off during the cold winter periods.


### ***Individual Single-Family Homes Cases***

This section includes analysis cases based on a typical 1,542 ft<sup>2</sup> single-family home in Fayetteville, AR. This provides a benchmark for understanding the impacts of electrification on a typical individual household.

### **Single-Family Home With Lifecycle Cost Analysis (LCA)**

This section highlights a representative single-family home that now uses available and efficient gas appliances and is required to move to all-electric equipment as highlighted in Case 9 (e.g., HSPF 9 electric heat pump). Case 14 results highlight the energy bill impacts for the gas and electric scenarios for space heating, water heating, cooking, and drying in this home. We also highlight an LCA analysis for net present costs for a homeowner from 2020 through 2050, building on data from the DOE-EIA 2020 Annual Energy Outlook. More details on this case can be found in the appendix.

Figure 34 shows results from this case, with annual energy costs for electric homes being 45.5% higher than a home that now uses natural gas for these four energy uses (i.e., space heating, water heating, cooking, and drying) along with facing higher lifecycle costs. Homeowners could see significant added costs not reflected in this analysis, including home electric service upgrade costs to handle this expanded suite of electric loads.

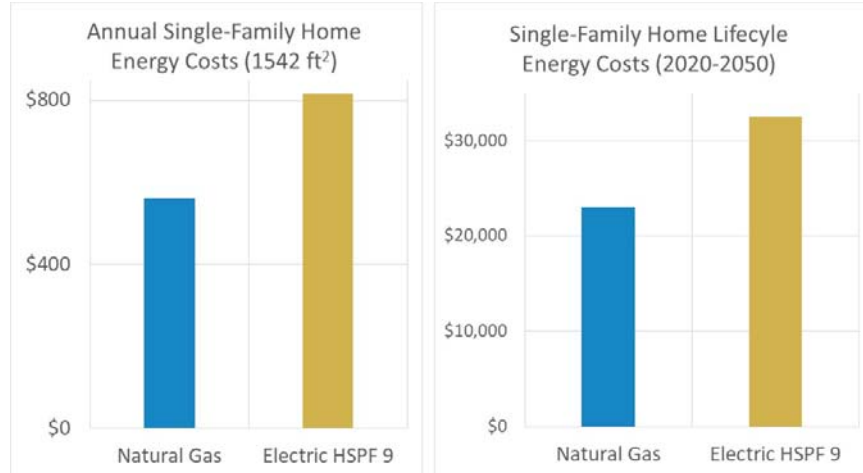

**Figure 34: Annual Energy Costs and Lifecycle Costs for Typical 1,542 ft² Single-Family Home in Fayetteville, AR**

### Special Space Heating Only Cases

This report highlights the significant real-world challenges with seasonal home space heating. In particular, prior graphs – for example, Figure 6 and Figure 27 – help illustrate the challenges. There is also a high likelihood that a significant portion of electric space heating will be met by dispatchable natural gas generators – rather than average or idealized future grid scenarios – in particular due to the winter decline in solar PV generation.


To illustrate the implications, Case 15 (HSPF 9.0 electric heat pump) and Case 16 (HSPF 13.0 electric heat pump) show the potential impact on GHG emissions of electric space heating equipment operating on 100% natural gas power generation mix (i.e., winter dispatchable generation). Table 10 compares these cases for a typical 1,542 ft² single-family home using a 98% efficient gas furnace. Under these assumptions, both electric heat pumps cases have lower CO<sub>2</sub> emissions but greater than anticipated in Figure 33.

**Table 10: Comparison of Gas and Electric Heating Using 100% Natural Gas Power Generation (Case 15, 16)**

Case	CO <sub>2</sub> Emissions kg/year
Natural Gas 98% Furnace	1,651
HSPF 9.0 Heat Pump (Case 15)	1,433
HSPF 13.0 Heat Pump (Case 16)	1,188

When considering the results in Table 10 with electric space heating operating with dispatchable natural gas power generation, the real-world electrification emission reductions will be less than anticipated and the costs higher. Figure 35 shows the results if 50% of electric space heating uses

natural gas generation and the balance the average grid mix (orange circles). The effect is to raise the relative GHG emissions for electrification and increase the carbon abatement cost.

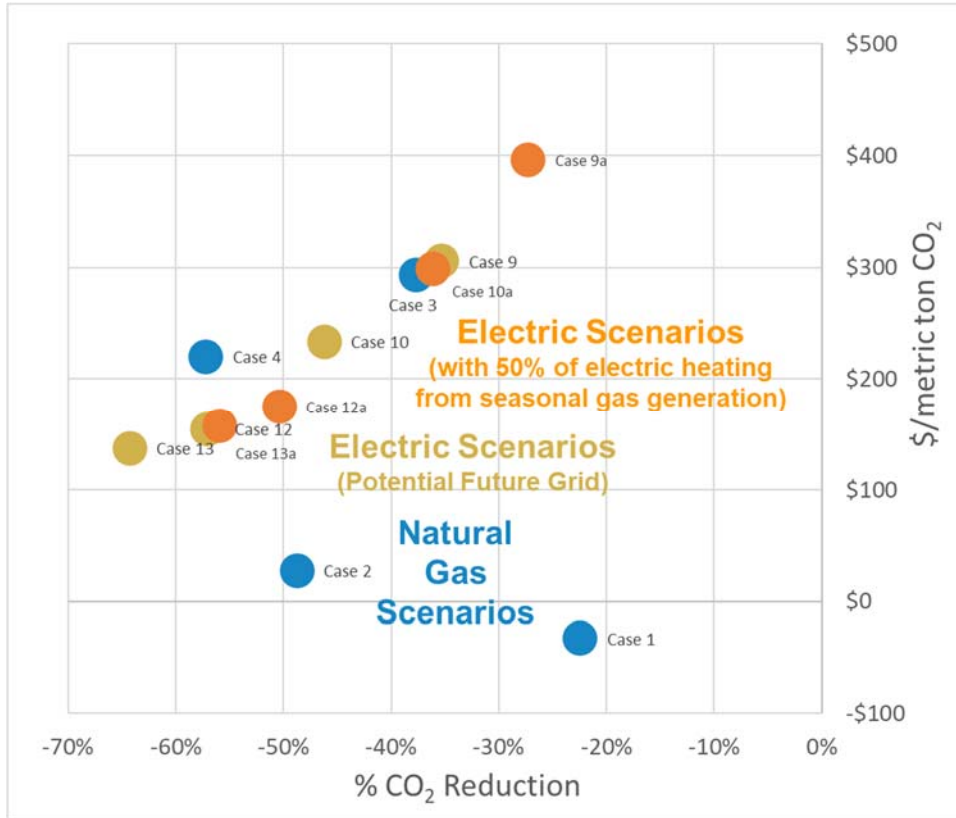

**Figure 35: Directional Impact of Winter Peak Electricity Use on CO<sub>2</sub> Reduction and Cost/Benefit Ratio**

**Table 11: Energy and Environmental Cost and Benefit Data**


Case	Description	Annual Energy Costs (\$MM/yr)	Annualized Capital Costs (\$MM/yr)	Total Annualized Costs (\$MM/yr)	Annual CO <sub>2</sub> Emissions (MMT/yr)	Annual CO <sub>2</sub> e Emissions (MMT/yr)	\$/Metric Ton CO <sub>2</sub> Reduced	% CO <sub>2</sub> Reduction
--	Baseline: Natural Gas Systems	\$12.15	\$6.61	\$18.76	0.059	0.067	--	--
1	Typical High-Efficiency Gas Equipment	\$9.62	\$8.70	\$18.32	0.046	0.052	-\$33	22.5%
2	Case 1 with 50% RNG	\$10.85	\$8.70	\$19.55	0.030	0.036	\$27	48.8%
3	Emerging High-Efficiency Gas Equipment	\$8.20	\$17.09	\$25.29	0.037	0.042	\$293	37.6%
4	Case 3 with 50% RNG	\$9.12	\$17.09	\$26.21	0.025	0.030	\$220	57.3%
5	Baseline All Electric Resistance Equipment / Current Power Generation	\$20.44	\$5.21	\$25.65	0.111	0.118	GHG Increase	GHG Increase
6	Case 5 with Scenario 1 Power Generation	\$20.44	\$5.21	\$25.65	0.053	0.058	\$1,162	10.0%
7	Case 5 with Scenario 2 Power Generation	\$20.44	\$5.21	\$25.65	0.044	0.048	\$463	25.2%
8	Typical High-Efficiency Electric Equipment/Current Power Generation	\$14.70	\$10.45	\$25.15	0.080	0.085	GHG Increase	GHG Increase
9	Case 8 with Scenario 1 Power Generation	\$14.70	\$10.45	\$25.15	0.038	0.042	\$306	35.3%
10	Case 8 with Scenario 2 Power Generation	\$14.70	\$10.45	\$25.15	0.032	0.035	\$234	46.2%
11	Emerging High-Efficiency Electric Equipment/Current Power Generation	\$9.76	\$14.21	\$23.97	0.053	0.056	\$875	10.1%
12	Case 11 with Scenario 1 Power Generation	\$9.76	\$14.21	\$23.97	0.025	0.028	\$154	57.0%
13	Case 11 with Scenario 2 Power Generation	\$9.76	\$14.21	\$23.97	0.021	0.023	\$137	64.3%

## Additional Home Electrification Considerations and Challenges

This section discusses additional challenges or issues with the expanded use of electricity as a natural gas replacement in Fayetteville, AR homes. These center around energy transmission, distribution, and storage systems as well as the growing consumer importance placed on home energy service reliability and resilience.


### Natural Gas and Electric Energy Delivery Systems

Figure 36 shows results of a prior GTI analysis of space heating electrification impact on peak winter demand in 17 different states. This data highlights the substantial scale-up and investment in electric transmission and delivery capacity required to support switching residential gas heating to electricity. Some electrification advocates point to distributed PV systems as an answer; however, decreased solar PV output during the winter largely negates their ability to offset this challenge.

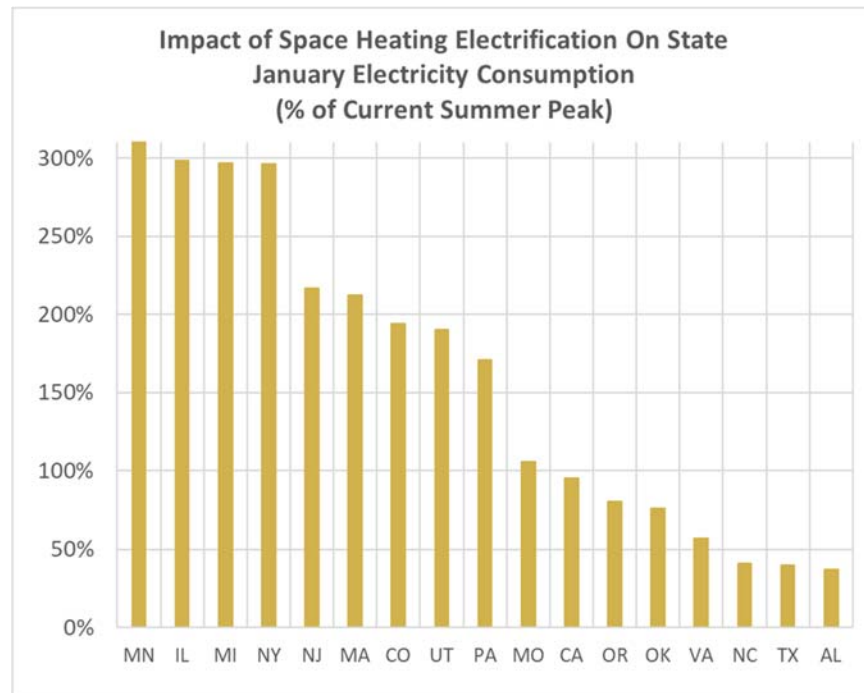

**Figure 36: Impact of Electrification on Peak Winter Demand (Source: GTI)**

The ability of gaseous energy delivery systems to successfully meet severe peak winter demand is due to the combination of the major energy-carrying capacity of gas pipelines and natural gas storage. Figure 37 and Table 12 illustrate the typical rated energy delivery capacity of an interstate natural gas pipeline relative to electric transmission lines. Gas transmission pipelines have 10-50 times the energy delivery capacity of electric transmission lines.

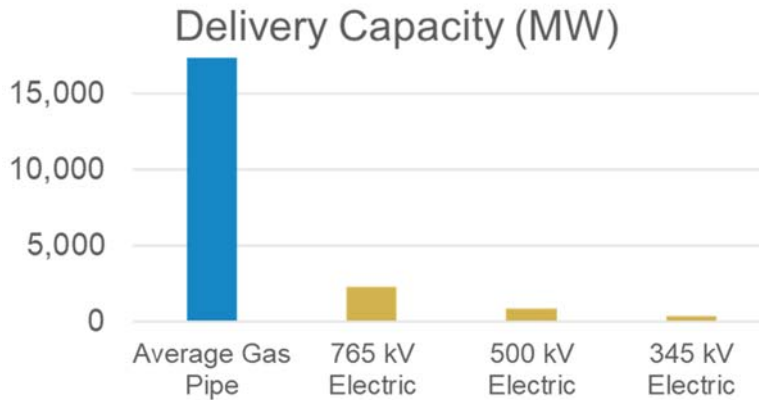

**Figure 37: Major Natural Gas and Electric Transmission System Capacity (DOE, AEP)**

**Table 12: Major Natural Gas and Electric Transmission System Capacity (DOE, AEP)**

350 US Gas Transmission Pipelines	Delivery Capacity, MW
Average Pipeline	17,386
90 <sup>th</sup> Percentile	~32,000
Electric Transmission Lines	Capacity, MW
765 kV	2,300
500 kV	900
345 kV	400

In addition to peak power generation challenges – and the lack of suitable dispatchable power generation other than natural gas combined cycle plants – substantial electric transmission and distribution system upgrades will likely be required to reliably meet high peak day/peak month electricity demand. This makes widespread full electrification of homes very problematic.

### **Natural Gas and Electric Energy Storage Systems**


Energy storage systems are used in natural gas and electric energy delivery systems to manage peak demand periods as well as for other services. Table 13 summarizes key metrics for three main US energy storage systems: underground natural gas storage, pumped hydro energy storage, and battery energy storage (BES); the latter two are used for electric energy storage.

Natural gas underground storage systems are much larger than electric storage systems based on delivery capacity (over 20X larger) and demonstrated peak monthly energy delivery (over 100X larger). Gas underground storage and pumped hydro can provide seasonal energy storage capability (e.g., helping with winter or summer space conditioning loads); however, battery energy systems lack this capability. In terms of cycle efficiency and energy losses, natural gas underground storage systems are substantially more efficient (97-99%) than both battery electric (70-90%) or pumped hydro (60-88%) energy storage systems.

**Table 13: Representative Gas and Electric Energy Storage Size and Performance Metrics (DOE-EIA, GTI)**


<b>Energy Storage System</b>	<b>Underground Gas Storage</b>	<b>Pumped Hydro</b>	<b>Battery Energy Storage</b>
Nominal Capacity (GW)  (Gas: Electric Ratio)	495 (20.6:1)	23	1
Peak Monthly Energy Delivered, GWh (G:E Ratio)	331,800 (112:1)	2900	52
Peak Month Capacity Factor	23%	17%	7%
Peak Month Storage % of Monthly Total Energy Use	36%	1%	0.1%
Cycle Efficiency (Losses) (%)	98.8% (1.2%)	69% (31%)	80% (20%)

Figure 38 shows the much larger energy delivery capacity that is possible with natural gas underground storage compared to pumped hydro or BES systems. Gas storage has evolved to satisfy the sizeable winter heating loads discussed earlier. Replicating this capacity with electric energy storage systems – particularly considering the high seasonality of space heating loads – would be extraordinarily expensive and may only be technically feasible with pumped hydro systems or using gas turbines backed up with gas storage (which would negate the potential GHG benefits of electric space heating). Battery energy storage lacks the ability to seasonally store energy.

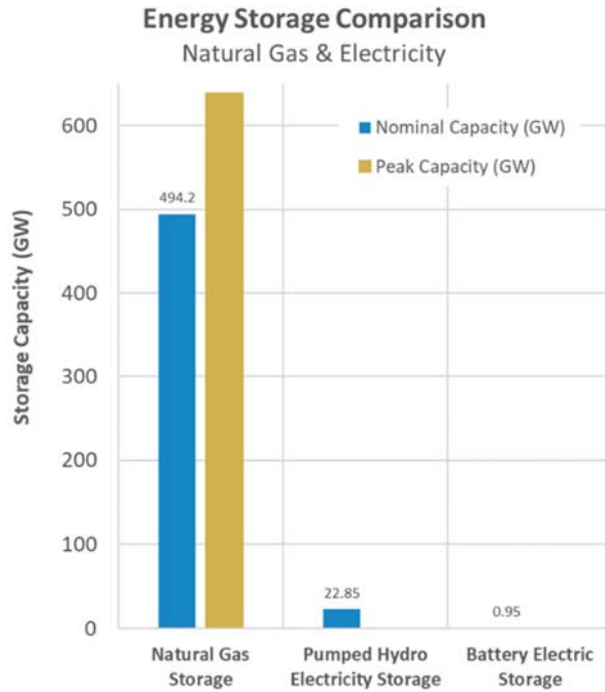

**Figure 38: Nominal Energy Storage Capacity (DOE-EIA)**

Figure 39 provides insights on annual energy storage system operations in the US. Large quantities of natural gas are efficiently drawn from storage as cold temperatures descend across the US. The amount of energy delivered is significantly larger than pumped hydro storage which, in turn, is currently about ten times larger than battery energy storage in the US.

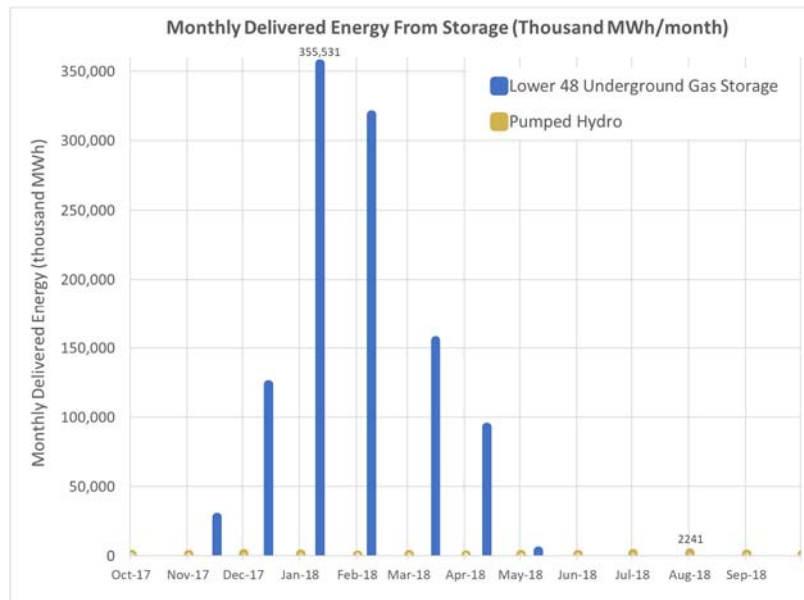


**Figure 39: Example Monthly Energy Delivery for Storage (DOE-EIA)**

Figure 40 shows the differences in energy storage cycle losses. Underground gas storage is very efficient, with only 1-3% round-trip cycle losses. In comparison, real-world DOE-EIA data show




battery energy storage systems have losses of 10-30% and pumped hydro cycle losses are typically slightly higher. Energy losses from electric storage systems raise electricity costs and necessitate even larger investments in generating capacity to compensate for storage losses.

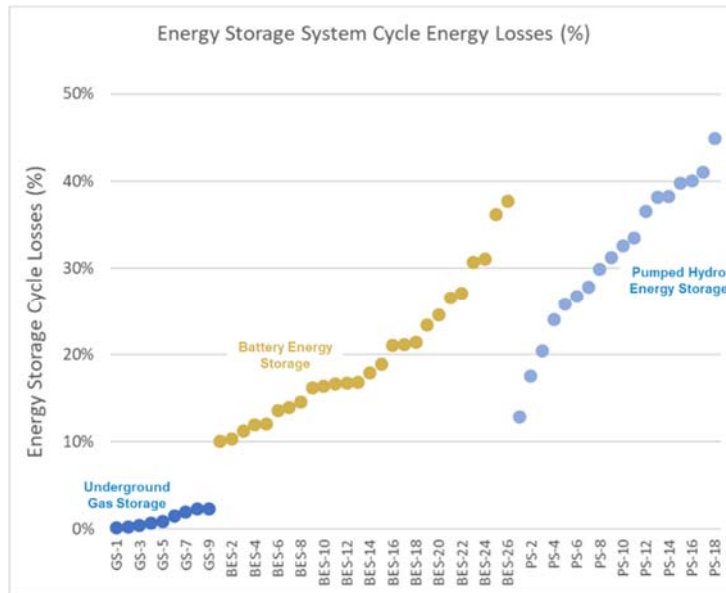

**Figure 40: Energy Storage Cycle Energy Losses (DOE-EIA, GTI)**


Battery energy storage lacks the seasonal storage capability needed for winter electric space heating. Figure 41 supports this, showing monthly capacity factors for these three forms of energy storage. Natural gas storage has demonstrated high seasonal storage capabilities as does pumped hydro to a lesser extent (supporting summer space cooling loads). Battery energy storage however has no demonstrated seasonal differences in capacity factor. In addition, battery energy storage has much lower capacity factors – which has cost-effectiveness implications.

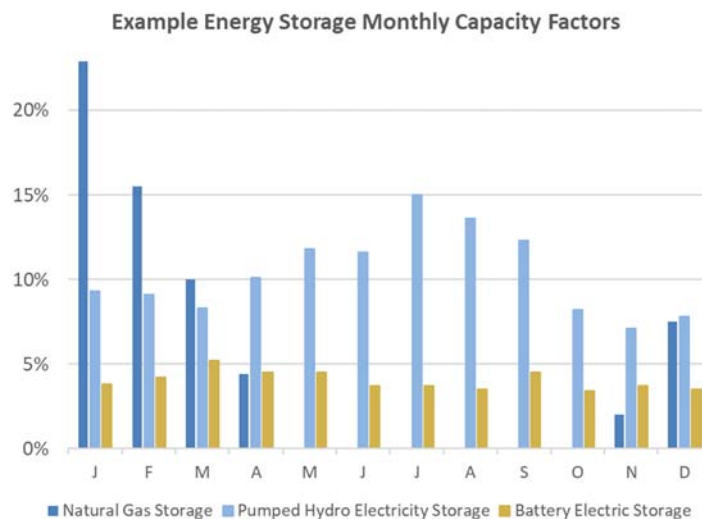

**Figure 41: Example Energy Storage System Capacity Factors (DOE-EIA)**

Figure 42 provides an additional technical basis for the challenges with electric energy storage in meeting long-duration winter space heating peak electricity demands. Only pumped hydro

systems come close to having the system scale and operating attributes (e.g., discharge time) that are congruent with space heating loads. While larger battery energy storage systems are being deployed, they remain relatively small compared to pumped hydro and completely lack the fundamental capability of extended duration (e.g., weeks, months) discharge times.

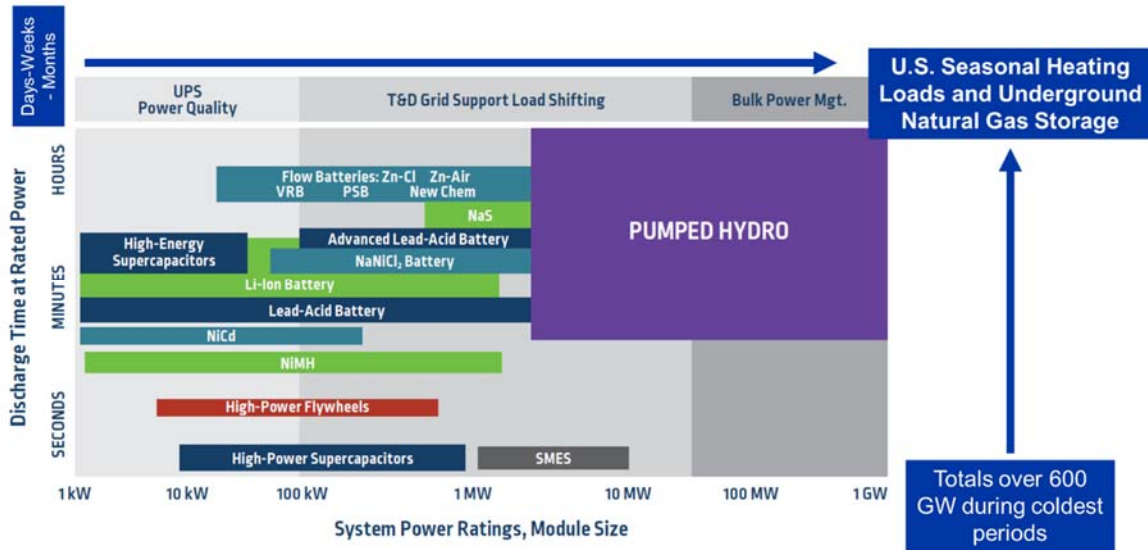


**Figure 42: Size and Duration of Energy Storage Systems**  
(adapted from National Hydropower Association report)

**Main Finding:** Electric energy storage options have higher cycle losses than natural gas systems and battery energy storage systems lack the seasonal capability needed to meet the prospective winter electric peaks stemming from large-scale residential electrification. Pumped hydro storage has some seasonal capabilities but at a much smaller scale than seen with natural gas storage and with higher cycle losses; however, pumped hydro is likely not topographically practical for Arkansas.


### Home Energy Supply Reliability and Resilience

Home energy system reliability and resilience have become increasingly important to residential homeowners, causing more consumers to install home emergency generators to ensure electricity is available at all times (Figure 43).

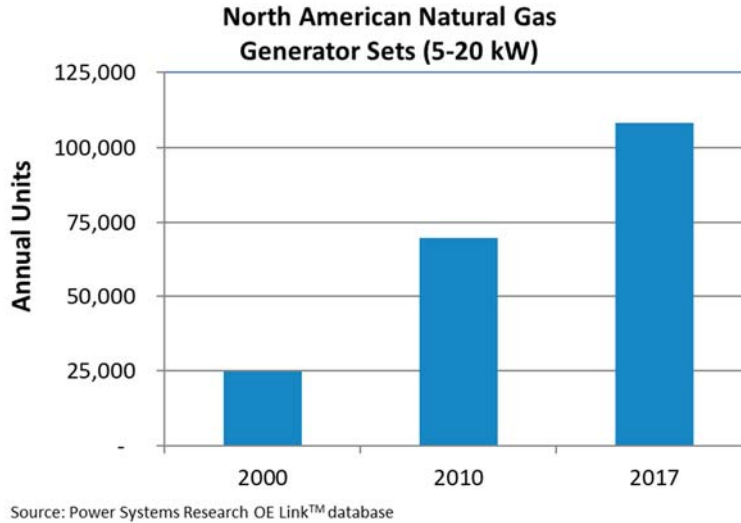

**Figure 43: Trends in North American Residential Natural Gas Generators Units**

Figure 44 highlights the main reasons consumers look to install equipment like natural gas home generators: (1) high electricity outage rates and (2) concomitant lower levels of reliability (when compared to natural gas distribution service). These data are comparable to the following IEEE 1366 Guide for Electric Power Distribution Reliability metrics: (1) System Average Interruption Frequency Index (SAIFI, left) and (2) Average Service Availability Index (ASAI, right).

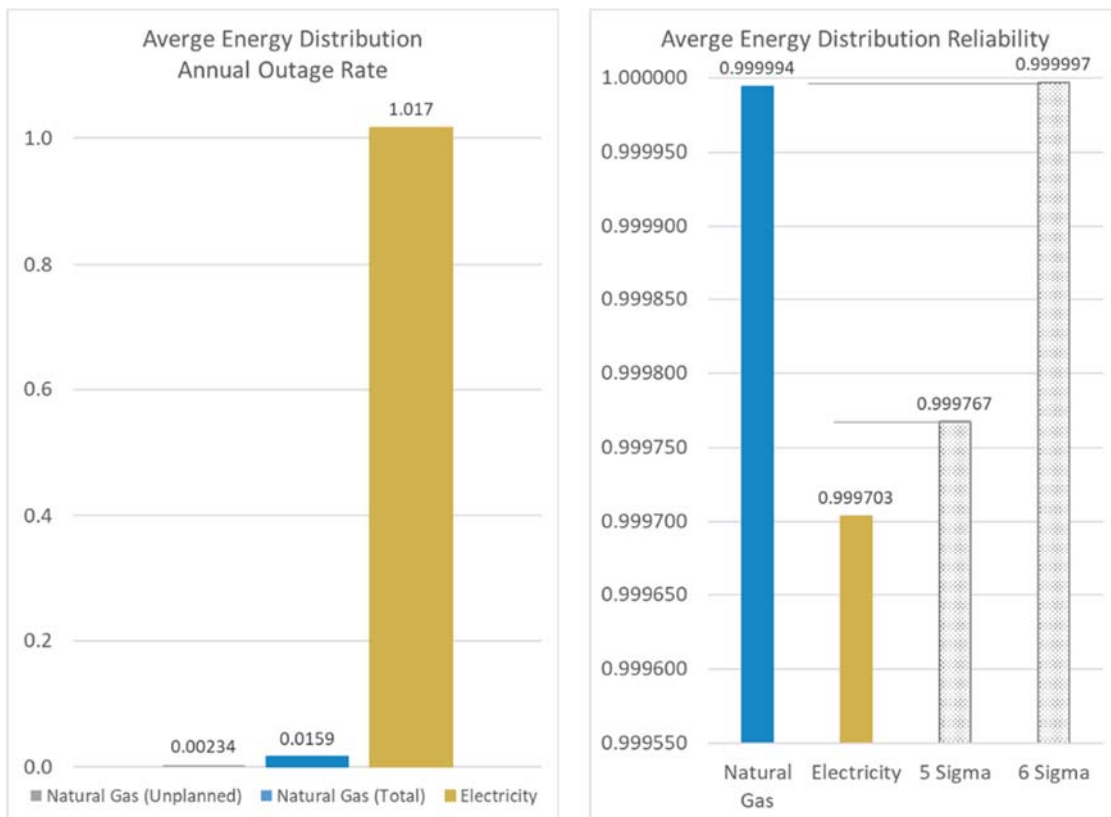

**Figure 44: Natural Gas and Electric Distribution Outage Rates and Service Reliability**

Installing a natural gas generator in homes and businesses provides energy security since natural gas distribution service is highly robust even during extreme weather events (e.g., tornados, flooding, etc). The extreme notion of removing natural gas service to homes and businesses not only substantially increases their annual energy bills, it also would remove a key solution consumers are using to ensure their home's energy supply reliability and resilience (Figure 45).



**Figure 45: Example Residential and Commercial/Industrial Natural Gas Generator Sets**

## **Fayetteville, AR Home GHG Reduction Recommendations**

---

The following is a strategic framework for achieving feasible and cost-effective GHG reductions in Fayetteville, AR natural gas homes over the next two decades, predicated on the perspective that:

- Natural gas is an important cost-effective, and abundant natural resource that provides tremendous value to consumers and the nation as a whole
- Two energy delivery systems – natural gas and electricity – can provide an optimized approach to energy delivery and reliability; each have corresponding GHG impacts which to varying degrees may include indirect or unforeseen impacts
- Home gas and electric equipment can be complementary – within a smart energy system – to allow energy consumers, energy utility operators, and other stakeholders the option to choose gas or electricity to optimize cost, energy system reliability, and GHG reductions
- Pipeline energy delivery systems are important to society as reliable and resilient energy sources capable of delivering large quantities of energy to homes and businesses – especially during cold weather
- Long-term renewable gas (e.g., methane or hydrogen) can support a move to lower GHG emissions while leveraging society’s cumulative investment in gaseous pipeline and energy storage assets
- GHG reductions are an important approach to reduce the potential threats of climate change. Selecting the most feasible and cost-effective approaches should be based on objective economic analyses and metrics such as \$/metric ton of GHG reduction
- More information and progress in energy and environmental innovation will evolve over the next two decades to help inform and guide GHG reduction policy dialogue and direction

Recommended steps and measures for Fayetteville, AR natural gas home GHG reductions:


1. A core focus on energy efficiency improvements
2. An emphasis on building envelope efficiency improvements that help consumers – particularly older homes – lower their annual energy costs, improve indoor comfort, reduce natural gas and electric energy consumption (including peak energy demand), and minimize GHG emissions
3. Incentives for high-efficiency natural gas equipment (e.g., 95-98% efficient gas furnaces and water heaters) in addition to support for RD&D and market transformation resources for next-generation natural gas heat pumps (130%+ efficiency) for space and water heating
4. Expanded use of renewable natural gas (RNG) and related pathways for producing and using low-carbon sources of methane or hydrogen (including power-to-gas) to lower the carbon intensity of gaseous energy
5. Expanded use of hybrid space conditioning systems integrating a natural gas furnace (or boiler) with an electric heat pump (i.e., an upgrade to a conventional air conditioning system) in combination with smart controls at the home and utility level to optimize cost, capacity, energy delivery system investment and asset utilization, and GHG reductions. This approach provides high optionality value and avoids a series of pernicious issues with operating electric heat pumps at colder temperatures (e.g., reduced efficiency, high electricity peak demand, high marginal peak power GHG emission rates for seasonal demand)

## Summary and Conclusions

There is an active dialogue on policy considerations pertaining to future pathways for reducing GHG emissions. This report focuses on energy use and future GHG reduction pathways for the Fayetteville, AR residential sector, with quantitative and qualitative information on consumer costs and environmental benefits. The study also presents information on real-world challenges as well as potential unintended or unanticipated consequences of residential electrification.

The following is a summary of key findings, conclusions, and recommendations:


- **The ratio of residential electricity and natural gas prices has grown over the past 15 years.** In 2019, Arkansas homeowner electricity prices were over 2.6 times higher than natural gas on an energy-equivalent basis.
- Consumer surveys across the US provide evidence that most homeowners prefer natural gas over electricity, particularly for space heating, water heating, and cooking.
- **Residential electrification results in increases in annual energy bills for Fayetteville, AR homeowners.** Mid-case electric heat pump (HSPF 9) results in a \$2.55 million annual increase in energy bills for all homes now using natural gas in Fayetteville, AR.
- Figure 46 shows annual energy costs and lifecycle net present cost comparisons (2020-2050) for a typical 1,542 ft<sup>2</sup> home in Fayetteville, AR between efficient gas and electric equipment. With electrification, energy bills would go up over 45% for a typical single-family home.

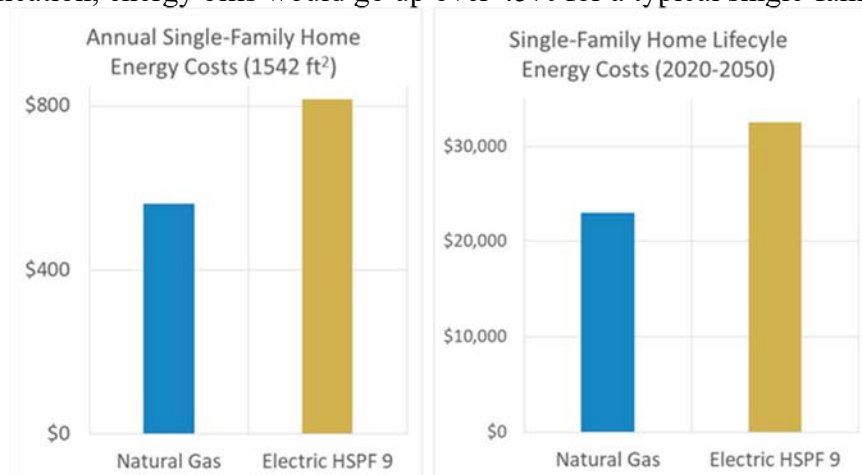

**Figure 46: Annual Energy Costs and Lifecycle Costs for Typical 1,800 ft<sup>2</sup> Single-Family Home in Fayetteville, AR**

- **Existing all-electric homes in Arkansas using the current average power generation mix in the state result in higher CO<sub>2</sub> emission rates** in most instances compared to a baseline home with gas appliances.
- **Natural gas pathways for GHG reductions using high-efficiency furnaces and water heaters have lower consumer and societal costs when measured in \$/metric ton of CO<sub>2</sub> reduced** (Figure 47). Using currently available high-efficiency gas equipment results in very cost-effective GHG reductions (-\$33/metric ton of CO<sub>2</sub>) and \$27/metric ton when using 50% renewable natural gas blends with existing high-efficiency equipment. Next-generation natural gas heat pumps offer potential for greater GHG reductions at higher costs (\$220 to \$293/metric ton of CO<sub>2</sub>). Residential electrification with typical electric heat pumps (HSPF 9) and potential future power generation improvements have CO<sub>2</sub> abatement costs of \$234 to

\$306/metric ton. More expensive higher-efficiency electric heat pumps reduce the carbon abatement costs to \$137 to \$154/metric tons based on this analysis; however costs are likely to be 15 to 30% higher or more depending on the winter season use of natural gas power generation for space heating loads.

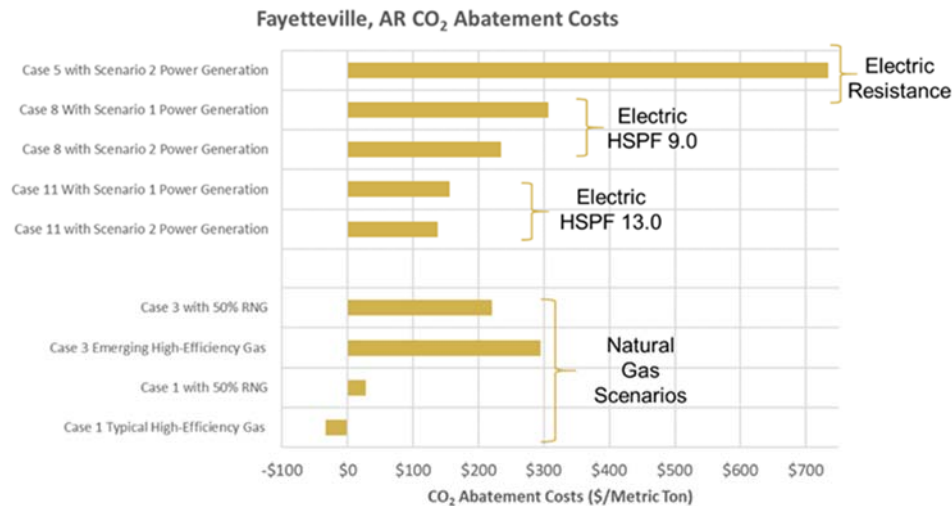

**Figure 47: Comparison of CO<sub>2</sub> Abatement Costs (\$/metric ton)**

- A three-step process is outlined for Arkansas power generation evolution over the next 10-20 years (from 2030 to 2040): (1) replacement of coal generation, (2) additional capacity for expanded baseload generation under an electrification scenario, and (3) strategies to address seasonal winter electricity demand. Step 3 is the most challenging market development need and worthy of more concentrated RD&D to find solutions.
- **A significant issue with residential electrification scenarios is the intense seasonal energy demand for space heating during the coldest days.** The challenges with cold-weather space heating are often oversimplified, underestimated, or not properly conveyed in public policy electrification discussions. The potential power generation and electric infrastructure cost and reliability implications for consumers and society are significant.
- **There is no evidence solar or wind resources can address prospective seasonal energy-intensive space heating electricity peaks during Arkansas winters.** Solar PV systems, which are projected to be a key new generation resource, have a significant drop in winter output.
- Using the matching principle and reasonable options at this time, **most new winter peak electricity demand that arises from electric space heating will be met with dispatchable natural gas generation.** Without GHG mitigation for this scenario, potential GHG reductions from electric space heating will be less than anticipated.
- There is no evidence battery energy storage can play a value-added role in meeting high winter electricity demands and pumped hydro is not a practicable option for Arkansas.
- Using hybrid space heating systems whereby electric heat pumps operate at milder temperatures and natural gas heating systems operate at cold temperatures avoids a host of issues associated with cold climate electric heat pump operation.
- Natural gas distribution systems have quantifiably higher service reliability and lower outage rates than electric distribution systems, leading more homes to install natural gas generators to avoid the cost and issues associated with grid power interruptions.

The following is a suggested set of energy efficiency and GHG reduction measures for Fayetteville, AR natural gas homes:

1. A core focus on energy efficiency improvements
2. An emphasis on building envelope efficiency improvements that help consumers – particularly older homes – lower their annual energy costs, improve indoor comfort, reduce natural gas and electric energy consumption (including peak energy demand), and minimize GHG emissions
3. Incentives for high-efficiency natural gas equipment (e.g., 95-98% efficient gas furnaces and water heaters) in addition to support for RD&D and market transformation resources for next-generation natural gas heat pumps (130%+ efficiency) for space and water heating
4. Support the expanded use of renewable natural gas (RNG) and related pathways for producing and using low-carbon sources of methane or hydrogen (including power-to-gas) to lower the carbon intensity of gaseous energy
5. Expanded use of hybrid space conditioning systems integrating a natural gas furnace (or boiler) with and electric heat pump (i.e., an upgrade to a conventional air conditioning system) working in combination with smart controls at the home and utility level to optimize cost, capacity, energy delivery system investment and asset utilization, and GHG reductions. This approach provides high optionality value and avoids a series of pernicious issues with operating electric heat pumps at colder temperatures (e.g., reduced efficiency, high electricity peak demand, high marginal peak power GHG emission rates for seasonal demand)



## **Analytical Research Team and Contributors**

---

Gas Technology Institute (GTI) is an independent, non-profit research & development organization with an 80-year history focused on developing new energy and environmental technologies and providing education and training services for the energy industry and its customers. The following biographies include GTI personnel that contributed directly and indirectly to this report and the underlying tools, data, and analysis used in compiling this publication. This includes a team of engineers, data analysts, and programmers which developed and refined GTI's publicly accessible Energy Planning and Analysis Tool (EPAT) over multiple years. These personnel are part of GTI's 40-person Building Energy Efficiency Group that is developing and validating a range of technologies and building envelope solutions aimed at reducing the energy and environmental impact of energy use in buildings.

### **William Liss, Vice President – GTI**

Mr. Liss has an over 34-year career at GTI spanning a wide-spectrum of challenges related to end-use markets (residential, commercial, industrial, onsite power, and transportation) and natural gas pipeline issues. He leads a broad-based group of over 100 energy professionals – engineers, scientists, data analysts, and technicians – focused on technology development and market adoption of new energy solutions that address important energy and environmental challenges. His career began with development of detailed benefit/cost analytical studies to support annual research & development plan submissions to the Federal Energy Regulatory Commission. He received a B.S. in Chemical Engineering from the University of Illinois at Chicago and an MBA from Keller Graduate School of Management.

### **Patricia Rowley, R&D Manager – GTI**

Ms. Rowley is an R&D Manager with the building energy efficiency group at GTI with over 25 years of hands-on and management experience in analytical, laboratory, and field work. Ms. Rowley's research and development experience includes expertise on technologies for commercial buildings, transportation, and distributed energy resources. Her most current work is focused on demonstration and validation of emerging technologies to improve energy efficiency, reduce costs, or enhance energy resilience for commercial facilities. Ms. Rowley has extensive experience in field demonstrations and laboratory evaluations with expertise in instrumentation, test design, and data acquisition. Ms. Rowley has developed technical and market analyses of technologies for commercial buildings and industrial applications based on analytical models and experimental data with a focus on technologies for space conditioning, water heating, and distributed power generation. She has developed modeling and spreadsheet tools to conduct technical and market assessment of natural gas and electric technologies based on full-fuel-cycle energy use, greenhouse gas emissions and life cycle costs for all sectors of the U.S. market. Ms. Rowley received a B.S. in Mechanical Engineering from Purdue University and an M.S. in Mechanical Engineering from the University of Illinois-Chicago.

### **Neil Leslie, P.E., Senior Institute Engineer – GTI**

Mr. Leslie is the program manager and principal investigator for GTI's Carbon Management Information Center (CMIC), which provides clearinghouse information and analyses, energy and environmental analysis tools (<http://seeatcalc.gastechnology.org/> and [epat.gastechnology.org](http://epat.gastechnology.org)), and technical input to voluntary standards and regulatory initiatives developed and promulgated by other stakeholders. Mr. Leslie previously managed the residential and commercial program

area at GTI that includes building energy efficiency analysis, carbon management, space conditioning, water heating, commercial food service, indoor environmental quality, combined heat and power systems, and emerging technology programs in support of industry energy efficiency programs. He has over 40 years of experience in the global energy, consulting, and manufacturing industries. In addition to his management experience, he has published technical reports, peer-reviewed papers, articles, and a book on source energy and greenhouse gas emissions measurement methods and societal benefits of direct use of natural gas and propane in buildings. He has a B.S. in Mechanical Engineering from Northwestern University and an MBA from the University of Chicago. He is a registered professional engineer in the State of Illinois and an ASHRAE life member.

### **Erin Bonetti, Principal Engineer – GTI**

Ms. Bonetti is a Principal Engineer at GTI and focuses mainly on residential energy modeling, studying methane emissions in the commercial and residential sectors, understanding the changing energy landscape and its impact on emissions, and evaluation of emerging natural gas technologies. Prior to joining GTI, she supported technology investigations as part of Chevron's Energy Technology Company. Erin Bonetti is a licensed professional chemical engineer and received her B.S. degree at the University of California, Davis.

### **Jennifer Yang, Principal Engineer – GTI**

Jennifer Yang is a principal engineer with the Energy Delivery & Utilization Group at Gas Technology Institute (GTI). She has focused on design and development of web tools for energy analysis: Source Energy and Emission Analysis Tool (SEATT), Energy Planning Analysis Tool (EPAT), Commercial Food Service Equipment Calculator, Total Cost of Ownership (TCO) Calculator for Natural Gas Standby Power Generation, and Pipe Insulation Energy Savings Calculator. She has been also programming on data acquisition and process controls for the research projects, and developing and maintenance of engineering analysis software. She has a M.S. degree in Chemical Engineering from Lamar University, TX, a M.S. degree in Environmental Engineering from Tsinghua University, China, and a B.S. degree in Environmental Engineering from Tsinghua University, China.

### **Alejandro Baez Guada, Principal Engineer – GTI**

Alejandro Baez Guada is a principal engineer with the building energy efficiency group at GTI with over eight years of hands-on and modeling experience in analytical, laboratory and field work. Mr. Guada's research and development work has been focused on HVAC, water heating, micro-CHP and micro-grid equipment development and integration for space heating/cooling, water heating and on-site power management in the residential and light commercial sectors. Mr. Guada received a B.S. in Mechanical Engineering from Texas A&M University-Kingsville and a M.S. in Aerospace and Mechanical Engineering from the Illinois Institute of Technology.

## References

---

- American Biogas Council, “Biogas State Profile: Arkansas,”  
<https://americanbiogascouncil.org/wp-content/uploads/2020/06/ABC-2020-State-Profiles-4.pdf>
- American Electric Power, “Transmission Facts,”  
[http://web.ecs.baylor.edu/faculty/grady/\\_13\\_EE392J\\_2\\_Spring11\\_AEP\\_Transmission\\_Facts.pdf](http://web.ecs.baylor.edu/faculty/grady/_13_EE392J_2_Spring11_AEP_Transmission_Facts.pdf)
- American Gas Foundation/ICF, “Renewable Sources of Natural Gas: Supply and Emissions Reduction Assessment,” Dec. 2019,  
<https://gasfoundation.org/wp-content/uploads/2019/12/AGF-2019-RNG-Study-Full-Report-FINAL-12-18-19.pdf>
- Cadmus Group, “Ductless Mini-Split Heat Pump Impact Evaluation, Dec. 2016,  
<http://www.ripuc.ri.gov/eventsactions/docket/4755-TRM-DMSHP%20Evaluation%20Report%2012-30-2016.pdf>
- Department of Energy, Energy Information Administration (DOE-EIA). Residential Energy Consumption Survey, 2015 edition.
- DOE-EIA, “Annual Energy Outlook 2020,” <https://www.eia.gov/outlooks/aeo/>
- DOE-EIA, Electricity Data,  
<https://www.eia.gov/electricity/data.php>  
<https://www.eia.gov/electricity/data/eia860/>
- DOE-EIA, Natural Gas Data, <https://www.eia.gov/naturalgas/data.php>
- DOE-EIA, Updated Buildings Sector Appliance and Equipment Costs and Efficiency,  
<https://www.eia.gov/analysis/studies/buildings/equipcosts/>
- DOE, Supplemental Notice of Proposed Rulemaking (SNOPR) 2016. “Technical Support Document: Residential Furnaces,” prepared for DOE by Navigant Consulting, Inc. and Lawrence Berkeley National Laboratory.
- Energy Solutions Center, “Woodland, O’Brien & Scott: New Homeowner Energy Preference Survey,” 2016.
- Gas Technology Institute (GTI), Brio, “The Gas Heat Pump Technology and Market Roadmap,” October, 2019.
- GTI, “Assessment of Natural Gas and Electric Distribution Service Reliability,” July 2018.  
<https://www.gti.energy/wp-content/uploads/2018/11/Assessment-of-Natural-Gas-Electric-Distribution-Service-Reliability-TopicalReport-Jul2018.pdf>
- GTI, “Comparison of Natural Gas and Electricity Energy Storage Systems,” draft unpublished report available upon request.
- GTI, Energy Planning Analysis Tool, <http://epat.gastechnology.org/>
- GTI, “Right-Sizing Electric Heat Pump and Auxiliary Heating for Residential Heating Systems Based on Actual Performance Associated with Climate Zone,” ASHRAE 2020 Winter Conference.

IEEE Standard 1316 – 2012 – IEEE Guide for Electric Power Distribution Reliability Indices,  
<https://standards.ieee.org/findstds/standard/1366-2012.html>

National Hydropower Association, “2018 Pumped Hydro Storage Report,”  
<https://www.hydro.org/wp-content/uploads/2018/04/2018-NHA-Pumped-Storage-Report.pdf>

National Renewable Energy Laboratory (NREL), National Residential Efficiency Measures Database, <https://remdb.nrel.gov/>

NREL, “California Power-to-Gas and Power-to-Hydrogen Near-Term Business Case Evaluation,” Dec. 2016, <https://www.nrel.gov/docs/fy17osti/67384.pdf>

Power Systems Research, OE Link™ Database,  
<https://www.powersys.com/products-services/powertrain-databases/oe-link>

United States Census Bureau, American Housing Survey,  
<https://www.census.gov/programs-surveys/ahs.html>

## **Appendix A: Energy Planning Analysis Tool (EPAT) Detailed Results**

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>Natural Gas, AFUE 98%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,845 (10 <sup>3</sup> Therm) Installed Cost: 2,807 \$/Unit +3.86 \$/kBtuh Unit Capacity: 50 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 10,117 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Natural Gas EF 0.95 - Condensing Tankless</b> Electric Consumption: 828 (10 <sup>3</sup> kWh) Gas Consumption: 2,331 (10 <sup>3</sup> Therm) Installed Cost: 2,515 \$/Unit Unit Capacity: 199 kBtu/h

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> therm) Installed Cost: 823 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Gas Standard EF 3.84</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 457 (10 <sup>3</sup> Therm) Installed Cost: 1,100 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	86.86	1,095	91,865 +78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,125.85</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	12,913 (10 <sup>3</sup> kWh)	44.06	100.45	1,267	136,822 + 78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	7,203 (10 <sup>3</sup> Therm)	785.13	785.13	8,355	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>764.36</b>	<b>885.58</b>	<b>9,622</b>	



	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	2,530	44,957	17.8

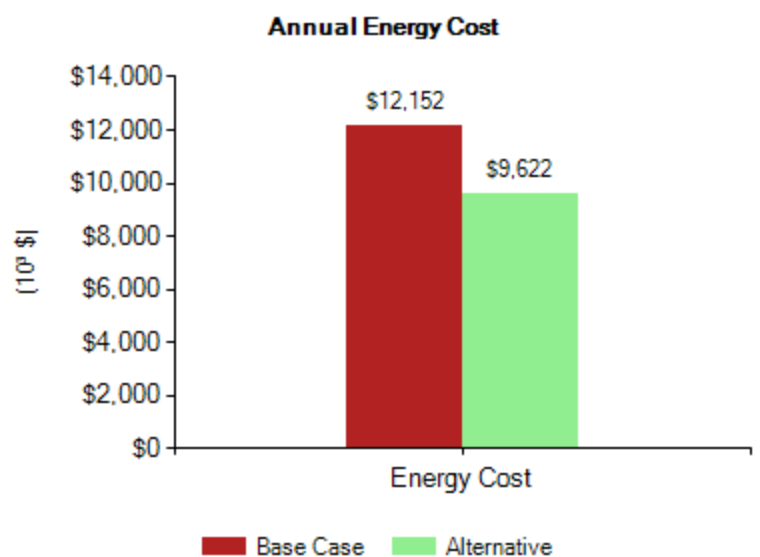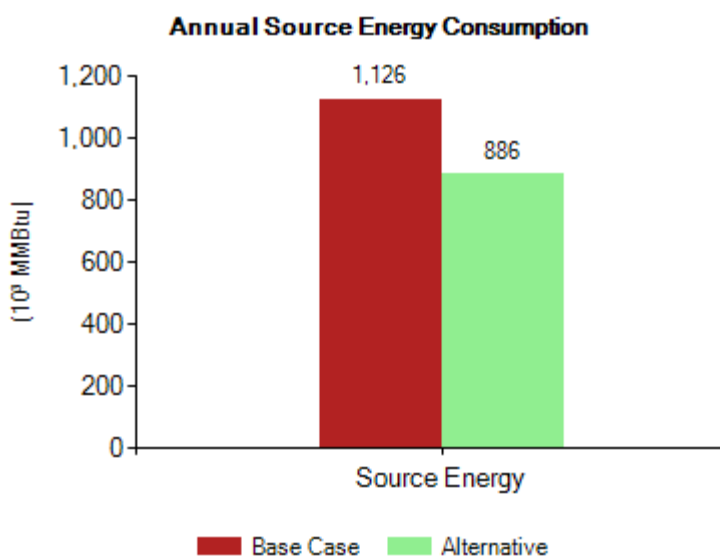



## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	29.21	167.75	130.39	595.93	2.87	147.71
Alternative	22.70	128.28	101.05	458.03	2.17	114.36

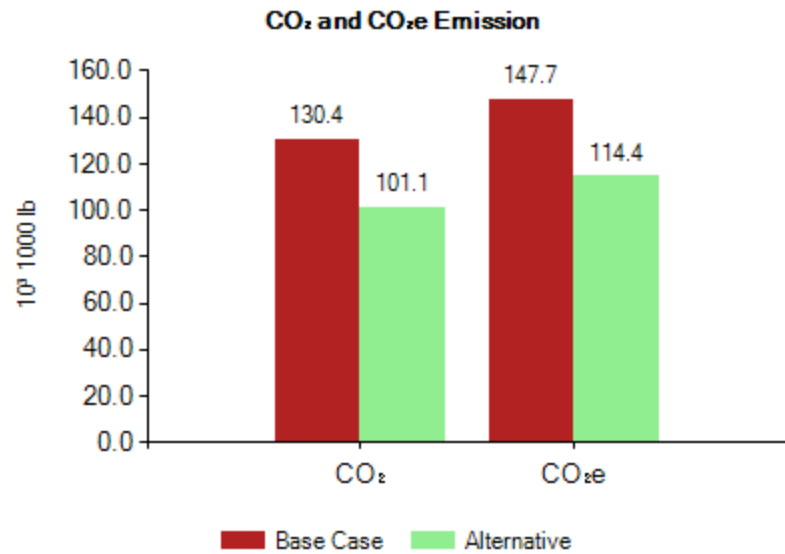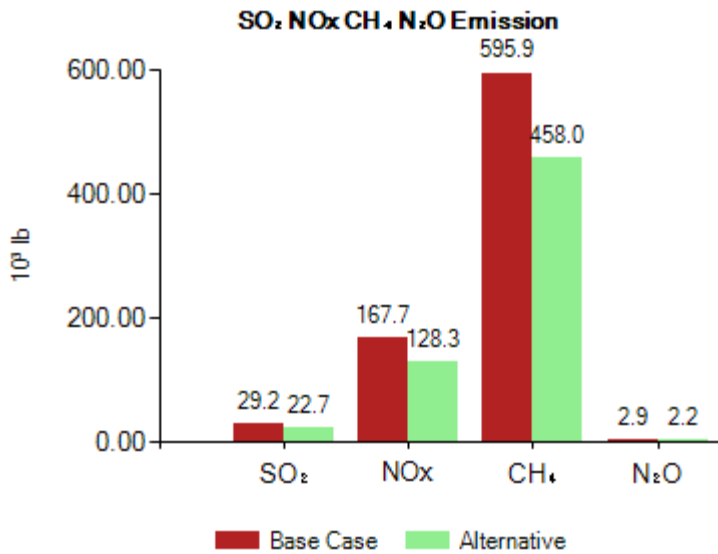

Energy Planning Analysis Tool



Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: User-Specified prices

Select Building Configurations

All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>Natural Gas, AFUE 98%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,845 (10 <sup>3</sup> Therm) Installed Cost: 2,807 \$/Unit +3.86 \$/kBtuh Unit Capacity: 50 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 10,117 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Natural Gas EF 0.95 - Condensing Tankless</b> Electric Consumption: 828 (10 <sup>3</sup> kWh) Gas Consumption: 2,331 (10 <sup>3</sup> Therm) Installed Cost: 2,515 \$/Unit Unit Capacity: 199 kBtu/h

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> therm) Installed Cost: 823 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Gas Standard EF 3.84</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 457 (10 <sup>3</sup> Therm) Installed Cost: 1,100 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	86.86	1,095	91,865 +78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	4,766 (10 <sup>3</sup> Therm)	476.60	519.49	5,529	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,216.41</b>	<b>13,773</b>	
Alternative	Electric (Building Used)	12,913 (10 <sup>3</sup> kWh)	44.06	100.45	1,267	136,822 +78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	3,602 (10 <sup>3</sup> Therm)	392.56	392.56	4,178	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>764.36</b>	<b>954.01</b>	<b>10,847</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	2,926	44,957	15.4

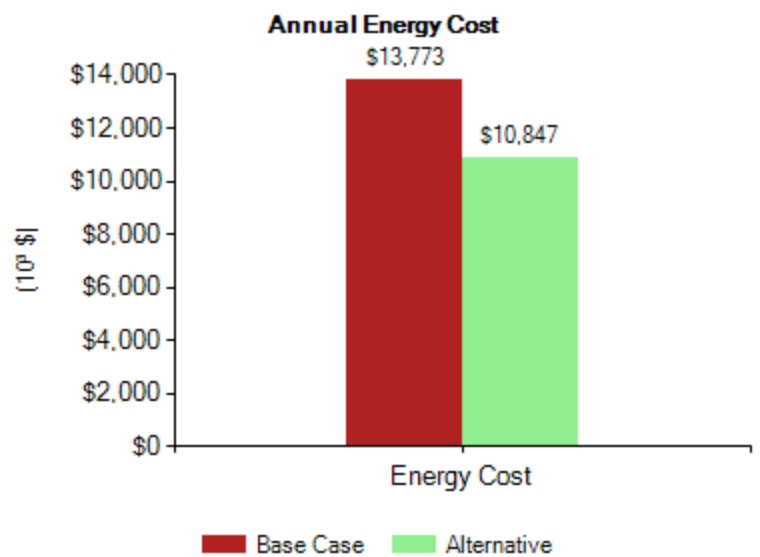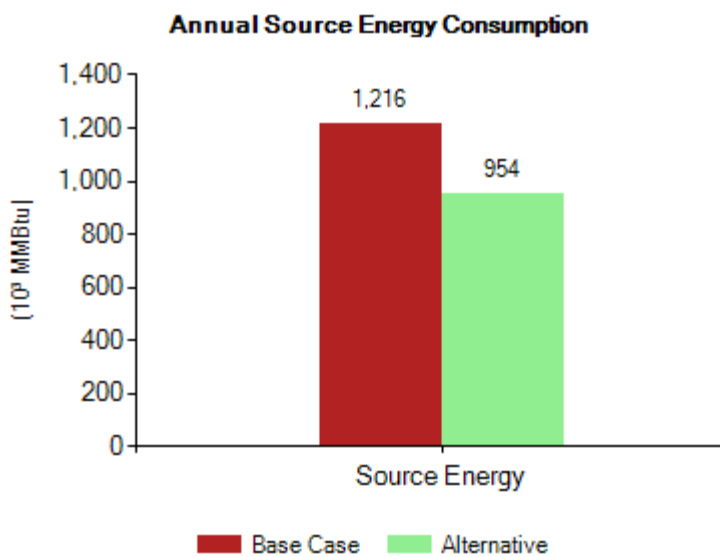

## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	55.42	219.70	85.07	551.12	2.87	101.24
Alternative	42.50	167.54	66.80	424.18	2.17	79.24

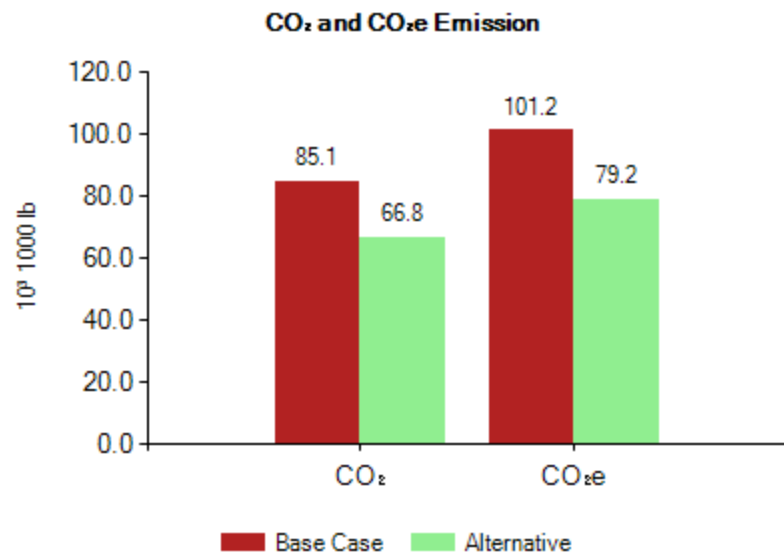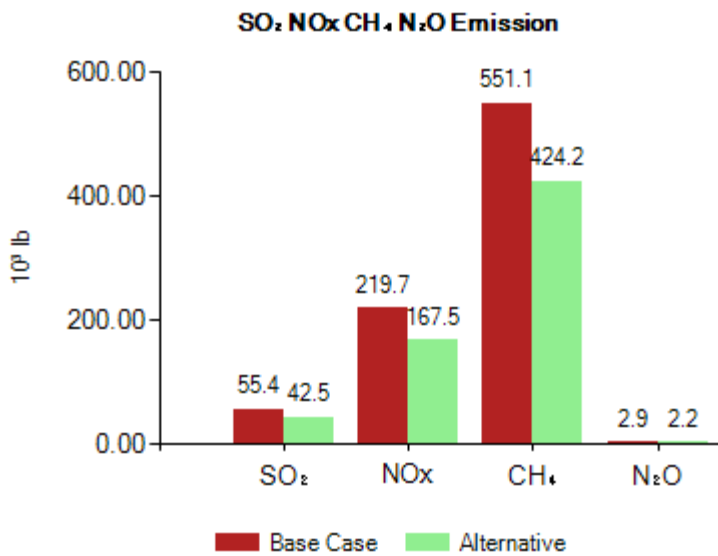

Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

Select Building Configurations

All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>1.4 AFUE Natural Gas Absorption Heat Pump (Prototype)</b> Electric Consumption: 1,987 (10 <sup>3</sup> kWh) Gas Consumption: 2,502 (10 <sup>3</sup> Therm) Installed Cost: 5,000 \$/Unit +2,500 \$/Unit Unit Capacity: 80 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal	<b>Natural Gas EF 1.30 - Absorption Heat Pump</b> Electric Consumption: 6,788 (10 <sup>3</sup> kWh) Gas Consumption: 1,853 (10 <sup>3</sup> Therm) Installed Cost: 2,250 \$/Unit

		Unit Capacity: 40 Gal	Unit Capacity: 60 Gal
	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> therm) Installed Cost: 823 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Gas Standard EF 3.84</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 457 (10 <sup>3</sup> Therm) Installed Cost: 1,100 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	86.86	1,095	91,865 +78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,125.85</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	19,941 (10 <sup>3</sup> kWh)	68.04	155.13	1,956	214,725 +78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	5,382 (10 <sup>3</sup> Therm)	586.64	586.64	6,243	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>606.24</b>	<b>741.77</b>	<b>8,199</b>	



	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	3,953	122,860	31.1

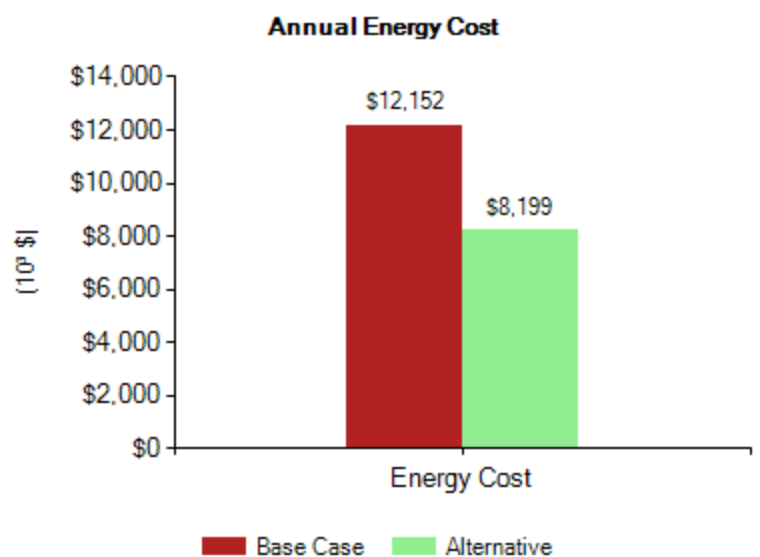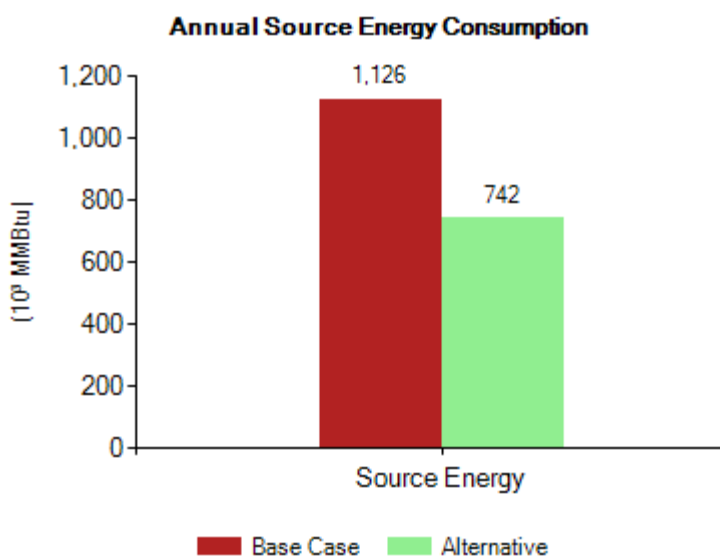



## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	29.21	167.75	130.39	595.93	2.87	147.71
Alternative	18.40	99.35	81.30	359.97	1.63	91.74

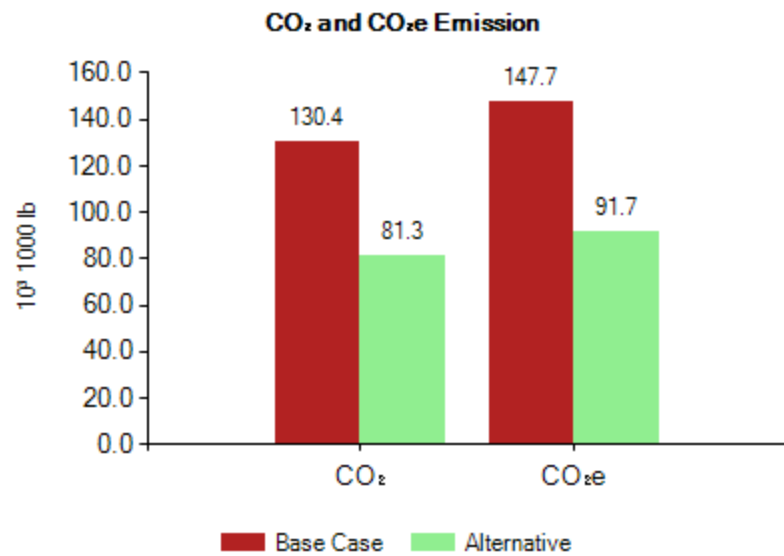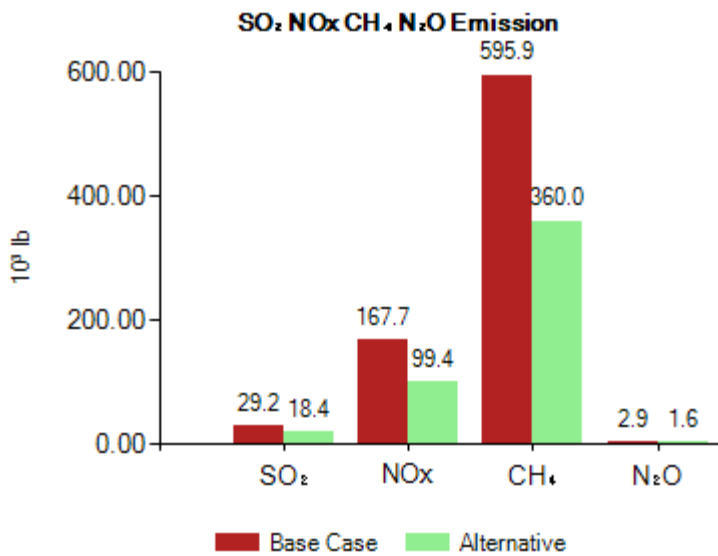

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: User-Specified prices

## Select Building Configurations

### All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>1.4 AFUE Natural Gas Absorption Heat Pump (Prototype)</b> Electric Consumption: 1,987 (10 <sup>3</sup> kWh) Gas Consumption: 2,502 (10 <sup>3</sup> Therm) Installed Cost: 5,000 \$/Unit +2,500 \$/Unit Unit Capacity: 80 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal	<b>Natural Gas EF 1.30 - Absorption Heat Pump</b> Electric Consumption: 6,788 (10 <sup>3</sup> kWh) Gas Consumption: 1,853 (10 <sup>3</sup> Therm) Installed Cost: 2,250 \$/Unit

		Unit Capacity: 40 Gal	Unit Capacity: 60 Gal
	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> therm) Installed Cost: 823 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Gas Standard EF 3.84</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 457 (10 <sup>3</sup> Therm) Installed Cost: 1,100 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	86.86	1,095	91,865 +78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	4,766 (10 <sup>3</sup> Therm)	476.60	519.49	5,529	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,216.41</b>	<b>13,773</b>	
Alternative	Electric (Building Used)	19,941 (10 <sup>3</sup> kWh)	68.04	155.13	1,956	214,725 +78,500 for cooling
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	2,691 (10 <sup>3</sup> Therm)	293.32	293.32	3,122	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>606.24</b>	<b>792.90</b>	<b>9,115</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	4,658	122,860	26.4

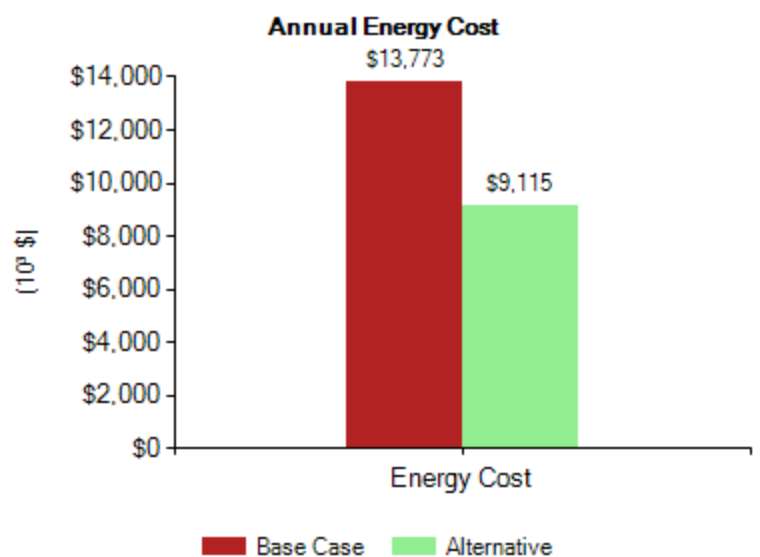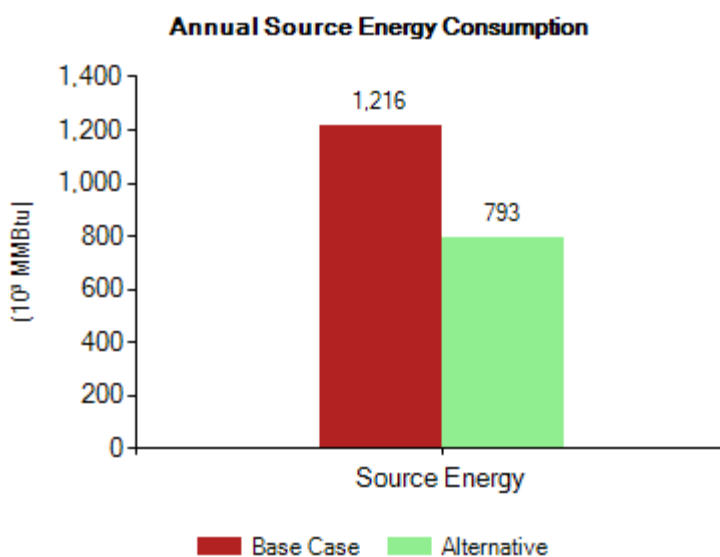

## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	55.42	219.70	85.07	551.12	2.87	101.24
Alternative	33.20	128.68	55.71	334.67	1.63	65.50

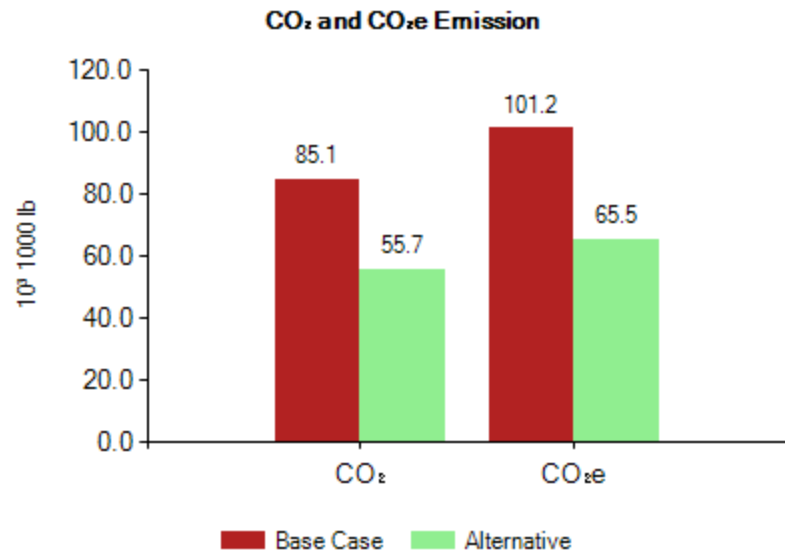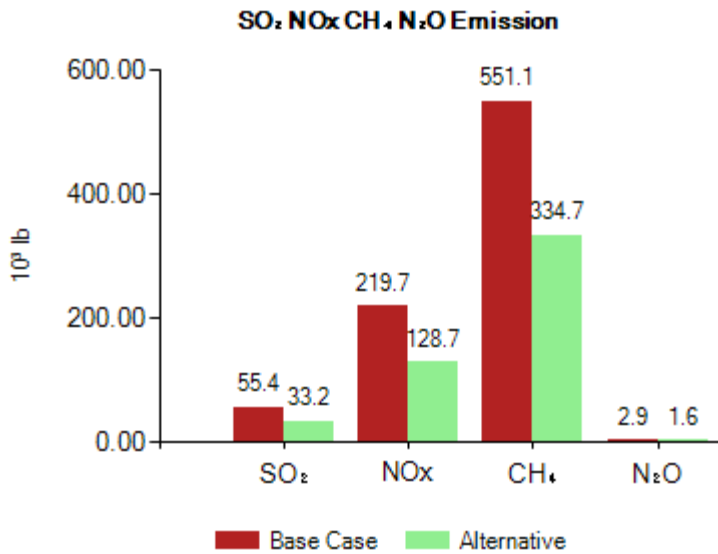

Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

Select Building Configurations

All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>Electric, Efficiency 100%</b> Electric Consumption: 103,913 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 450 \$/Unit +10.00 \$/kBtuh Unit Capacity: 50 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 69,147 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 40 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 8,241 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.1</b> Electric Consumption: 17,862 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 760 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.81	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	1,178.8	1.540	0.870	2.315	0.0090	1,246.0
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	107.06	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,146.05</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	208,361 (10 <sup>3</sup> kWh)	710.93	1,997.71	20,440	61,881
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>710.93</b>	<b>1,997.71</b>	<b>20,440</b>	



	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	-8,288	-29,984	Never

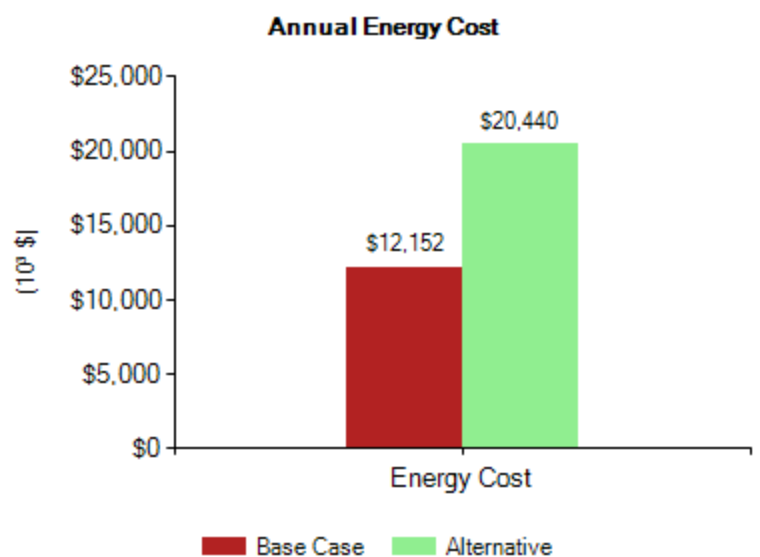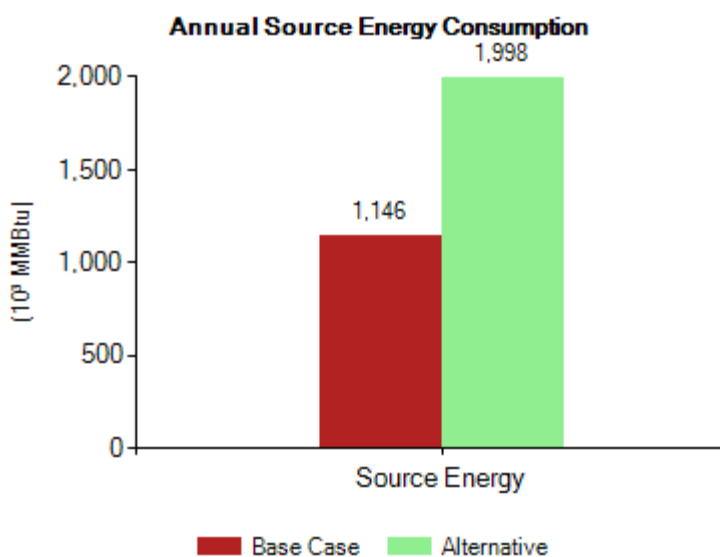



## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	44.84	173.66	137.27	602.54	2.96	154.80
Alternative	320.88	181.27	245.62	482.36	1.88	259.62

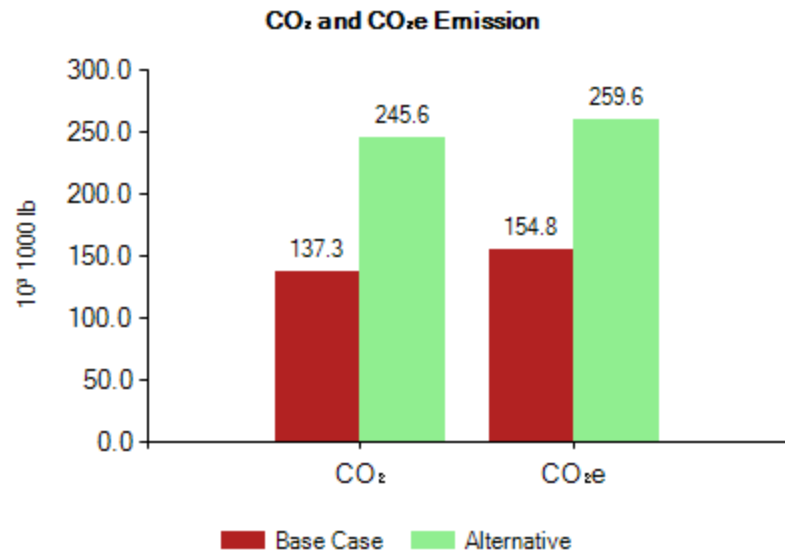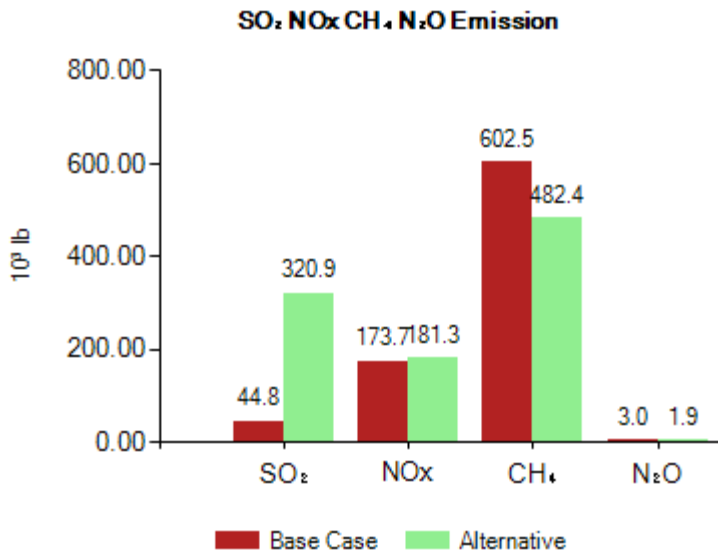

# Energy Planning Analysis Tool

## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>Electric, Efficiency 100%</b> Electric Consumption: 103,913 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 450 \$/Unit +10.00 \$/kBtuh Unit Capacity: 50 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 69,147 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 40 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 8,241 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.1</b> Electric Consumption: 17,862 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 760 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	86.86	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,125.85</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	208,361 (10 <sup>3</sup> kWh)	710.93	1,620.92	20,440	61,881
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>710.93</b>	<b>1,620.92</b>	<b>20,440</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	-8,288	-29,984	Never

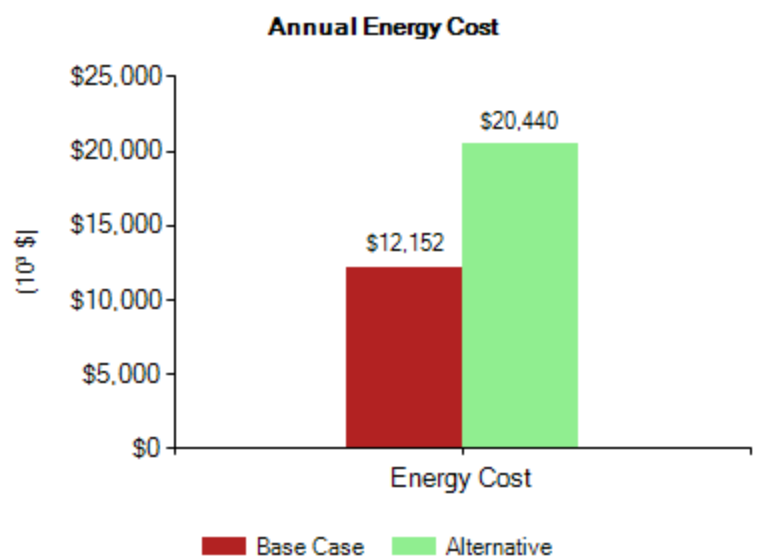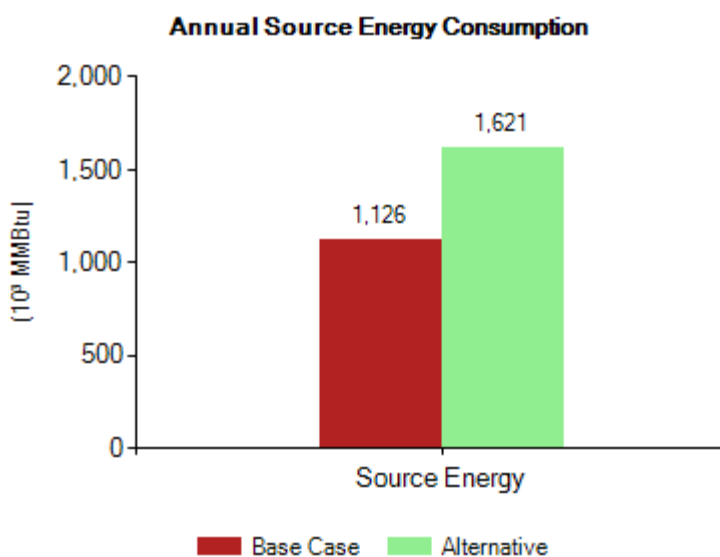

## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	29.21	167.75	130.39	595.93	2.87	147.71
Alternative	29.17	70.84	117.31	359.01	0.21	127.43

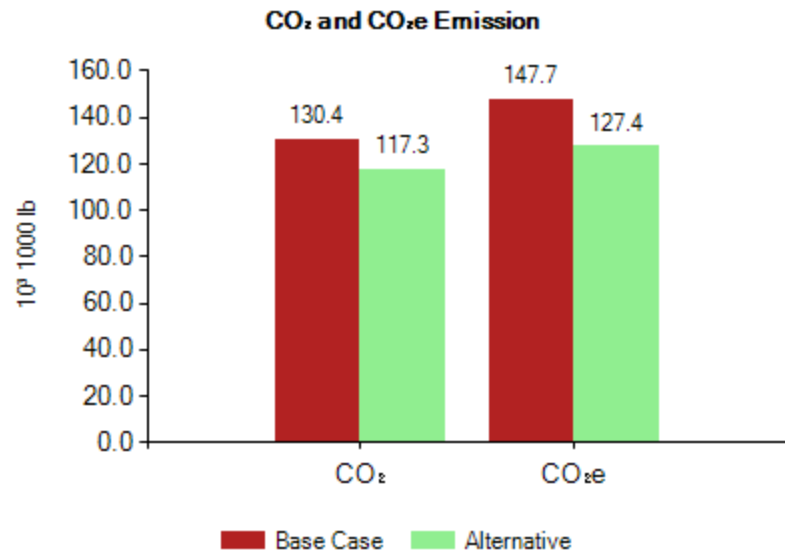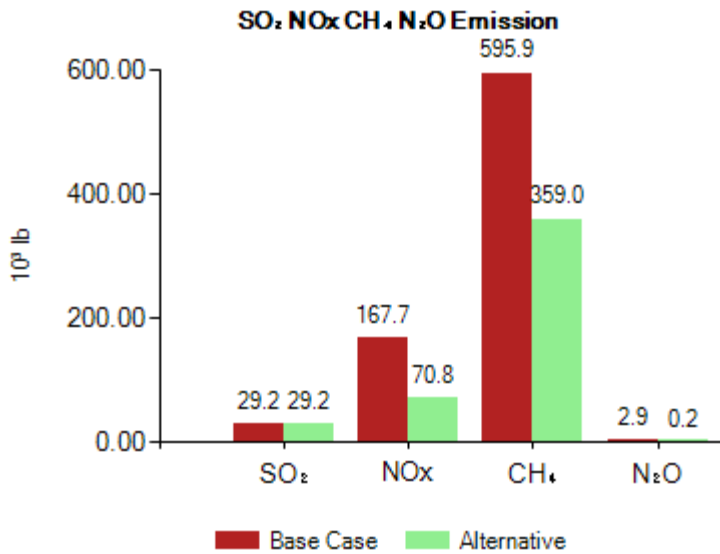

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>Electric, Efficiency 100%</b> Electric Consumption: 103,913 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 450 \$/Unit +10.00 \$/kBtuh Unit Capacity: 50 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 69,147 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 40 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 8,241 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.1</b> Electric Consumption: 17,862 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 760 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.15	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	468.3	0.120	0.290	1.431	0.0010	508.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	81.91	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,120.90</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	208,361 (10 <sup>3</sup> kWh)	710.93	1,528.49	20,440	61,881
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>710.93</b>	<b>1,528.50</b>	<b>20,440</b>	



	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	-8,288	-29,984	Never

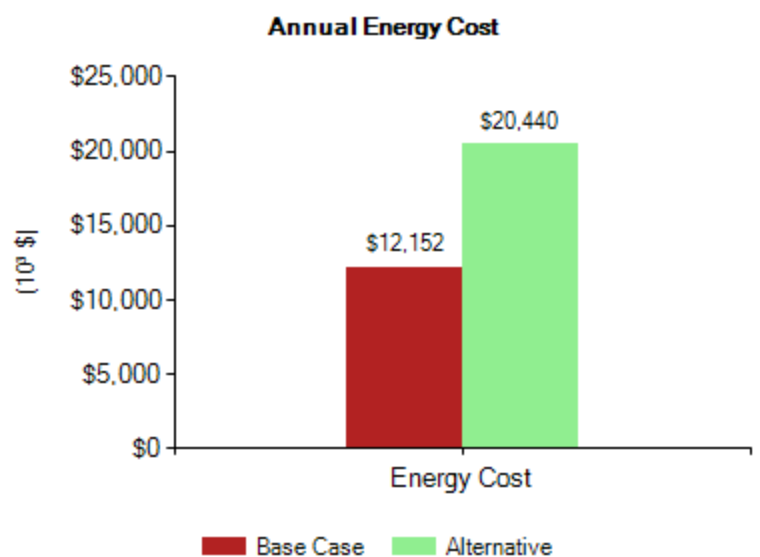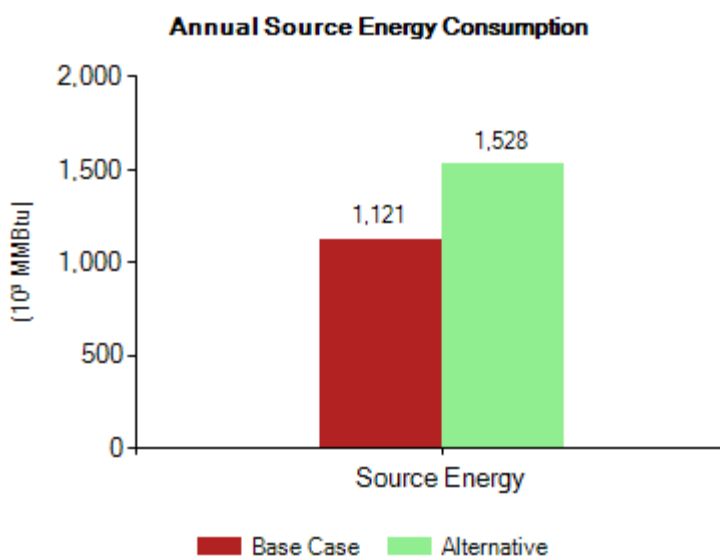



## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	28.98	167.19	129.34	592.66	2.87	146.56
Alternative	25.00	60.42	97.58	298.16	0.21	105.97

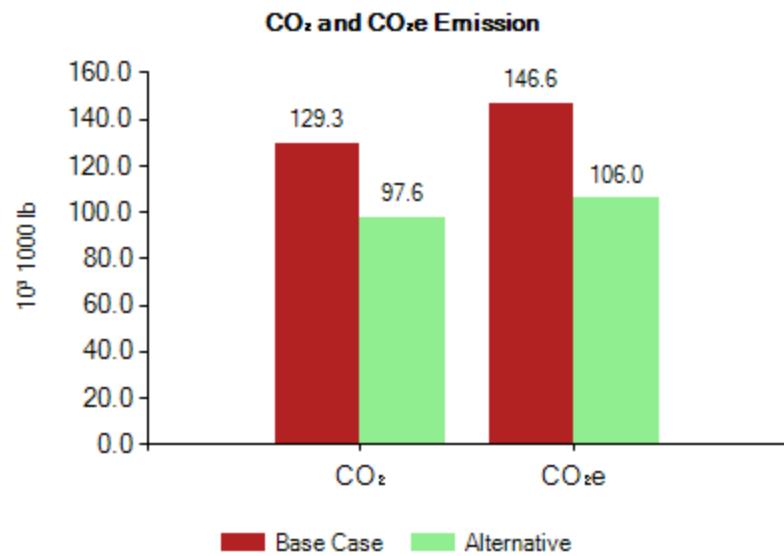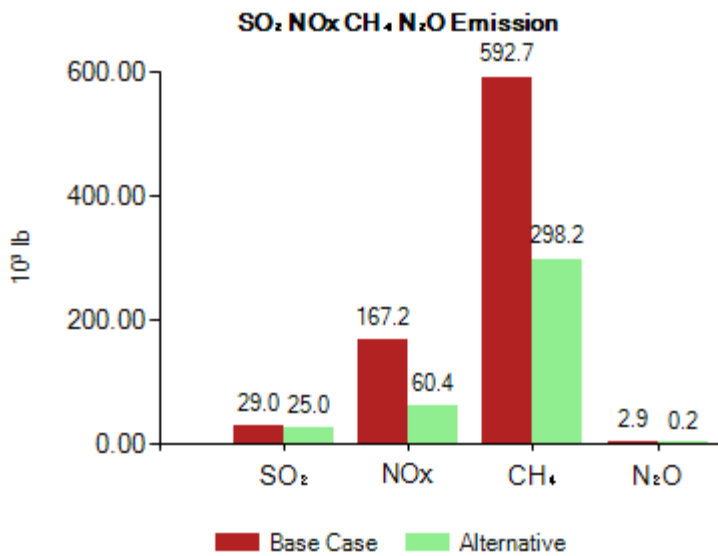

Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

Select Building Configurations

All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 45,362 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 3,873 \$/Unit +42.00 \$/kBtuh Unit Capacity: 60 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 18,836 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 69,147 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 40 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 8,241 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.1</b> Electric Consumption: 17,862 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 760 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.81	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	1,178.8	1.540	0.870	2.315	0.0090	1,246.0
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used) Electric (mCHP to Grid) Natural Gas (Building Used) Natural Gas (mCHP Used) Propane (Building Used) <b>Total</b>	11,166 (10 <sup>3</sup> kWh) 0 (10 <sup>3</sup> kWh) 9,532 (10 <sup>3</sup> Therm) 0 (10 <sup>3</sup> Therm) 0 (10 <sup>3</sup> Gal) <b>991.30</b>	38.10 0.00 953.20 0.00 0.00 <b>991.30</b>	107.06 0.00 1,038.99 0.00 0.00 <b>1,146.05</b>	1,095 0 11,057 0 0 <b>12,152</b>	91,865
Alternative	Electric (Building Used) Electric (mCHP to Grid) Natural Gas (Building Used) Natural Gas (mCHP Used) Propane (Building Used) <b>Total</b>	149,810 (10 <sup>3</sup> kWh) 0 (10 <sup>3</sup> kWh) 0 (10 <sup>3</sup> Therm) 0 (10 <sup>3</sup> Therm) 0 (10 <sup>3</sup> Gal) <b>511.15</b>	511.15 0.00 0.00 0.00 0.00 <b>511.15</b>	1,436.34 0.00 0.00 0.00 0.00 <b>1,436.34</b>	14,696 0 0 0 0 <b>14,696</b>	162,005

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	-2,544	70,140	Never

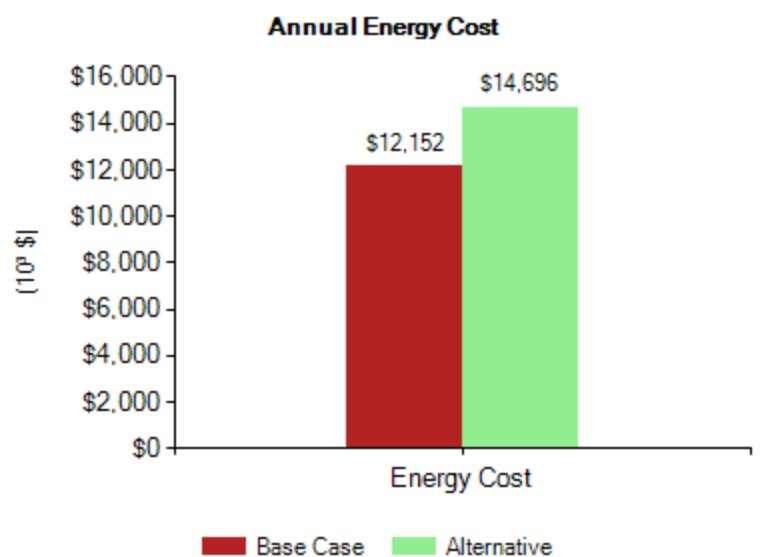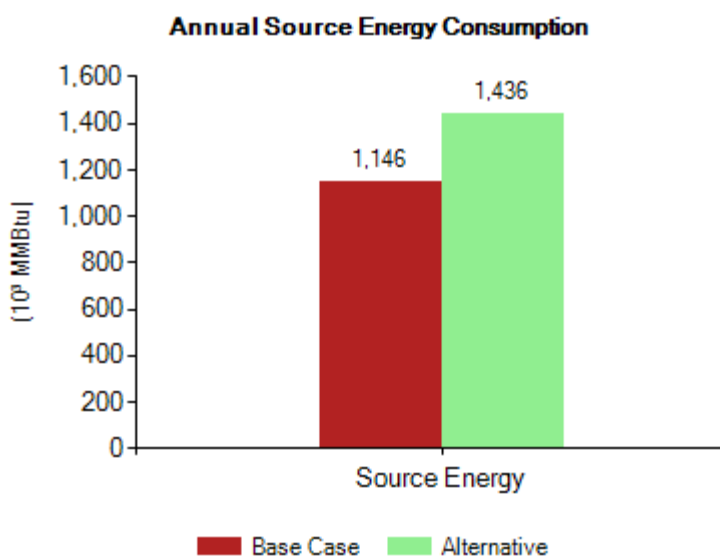

## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2e</sub> (10 <sup>6</sup> lb)
Baseline	44.84	173.66	137.27	602.54	2.96	154.80
Alternative	230.71	130.33	176.60	346.81	1.35	186.66

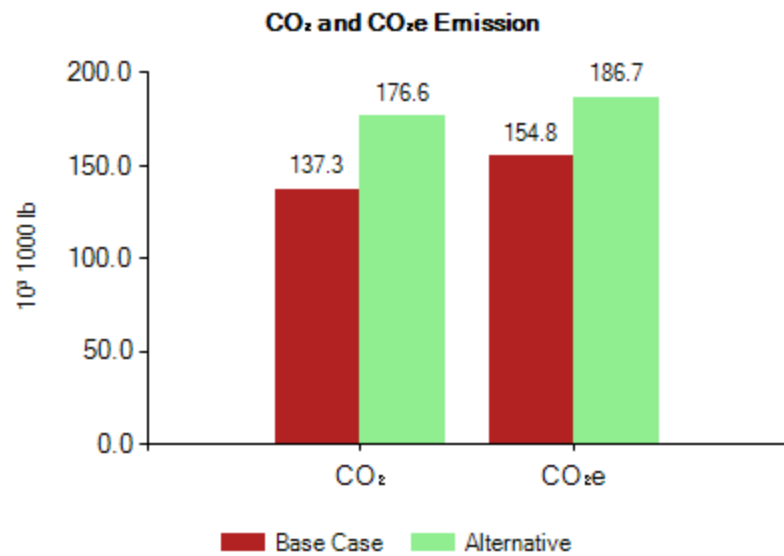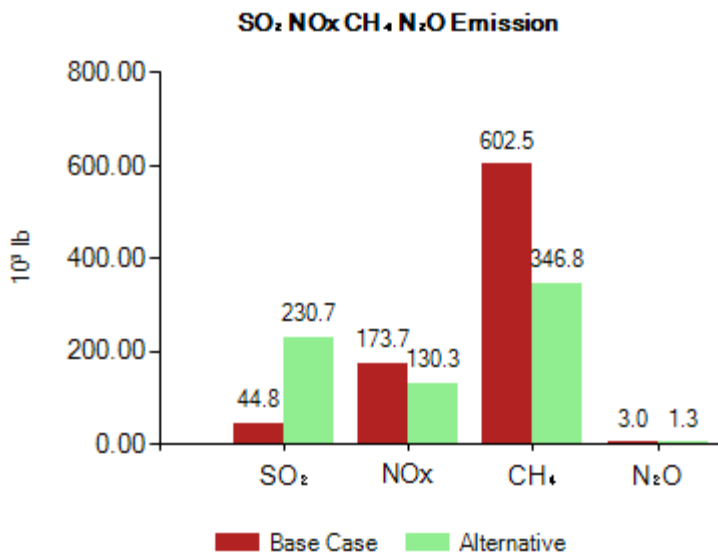

Energy Planning Analysis Tool



Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

Select Building Configurations

All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10^3 kWh) Gas Consumption: 4,709 (10^3 Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 45,362 (10^3 kWh) Gas Consumption: 0 (10^3 Therm) Installed Cost: 3,873 \$/Unit +42.00 \$/kBtuh Unit Capacity: 60 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10^3 kWh) Gas Consumption: 0 (10^3 Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 18,836 (10^3 kWh) Gas Consumption: 0 (10^3 Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10^3 kWh)	Electric Consumption: 9,198 (10^3 kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10^3 kWh) Gas Consumption: 3,615 (10^3 Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 69,147 (10^3 kWh) Gas Consumption: 0 (10^3 Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 40 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 8,241 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.1</b> Electric Consumption: 17,862 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 760 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	86.86	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,125.85</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	149,810 (10 <sup>3</sup> kWh)	511.15	1,165.43	14,696	162,005
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>511.15</b>	<b>1,165.43</b>	<b>14,696</b>	



	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	-2,544	70,140	Never

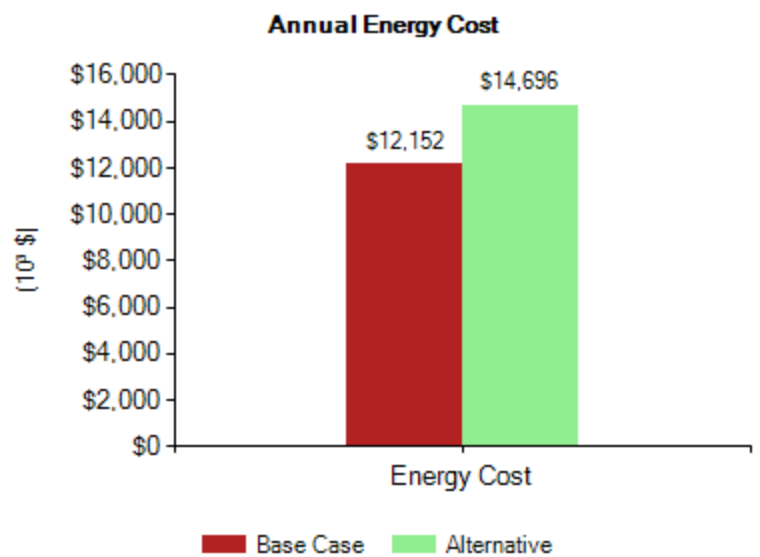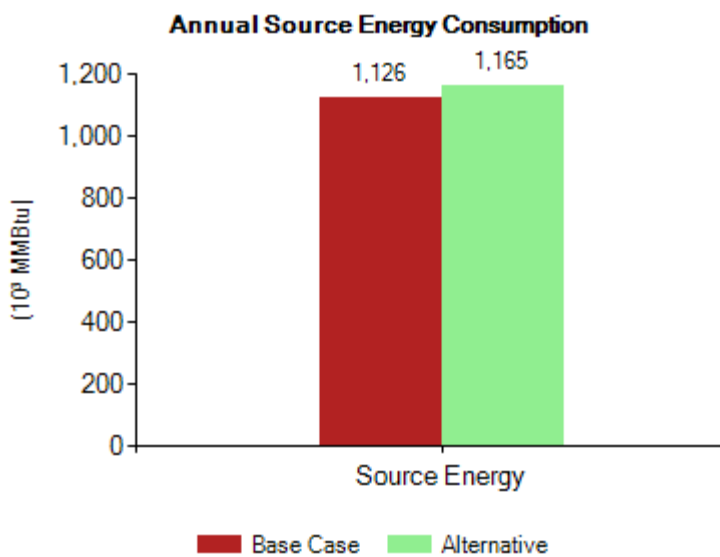



## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2e</sub> (10 <sup>6</sup> lb)
Baseline	29.21	167.75	130.39	595.93	2.87	147.71
Alternative	20.97	50.94	84.34	258.12	0.15	91.62

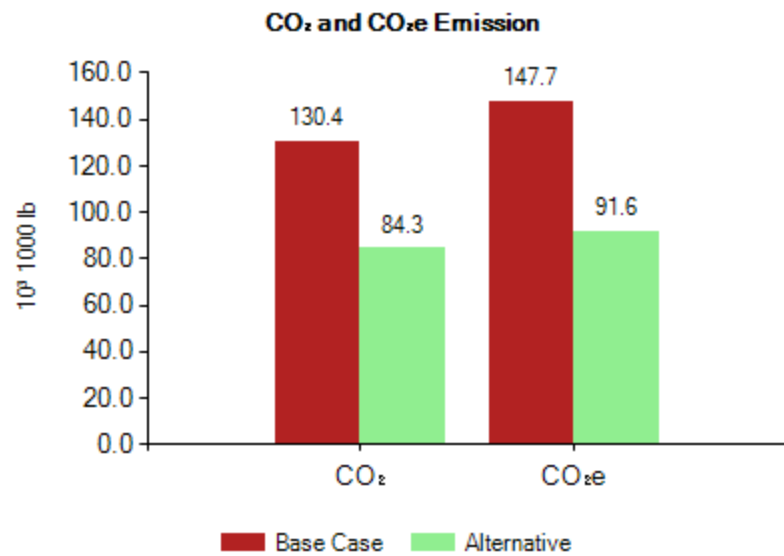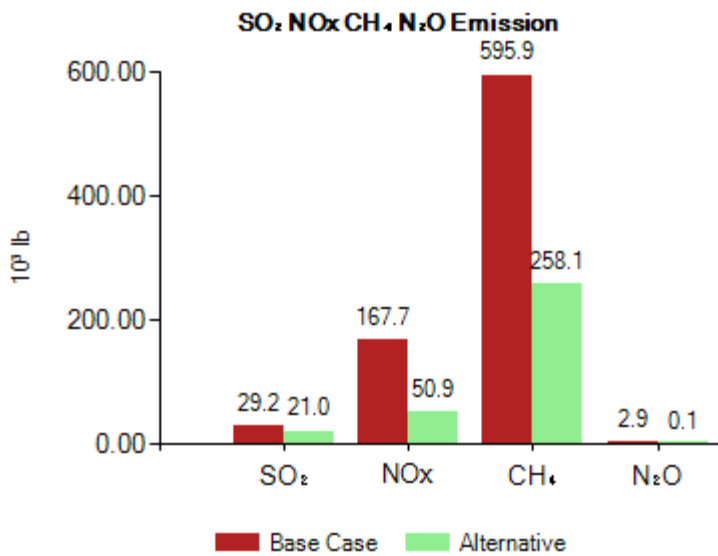

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 45,362 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 3,873 \$/Unit +42.00 \$/kBtuh Unit Capacity: 60 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 18,836 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 69,147 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 40 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 8,241 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.1</b> Electric Consumption: 17,862 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 760 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.15	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	468.3	0.120	0.290	1.431	0.0010	508.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	81.91	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,120.90</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	149,810 (10 <sup>3</sup> kWh)	511.15	1,098.98	14,696	162,005
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>511.15</b>	<b>1,098.98</b>	<b>14,696</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	-2,544	70,140	Never

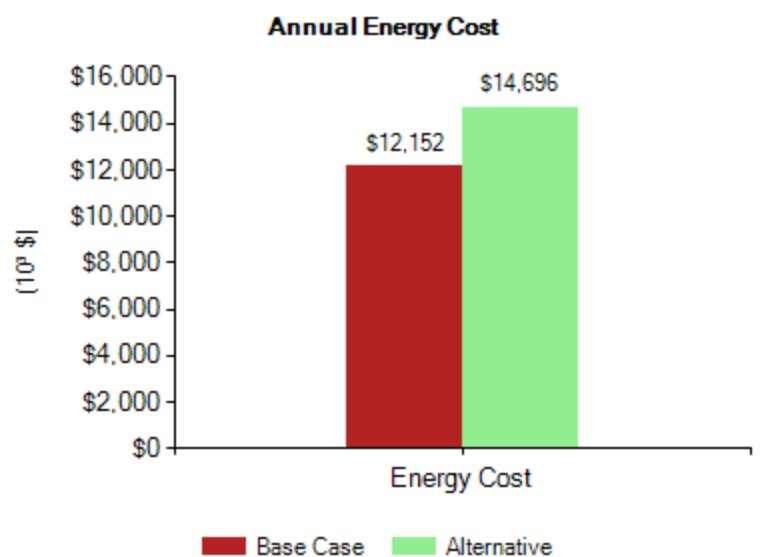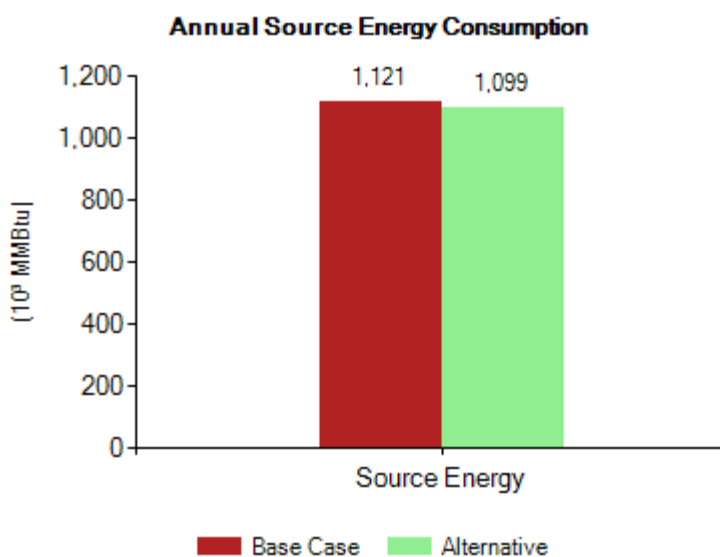

## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	28.98	167.19	129.34	592.66	2.87	146.56
Alternative	17.98	43.44	70.16	214.38	0.15	76.19

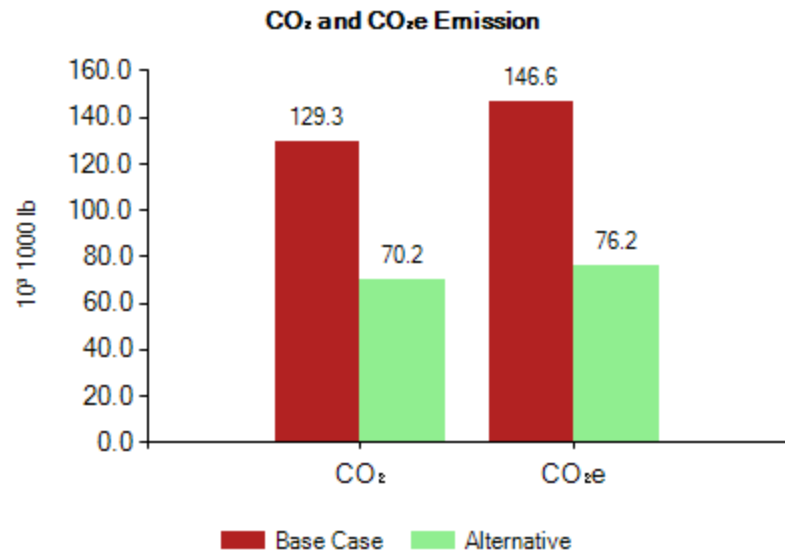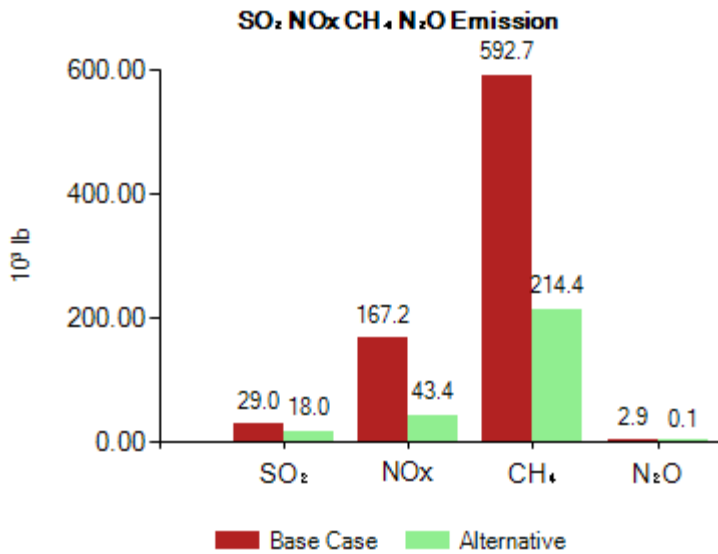

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 36,091 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 4,745 \$/Unit +42.00 \$/kBtuh Unit Capacity: 60 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 14,311 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Heat Pump EF, 2.00</b> Electric Consumption: 32,835 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 1,900 \$/Unit Unit Capacity: 50 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10^3 kWh)	Electric Consumption: 34,515 (10^3 kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10^3 kWh) Gas Consumption: 570 (10^3 Therm) Installed Cost: 823 \$/Unit	<b>Electric Induction EF 0.84</b> Electric Consumption: 7,266 (10^3 kWh) Gas Consumption: 0 (10^3 therm) Installed Cost: 1,879 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10^3 kWh)	How many: 1 Electric Consumption: 0 (10^3 kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10^3 kWh)	How many: 1 Electric Consumption: 3,164 (10^3 kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10^3 kWh)	How many: 1 Electric Consumption: 0 (10^3 kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10^3 kWh) Gas Consumption: 638 (10^3 Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.93</b> Electric Consumption: 14,091 (10^3 kWh) Gas Consumption: 0 (10^3 Therm) Installed Cost: 930 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10^3 kWh) Electric Export to Grid: 0 (10^3 kWh) NG Building Used Reduction: 0 (10^3 therm) mCHP NG Consumption: 0 (10^3 therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10^3 kWh) Electric Export to Grid: 0 (10^3 kWh) NG Building Used Reduction: 0 (10^3 therm) mCHP NG Consumption: 0 (10^3 therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.81	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	1,178.8	1.540	0.870	2.315	0.0090	1,246.0
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	107.06	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,146.05</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	99,481 (10 <sup>3</sup> kWh)	339.43	953.80	9,759	220,262
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>339.43</b>	<b>953.80</b>	<b>9,759</b>	



	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	2,393	128,397	53.7

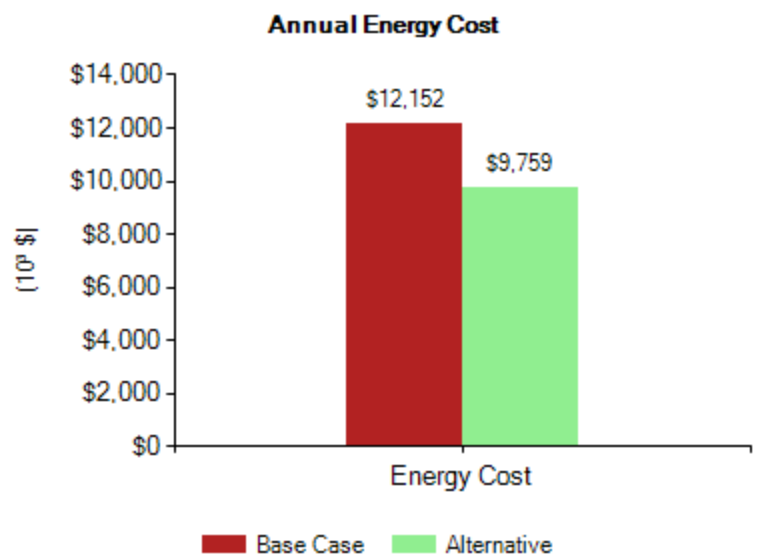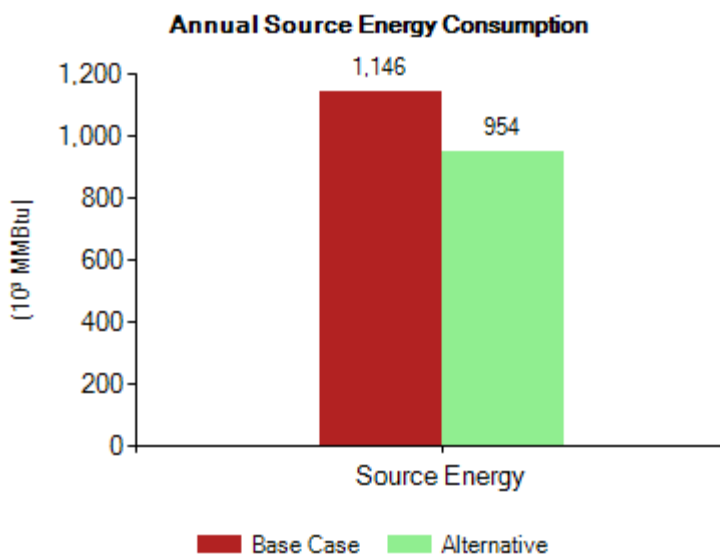



## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	44.84	173.66	137.27	602.54	2.96	154.80
Alternative	153.20	86.55	117.27	230.30	0.90	123.95

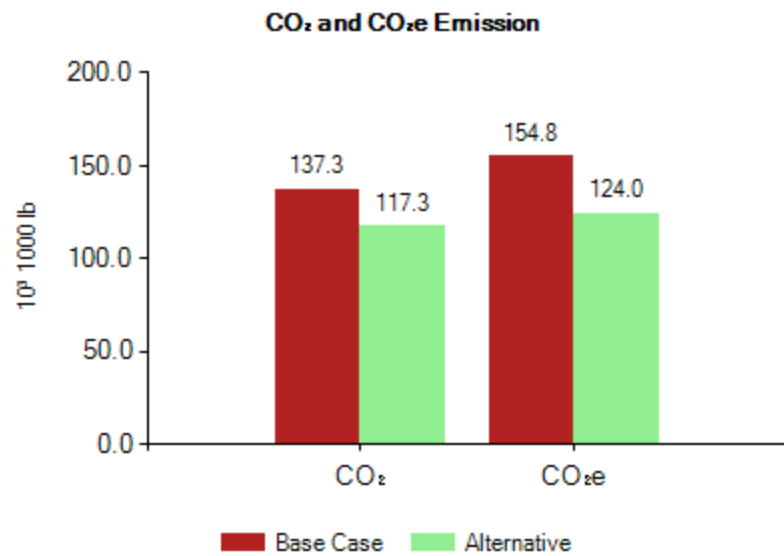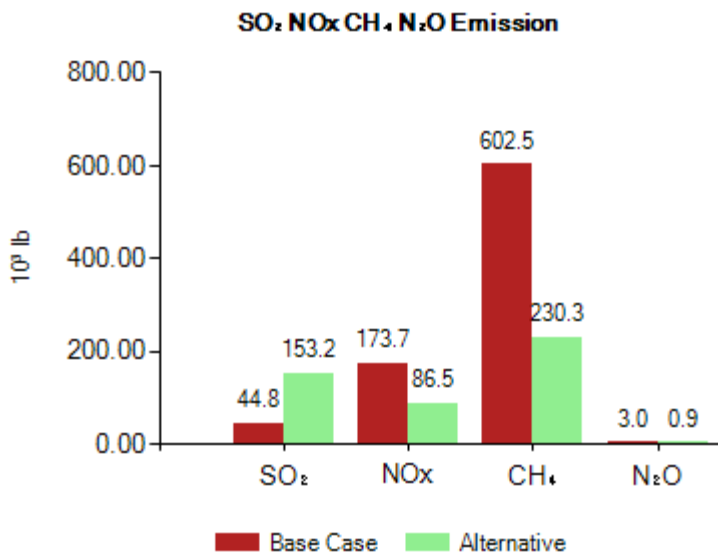

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 36,091 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 4,745 \$/Unit +42.00 \$/kBtuh Unit Capacity: 60 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 14,311 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Heat Pump EF, 2.00</b> Electric Consumption: 32,835 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 1,900 \$/Unit Unit Capacity: 50 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Induction EF 0.84</b> Electric Consumption: 7,266 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 1,879 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.93</b> Electric Consumption: 14,091 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 930 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	86.86	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,125.85</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	99,481 (10 <sup>3</sup> kWh)	339.43	773.90	9,759	220,262
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>339.43</b>	<b>773.90</b>	<b>9,759</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	2,393	128,397	53.7

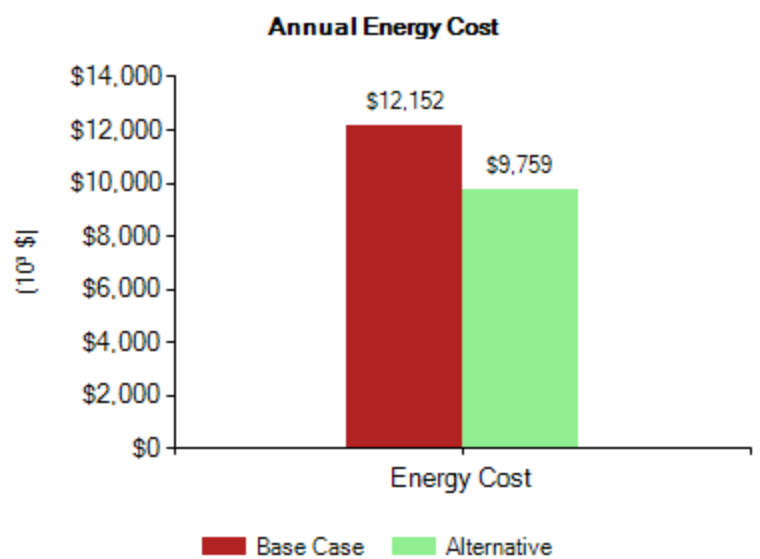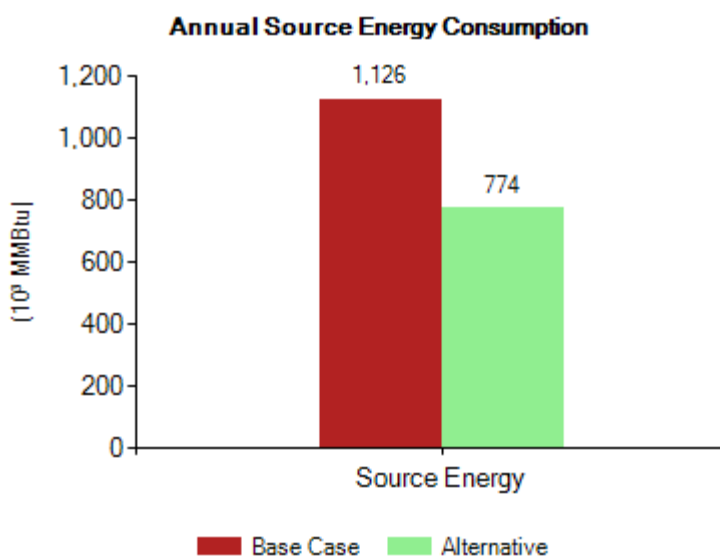

## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2e</sub> (10 <sup>6</sup> lb)
Baseline	29.21	167.75	130.39	595.93	2.87	147.71
Alternative	13.93	33.82	56.01	171.41	0.10	60.84

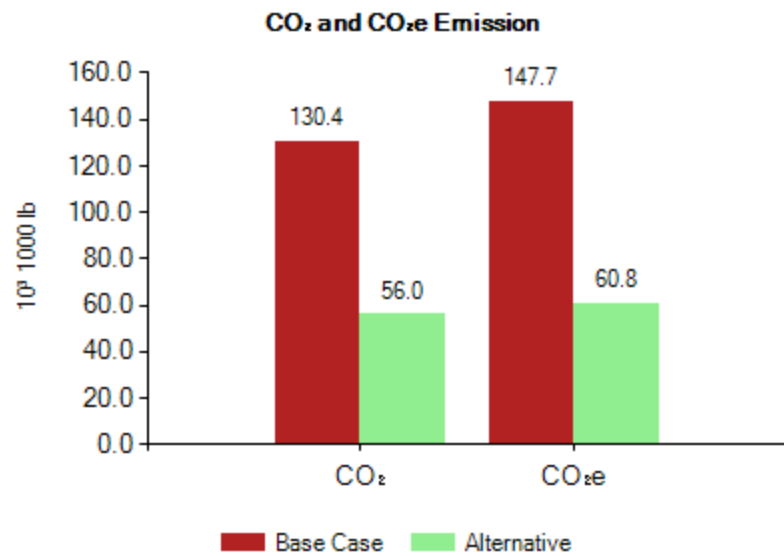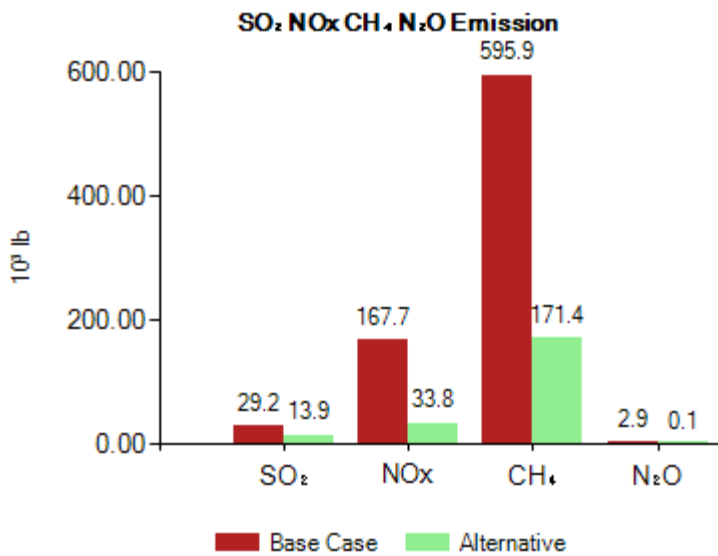

Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
x	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
x	Single Fam. Attached	825	1,318	3
x	Apt. Building 2 to 4 units	1,775	1,000	3
x	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>18,395</b>	<b>1,294</b>	<b>3</b>

State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

Select Building Configurations

All Houses

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 80%</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 4,709 (10 <sup>3</sup> Therm) Installed Cost: 1,881 \$/Unit +2.70 \$/kBtuh Unit Capacity: 60 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 36,091 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 4,745 \$/Unit +42.00 \$/kBtuh Unit Capacity: 60 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 24,171 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 30 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 14,311 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 30 kBtuh
x	HVAC Blower	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)	Electric Consumption: 9,198 (10 <sup>3</sup> kWh)
x	Water Heating	<b>Natural Gas EF 0.62 - Min. Eff. Storage</b> Electric Consumption: 0 (10 <sup>3</sup> kWh) Gas Consumption: 3,615 (10 <sup>3</sup> Therm) Installed Cost: 728 \$/Unit +10.00 \$/gal Unit Capacity: 40 Gal	<b>Electric Heat Pump EF, 2.00</b> Electric Consumption: 32,835 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 1,900 \$/Unit Unit Capacity: 50 Gal

	Lighting & Plug-in Loads	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)	Electric Consumption: 34,515 (10 <sup>3</sup> kWh)
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 570 (10 <sup>3</sup> kWh) Gas Consumption: 570 (10 <sup>3</sup> Therm) Installed Cost: 823 \$/Unit	<b>Electric Induction EF 0.84</b> Electric Consumption: 7,266 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 1,879 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
	Dishwasher	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 3,164 (10 <sup>3</sup> kWh)
	Washer	How many: 1 Electric Consumption: 1,619 (10 <sup>3</sup> kWh)	How many: 1 Electric Consumption: 0 (10 <sup>3</sup> kWh)
x	Clothes Dryer	<b>Gas Standard EF 2.75</b> Electric Consumption: 1,398 (10 <sup>3</sup> kWh) Gas Consumption: 638 (10 <sup>3</sup> Therm) Installed Cost: 1,000 \$/Unit	<b>Electric Standard EF 3.93</b> Electric Consumption: 14,091 (10 <sup>3</sup> kWh) Gas Consumption: 0 (10 <sup>3</sup> Therm) Installed Cost: 930 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (10 <sup>3</sup> kWh) Electric Export to Grid: 0 (10 <sup>3</sup> kWh) NG Building Used Reduction: 0 (10 <sup>3</sup> therm) mCHP NG Consumption: 0 (10 <sup>3</sup> therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.15	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	468.3	0.120	0.290	1.431	0.0010	508.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> MMBtu)	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)
Baseline	Electric (Building Used)	11,166 (10 <sup>3</sup> kWh)	38.10	81.91	1,095	91,865
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	9,532 (10 <sup>3</sup> Therm)	953.20	1,038.99	11,057	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>991.30</b>	<b>1,120.90</b>	<b>12,152</b>	
Alternative	Electric (Building Used)	99,481 (10 <sup>3</sup> kWh)	339.43	729.77	9,759	220,262
	Electric (mCHP to Grid)	0 (10 <sup>3</sup> kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (10 <sup>3</sup> Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (10 <sup>3</sup> Gal)	0.00	0.00	0	
	<b>Total</b>		<b>339.43</b>	<b>729.77</b>	<b>9,759</b>	



	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(10 <sup>3</sup> \$)	(10 <sup>3</sup> \$)	(Year)
Comparison	2,393	128,397	53.7

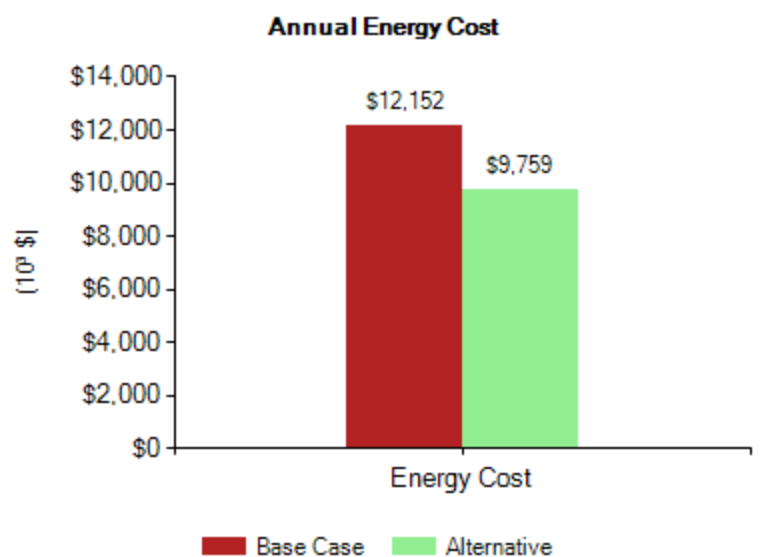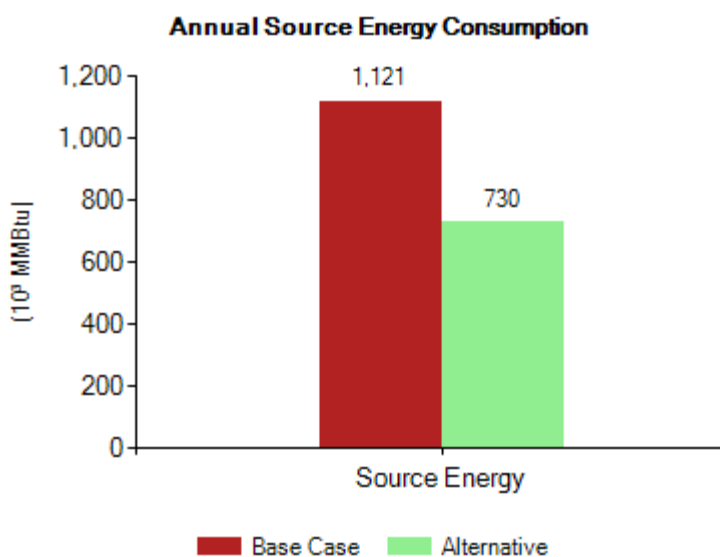



## Annual Source Emissions

	SO <sub>2</sub> (10 <sup>3</sup> lb)	NO <sub>x</sub> (10 <sup>3</sup> lb)	CO <sub>2</sub> (10 <sup>6</sup> lb)	CH <sub>4</sub> (10 <sup>3</sup> lb)	N <sub>2</sub> O (10 <sup>3</sup> lb)	CO <sub>2</sub> e (10 <sup>6</sup> lb)
Baseline	28.98	167.19	129.34	592.66	2.87	146.56
Alternative	11.94	28.85	46.59	142.36	0.10	50.60

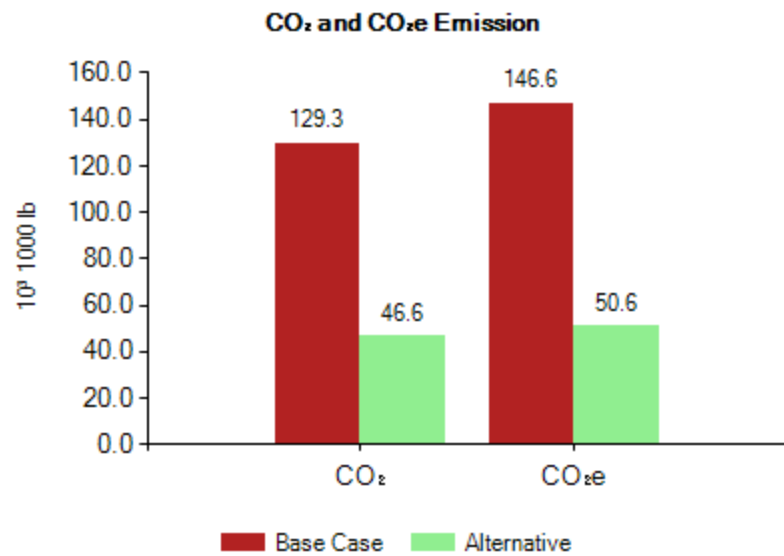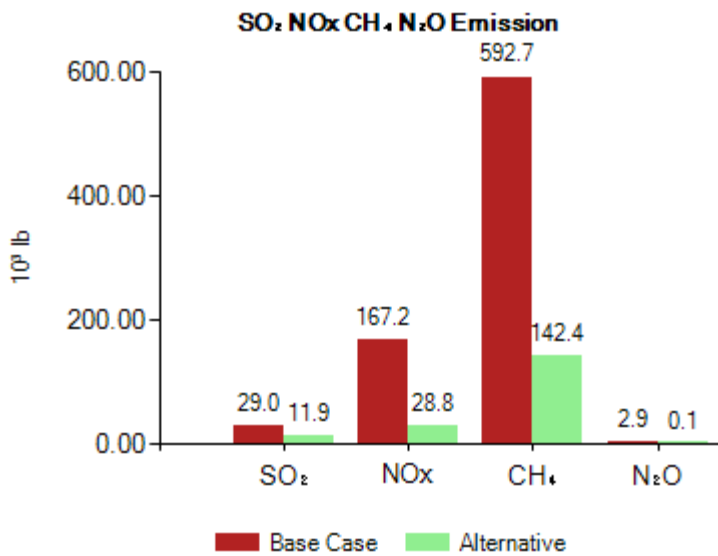

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
	Single Fam. Attached	825	1,318	3
	Apt. Building 2 to 4 units	1,775	1,000	3
	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>11,400</b>	<b>1,542</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### Single House

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 98%</b> Electric Consumption: 0 ( kWh) Gas Consumption: 236 ( Therm) Installed Cost: 2,807 \$/Unit +3.86 \$/kBtuh Unit Capacity: 60 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 2,787 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 3,873 \$/Unit +42.00 \$/kBtuh Unit Capacity: 70 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 1,421 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 36 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 1,108 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 36 kBtuh
x	HVAC Blower	Electric Consumption: 603 ( kWh)	Electric Consumption: 548 ( kWh)
x	Water Heating	<b>Natural Gas EF 0.95 - Condensing Tankless</b> Electric Consumption: 45 ( kWh) Gas Consumption: 127 ( Therm) Installed Cost: 2,515 \$/Unit Unit Capacity: 199 kBtu/h	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 3,759 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 60 Gal
	Lighting &	Electric Consumption: 2,236 ( kWh)	Electric Consumption: 2,236 ( kWh)

	Plug-in Loads		
x	Cooking Range	<b>Gas Standard</b> Electric Consumption: 31 (kWh) Gas Consumption: 31 (Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 448 (kWh) Gas Consumption: 0 (therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 (kWh)	How many: 1 Electric Consumption: 0 (kWh)
	Dishwasher	How many: 1 Electric Consumption: 172 (kWh)	How many: 1 Electric Consumption: 172 (kWh)
	Washer	How many: 1 Electric Consumption: 88 (kWh)	How many: 1 Electric Consumption: 0 (kWh)
x	Clothes Dryer	<b>Gas Standard EF 3.84</b> Electric Consumption: 76 (kWh) Gas Consumption: 25 (Therm) Installed Cost: 1,100 \$/Unit	<b>Electric Standard EF 3.93</b> Electric Consumption: 766 (kWh) Gas Consumption: 0 (Therm) Installed Cost: 930 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 (kWh) Electric Export to Grid: 0 (kWh) NG Building Used Reduction: 0 (therm) mCHP NG Consumption: 0 (therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 (kWh) Electric Export to Grid: 0 (kWh) NG Building Used Reduction: 0 (therm) mCHP NG Consumption: 0 (therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.28	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	563.0	0.140	0.340	1.723	0.0010	611.6
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR. Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(MMBtu)	(MMBtu)	(\$)	(\$)
Baseline	Electric (Building Used)	755 (kWh)	2.58	5.87	74	7,477
	Electric (mCHP to Grid)	0 (kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	419 (Therm)	41.90	45.67	486	
	Natural Gas (mCHP Used)	0 (Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (Gal)	0.00	0.00	0	
	<b>Total</b>		<b>44.48</b>	<b>51.54</b>	<b>560</b>	
Alternative	Electric (Building Used)	8,308 (kWh)	28.35	64.63	815	9,467
	Electric (mCHP to Grid)	0 (kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (Gal)	0.00	0.00	0	
	<b>Total</b>		<b>28.35</b>	<b>64.63</b>	<b>815</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(\$)	(\$)	(Year)
Comparison	-255	1,990	Never

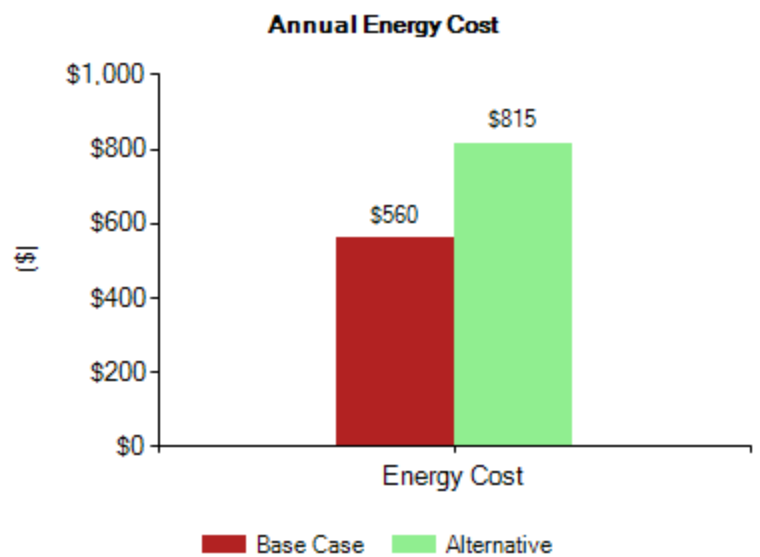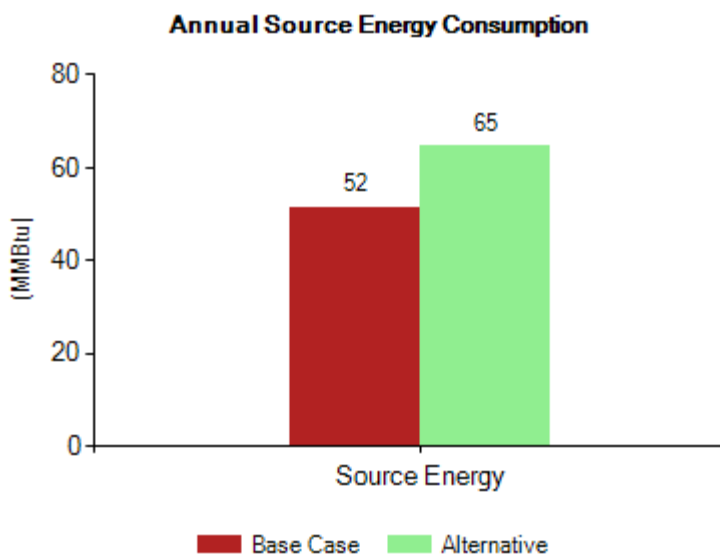

## Annual Source Emissions

	SO <sub>2</sub> (lb)	NO <sub>x</sub> (lb)	CO <sub>2</sub> (1000 lb)	CH <sub>4</sub> (lb)	N <sub>2</sub> O (lb)	CO <sub>2</sub> e (1000 lb)
Baseline	1.32	7.46	5.88	26.65	0.13	6.65
Alternative	1.16	2.82	4.68	14.31	0.01	5.08

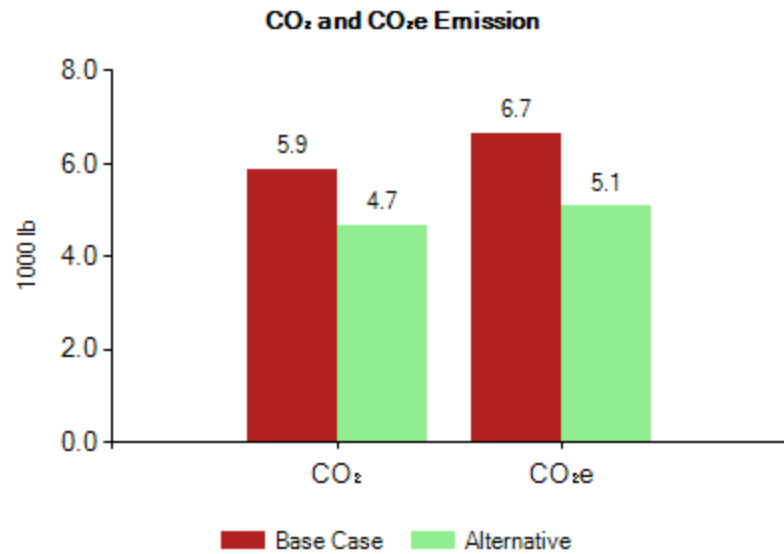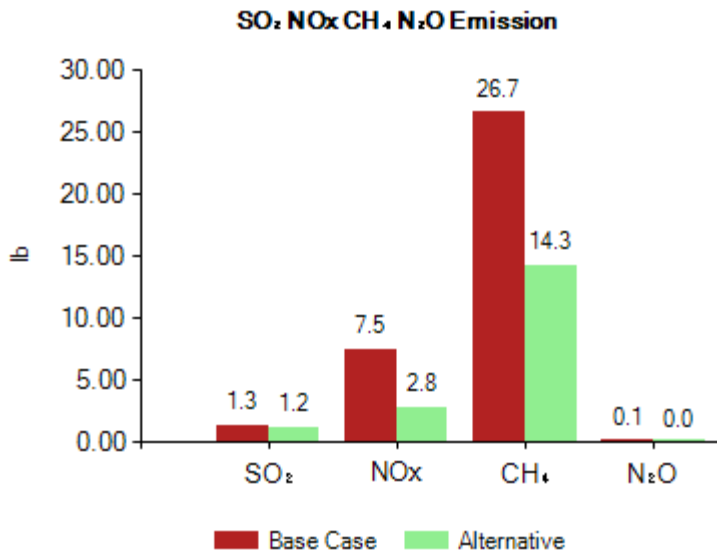

# Energy Planning Analysis Tool

Home | Residential City Level Comparison | Residential State Level Comparison | Tool Description | Contact




## Residential State Level House: Life Cycle Assessment Results


[<< Back to LCCA Input](#)

[View Life Cycle](#)

### Life Cycle Costs and Energy Consumption




	Net Present Cost (\$2020)	Equivalent Annual Cost (\$2020)	Electricity Usage (kWh)	Natural Gas Usage (Therm)	Renewable Natural Gas Usage (Therm)	Propane Usage (Gal)	Re
Base Case	23,003	1,174	22,650	12,570	0	0	
Alternative	32,503	1,658	249,240	0	0	0	

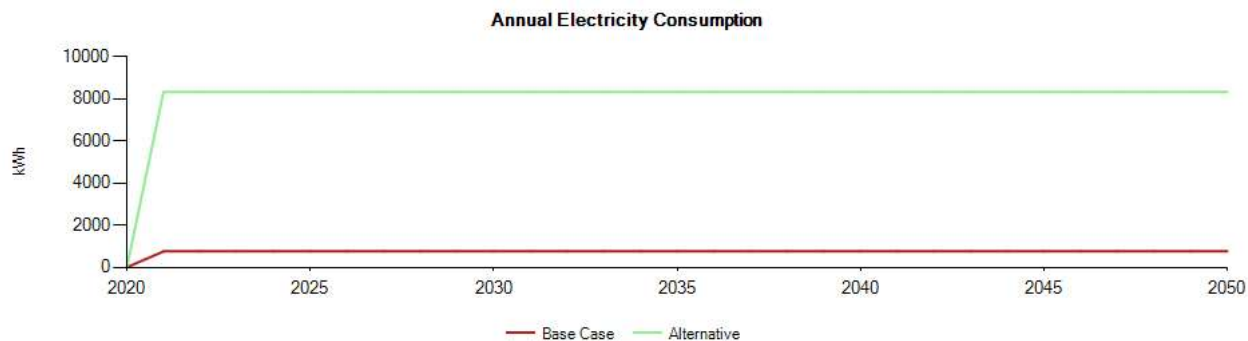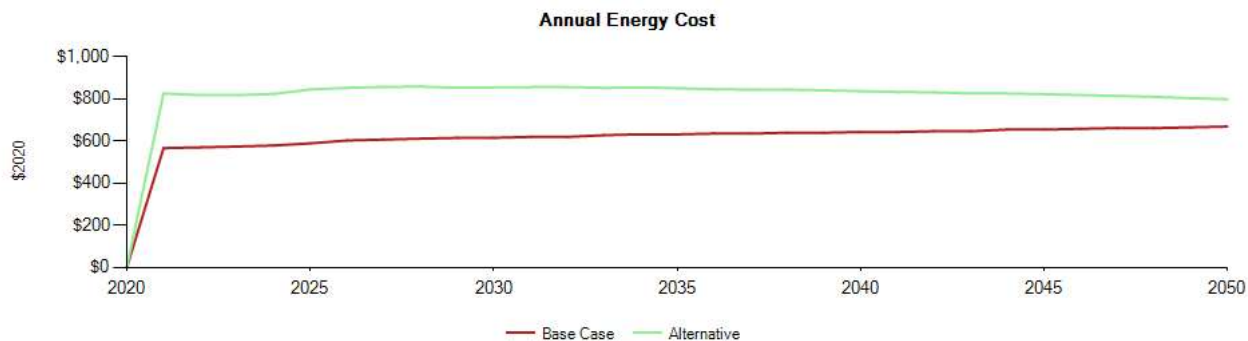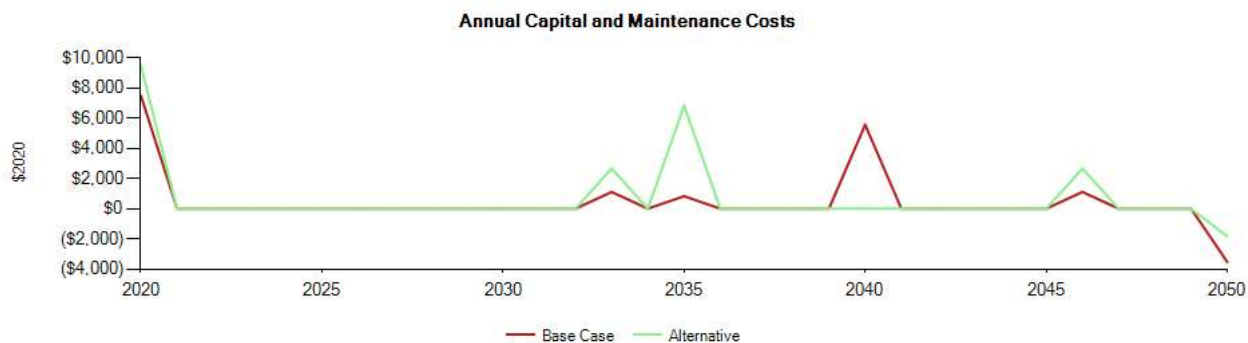

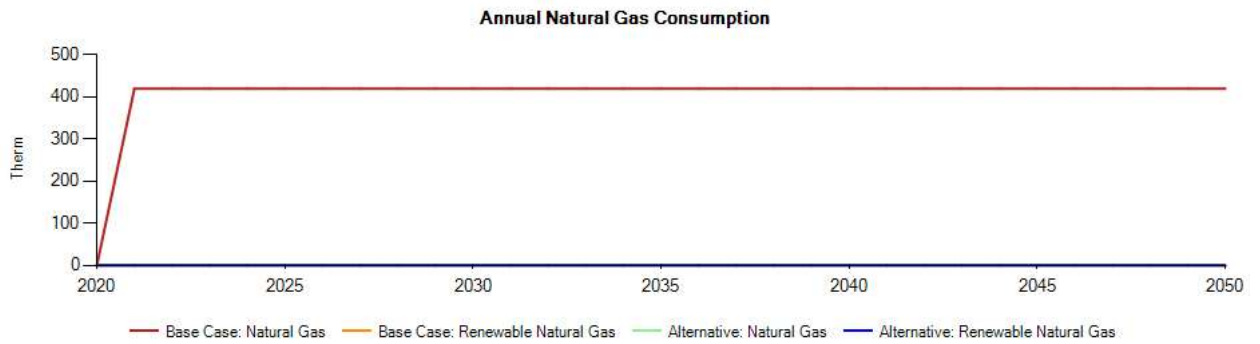




**Life Cycle Source Energy and Emissions**

	Total Source Energy (MMBtu)	CO2 (1000 lb)	SO2 (lb)	NOx (lb)	CH4 (lb)
Base Case	1,549	183	44	231	654
Alternative	1,923	216	81	154	595

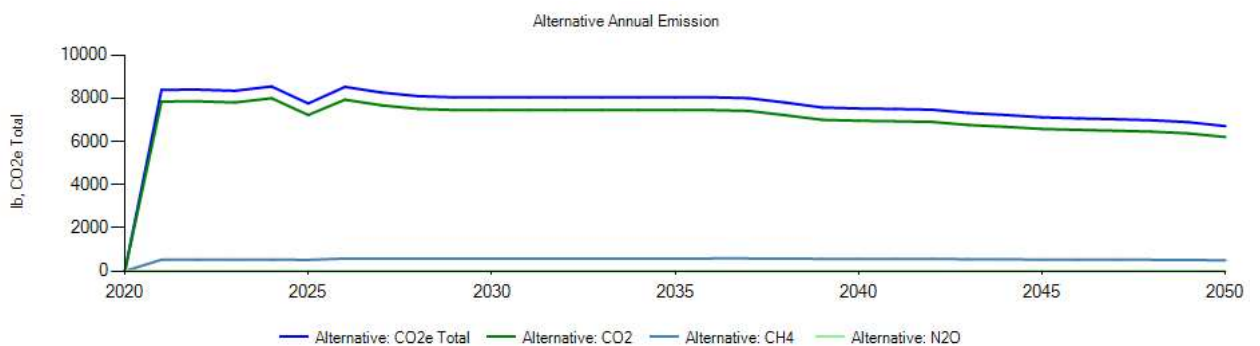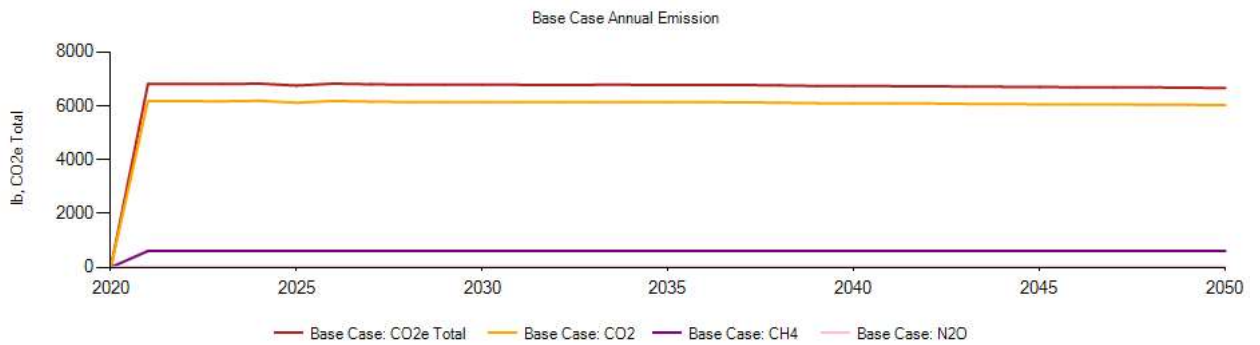
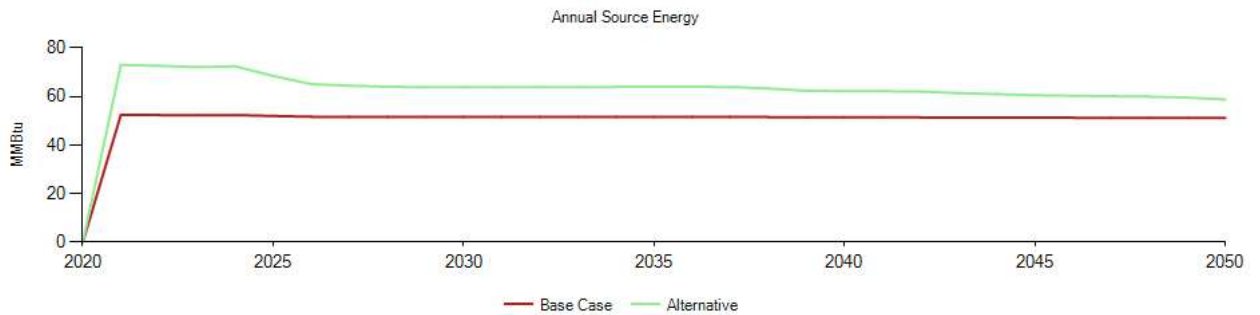


**Case Comparison: Alternative vs. Base Case**

Net Present Cost Savings (Base Case - Alternative) (\$2020)      Life Cycle Cost of Source Energy Savings (Base Case - Alternative) (\$2020/MMBTU)      Cost of CO2 Emission Alternative) (\$2020/MMBTU)

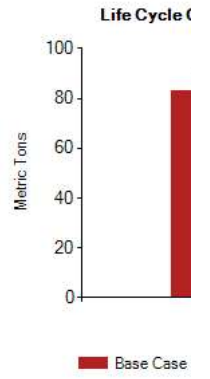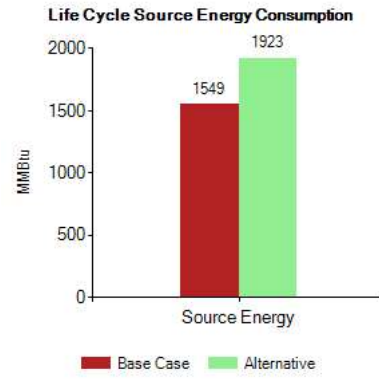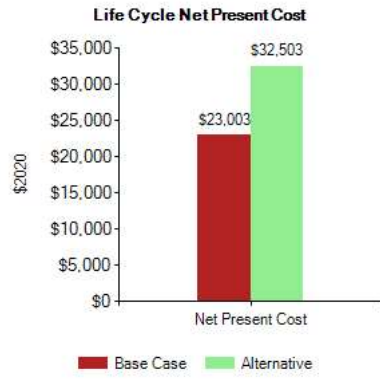

### Climate Impact Prediction

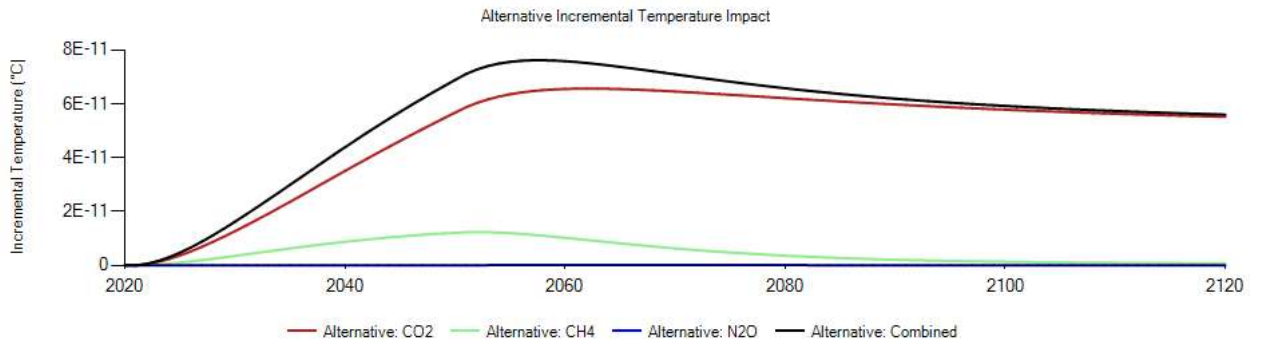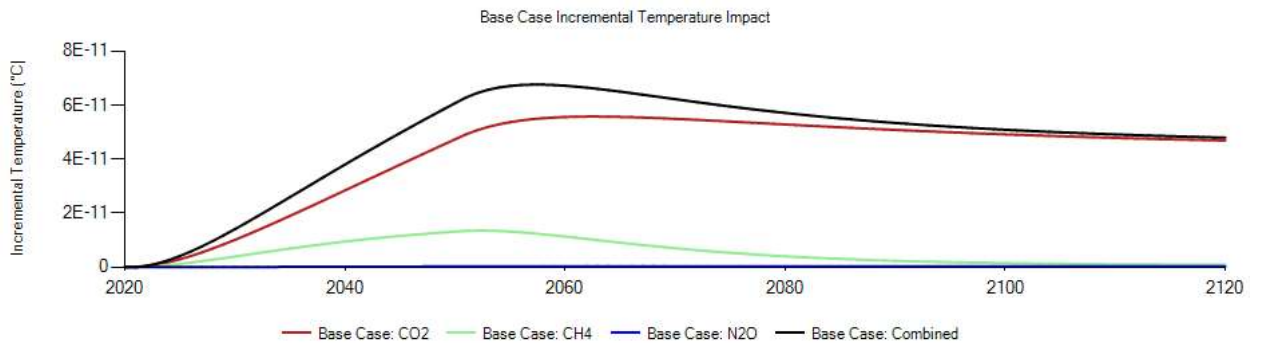

[View Clirr](#)



# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
	Single Fam. Attached	825	1,318	3
	Apt. Building 2 to 4 units	1,775	1,000	3
	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>11,400</b>	<b>1,542</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### Single House

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 98%</b> Electric Consumption: 0 ( kWh) Gas Consumption: 236 ( Therm) Installed Cost: 2,807 \$/Unit +3.86 \$/kBtuh Unit Capacity: 60 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 2,787 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 3,873 \$/Unit +42.00 \$/kBtuh Unit Capacity: 70 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 1,421 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 36 kBtuh	<b>16 SEER /9.0 HSPF Heat Pump</b> Electric Consumption: 1,108 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 36 kBtuh
x	HVAC Blower	Electric Consumption: 603 ( kWh)	Electric Consumption: 548 ( kWh)
	Water Heating	<b>Natural Gas EF 0.95 - Condensing Tankless</b> Electric Consumption: 45 ( kWh) Gas Consumption: 127 ( Therm) Installed Cost: 2,515 \$/Unit Unit Capacity: 199 kBtu/h	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 3,759 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 60 Gal
	Lighting &	Electric Consumption: 2,236 ( kWh)	Electric Consumption: 2,236 ( kWh)

	Plug-in Loads		
	Cooking Range	<b>Gas Standard</b> Electric Consumption: 0 ( kWh) Gas Consumption: 31 ( Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 0 ( kWh) Gas Consumption: 0 ( therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 ( kWh)	How many: 1 Electric Consumption: 0 ( kWh)
	Dishwasher	How many: 1 Electric Consumption: 172 ( kWh)	How many: 1 Electric Consumption: 172 ( kWh)
	Washer	How many: 1 Electric Consumption: 88 ( kWh)	How many: 1 Electric Consumption: 0 ( kWh)
	Clothes Dryer	<b>Gas Standard EF 3.84</b> Electric Consumption: 76 ( kWh) Gas Consumption: 25 ( Therm) Installed Cost: 1,100 \$/Unit	<b>Electric Standard EF 3.93</b> Electric Consumption: 766 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 930 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 ( kWh) Electric Export to Grid: 0 ( kWh) NG Building Used Reduction: 0 ( therm) mCHP NG Consumption: 0 ( therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 ( kWh) Electric Export to Grid: 0 ( kWh) NG Building Used Reduction: 0 ( therm) mCHP NG Consumption: 0 ( therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.33	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	947.7	0.180	0.540	2.920	0.0010	1,029.8
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR. Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost



	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(MMBtu)	(MMBtu)	(\$)	(\$)
Baseline	Electric (Building Used)	603 (kWh)	2.06	4.79	59	3,039
	Electric (mCHP to Grid)	0 (kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	236 (Therm)	23.60	25.72	274	
	Natural Gas (mCHP Used)	0 (Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (Gal)	0.00	0.00	0	
	<b>Total</b>		<b>25.66</b>	<b>30.52</b>	<b>333</b>	
Alternative	Electric (Building Used)	3,335 (kWh)	11.38	26.51	327	6,813
	Electric (mCHP to Grid)	0 (kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (Gal)	0.00	0.00	0	
	<b>Total</b>		<b>11.38</b>	<b>26.51</b>	<b>327</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(\$)	(\$)	(Year)
Comparison	6	3,774	629.1

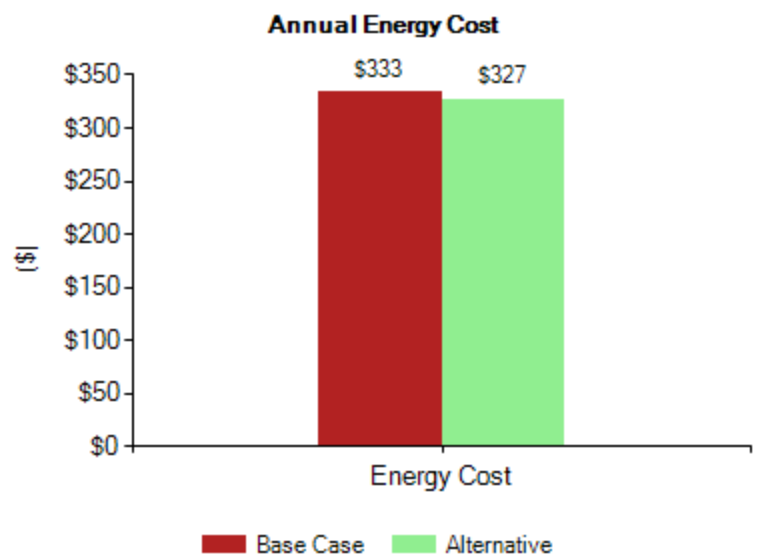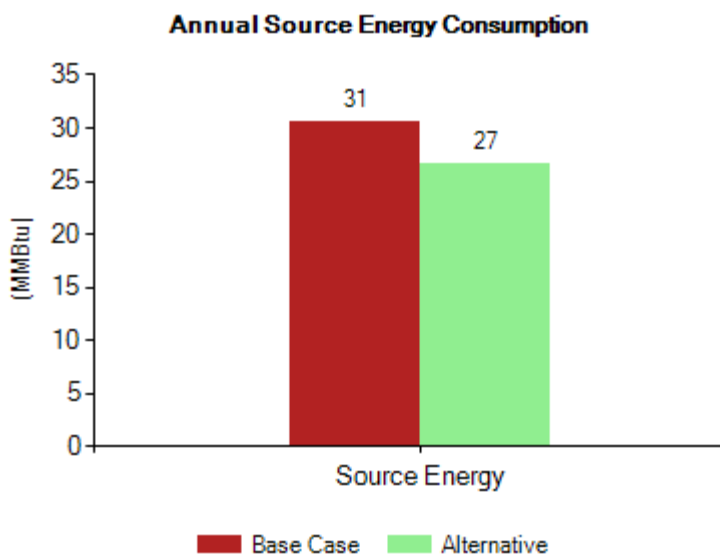

## Annual Source Emissions

	SO <sub>2</sub> (lb)	NO <sub>x</sub> (lb)	CO <sub>2</sub> (1000 lb)	CH <sub>4</sub> (lb)	N <sub>2</sub> O (lb)	CO <sub>2</sub> e (1000 lb)
Baseline	0.79	4.38	3.64	16.04	0.07	4.11
Alternative	0.60	1.80	3.16	9.74	0.00	3.43

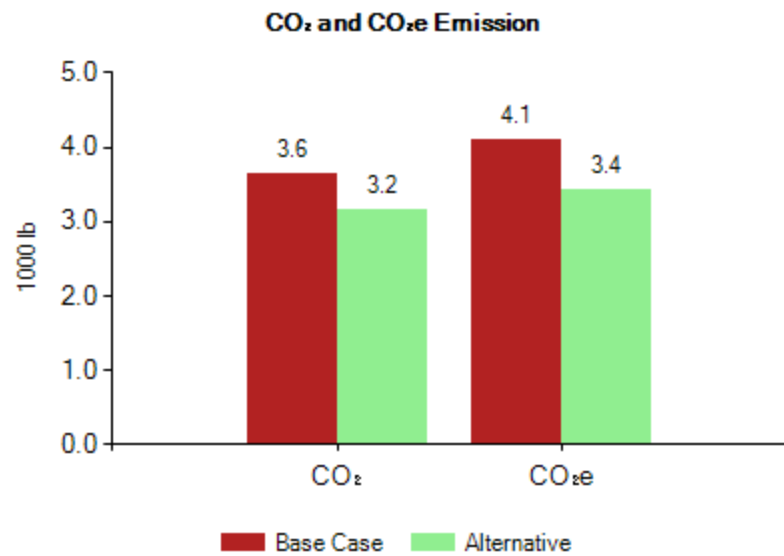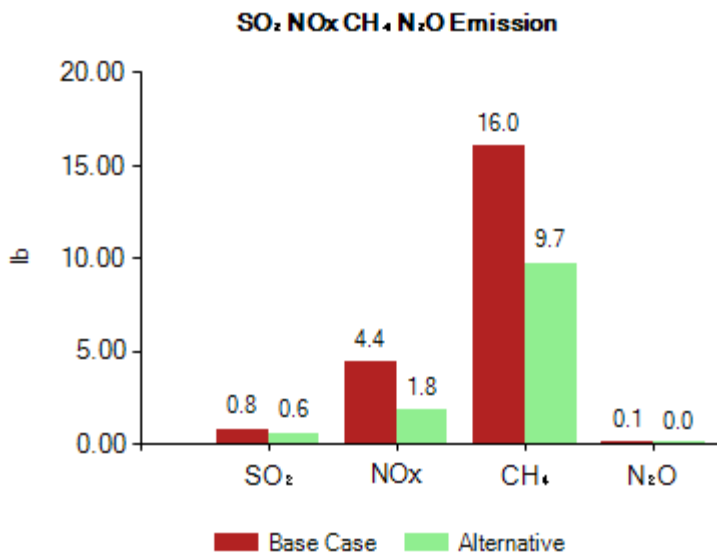

# Energy Planning Analysis Tool



## Building Location and Configuration

State:	Arkansas	Population:	2,915,918	Total State Home:	1,106,338
--------	----------	-------------	-----------	-------------------	-----------

### State Residential Electric Houses

Included?	House Type	Number of Units	Average Size (ft2)	Number of People per Unit
	Moblile	0	1,273	3
x	Single Fam. Detached	11,400	1,542	3
	Single Fam. Attached	825	1,318	3
	Apt. Building 2 to 4 units	1,775	1,000	3
	Apt. Building 5+ units	4,395	763	3
	<b>All Residential Electric Houses</b>	<b>11,400</b>	<b>1,542</b>	<b>3</b>

### State Energy Price \*

Electric Price (Cents/kWh)	Gas Price ( \$/Therm)	Propane Price (\$/Gal)
9.81	1.16	2.24

\*Note: EIA 2018 state annual prices

## Select Building Configurations

### Single House

		Baseline	Alternative
Included?	Application	Equipment and Appliances	Equipment and Appliances
x	Space Heating	<b>Natural Gas, AFUE 98%</b> Electric Consumption: 0 ( kWh) Gas Consumption: 236 ( Therm) Installed Cost: 2,807 \$/Unit +3.86 \$/kBtuh Unit Capacity: 60 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 2,217 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 4,745 \$/Unit +42.00 \$/kBtuh Unit Capacity: 70 kBtuh
	Space Cooling	<b>13 SEER(11.07 EER) A/C</b> Electric Consumption: 1,421 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 2,153 \$/Unit +42.00 \$/kBtu Unit Capacity: 36 kBtuh	<b>20.5 SEER /13 HSPF Heat Pump</b> Electric Consumption: 841 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 0 \$/Unit +0.00 \$/kBtu Unit Capacity: 36 kBtuh
x	HVAC Blower	Electric Consumption: 603 ( kWh)	Electric Consumption: 548 ( kWh)
	Water Heating	<b>Natural Gas EF 0.95 - Condensing Tankless</b> Electric Consumption: 45 ( kWh) Gas Consumption: 127 ( Therm) Installed Cost: 2,515 \$/Unit Unit Capacity: 199 kBtu/h	<b>Electric Resistance EF, 0.95</b> Electric Consumption: 3,759 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 591 \$/Unit +3.50 \$/gal Unit Capacity: 60 Gal
	Lighting &	Electric Consumption: 2,236 ( kWh)	Electric Consumption: 2,236 ( kWh)

	Plug-in Loads		
	Cooking Range	<b>Gas Standard</b> Electric Consumption: 0 ( kWh) Gas Consumption: 31 ( Therm) Installed Cost: 823 \$/Unit	<b>Electric Standard EF 0.74</b> Electric Consumption: 0 ( kWh) Gas Consumption: 0 ( therm) Installed Cost: 923 \$/Unit
	Refrigerator	How many: 1 Electric Consumption: 0 ( kWh)	How many: 1 Electric Consumption: 0 ( kWh)
	Dishwasher	How many: 1 Electric Consumption: 172 ( kWh)	How many: 1 Electric Consumption: 172 ( kWh)
	Washer	How many: 1 Electric Consumption: 88 ( kWh)	How many: 1 Electric Consumption: 0 ( kWh)
	Clothes Dryer	<b>Gas Standard EF 3.84</b> Electric Consumption: 76 ( kWh) Gas Consumption: 25 ( Therm) Installed Cost: 1,100 \$/Unit	<b>Electric Standard EF 3.93</b> Electric Consumption: 766 ( kWh) Gas Consumption: 0 ( Therm) Installed Cost: 930 \$/Unit
	Micro CHP	<b>None</b> Electric Reduced: 0 ( kWh) Electric Export to Grid: 0 ( kWh) NG Building Used Reduction: 0 ( therm) mCHP NG Consumption: 0 ( therm) Installed Cost: 0 \$/Unit +0 \$/kW	<b>None</b> Electric Reduced: 0 ( kWh) Electric Export to Grid: 0 ( kWh) NG Building Used Reduction: 0 ( therm) mCHP NG Consumption: 0 ( therm) Installed Cost: 0 \$/Unit +0 \$/kW

## Source Energy Factors And Composite Emission Factors

Geographic Area: State: Arkansas

eGrid Database: eGRID 2018 data plant level database

### Source Energy Factors

	Electric	Natural Gas	Propane
Btu/Btu	2.33	1.09	1.15

### Composite Emission Factors



Energy Form	CO2	SO2	NOx	CH4	N2O	CO2e
Electricity (lb/MWh)	947.7	0.180	0.540	2.920	0.0010	1,029.8
Natural Gas (Building Used, lb/MMBtu)	130.2	0.029	0.172	0.605	0.0030	147.8
Oil (lb/MMBtu)	35.1	0.084	0.281	0.511	0.0030	50.3
Natural Gas (mCHP NG Engine Used, lb/MMBtu)	163.2	0.055	0.225	0.079	0.0110	168.3
Natural Gas (mCHP Fuel Cell Used, lb/MMBtu)	43.5	0.101	0.281	0.013	0.0110	47.0

Source Energy and Emission Factors are calculated for AR: Energy conversion efficiency and specific emissions data for electricity generated using fossil fuels and biomass are based on eGRID 2018 data plant level database screened to verify primary fuel plant classification. Electric distribution efficiency data are based on eGRID 2018 data plant level database. Electricity generation fuel mix distribution data are based on user custom data All other default data are based on EIA, NREL, and ANL (GREET 1 2012) data sources.

## Energy Consumption and Cost

	Energy	Annual Site Consumption	Annual Site Consumption	Annual Source Consumption	Annual Energy Cost	Equipment Invest Cost
			(MMBtu)	(MMBtu)	(\$)	(\$)
Baseline	Electric (Building Used)	603 (kWh)	2.06	4.79	59	3,039
	Electric (mCHP to Grid)	0 (kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	236 (Therm)	23.60	25.72	274	
	Natural Gas (mCHP Used)	0 (Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (Gal)	0.00	0.00	0	
	<b>Total</b>		<b>25.66</b>	<b>30.52</b>	<b>333</b>	
Alternative	Electric (Building Used)	2,765 (kWh)	9.43	21.98	271	7,685
	Electric (mCHP to Grid)	0 (kWh)	0.00	0.00	0	
	Natural Gas (Building Used)	0 (Therm)	0.00	0.00	0	
	Natural Gas (mCHP Used)	0 (Therm)	0.00	0.00	0	
	Propane (Building Used)	0 (Gal)	0.00	0.00	0	
	<b>Total</b>		<b>9.43</b>	<b>21.98</b>	<b>271</b>	

	Energy Cost Savings (Baseline-Alternative)	Equipment Invest Cost (Alternative-Baseline)	Simple Payback (Year)
	(\$)	(\$)	(Year)
Comparison	62	4,646	74.9

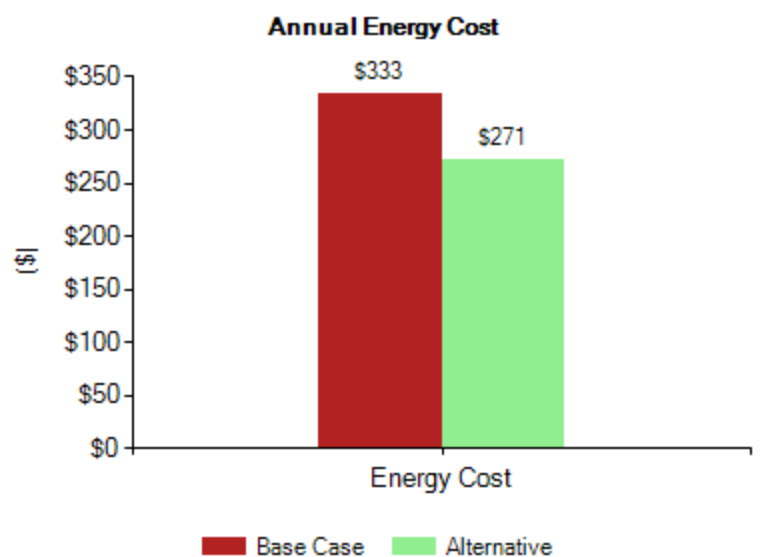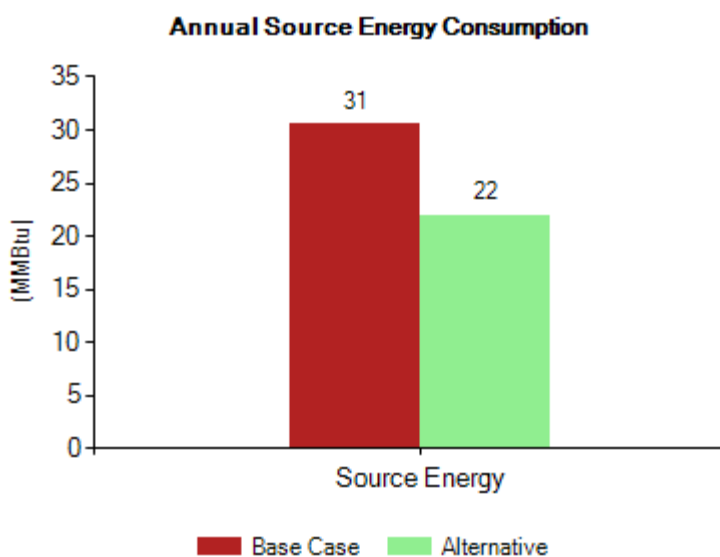

## Annual Source Emissions

	SO <sub>2</sub> (lb)	NO <sub>x</sub> (lb)	CO <sub>2</sub> (1000 lb)	CH <sub>4</sub> (lb)	N <sub>2</sub> O (lb)	CO <sub>2</sub> e (1000 lb)
Baseline	0.79	4.38	3.64	16.04	0.07	4.11
Alternative	0.50	1.49	2.62	8.07	0.00	2.85

